


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 77.52 lm/W
MODEL		Imax (cd)	1917	S/MH(C0/180)	0.51	
NOMINAL POWER(W)	10	LOR(%)	100.0	S/MH(C90/270)	0.52	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	772.99	η UP,DN(C0-180)	0.0,51.3	
NOMINAL FLUX(lm)	772.992	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,48.7	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	240.35	η down (%)	100.0	CIBSE SHR MAX	0.50	

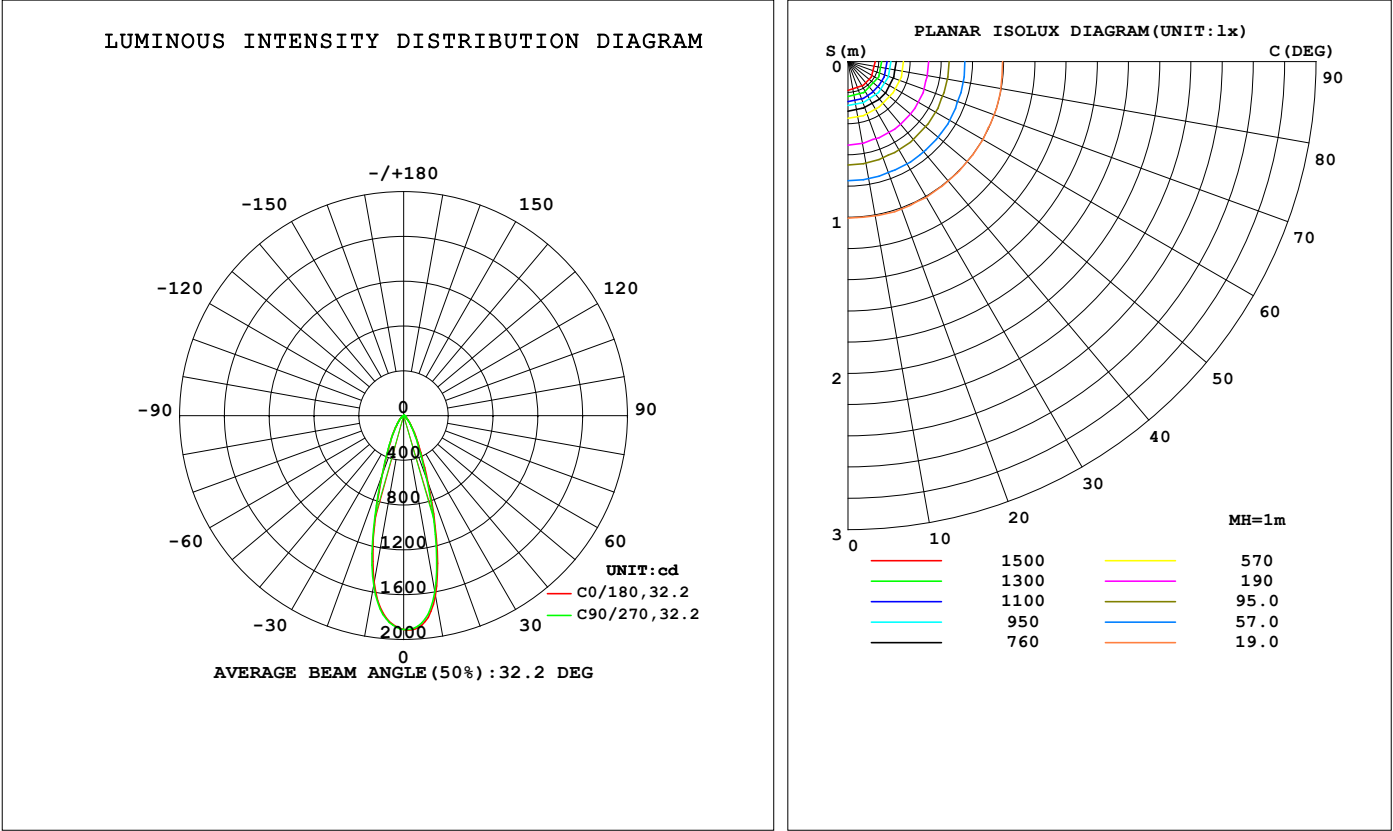

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1633	1636	1604	1564	1515	1500	1544	1595	0- 10	167.6	167.6	21.7,21.7
20	641.5	629.8	606.8	590.4	563.2	551.6	576.4	613.1	10- 20	290.3	458.0	59.2,59.2
30	223.2	216.4	205.6	203.9	197.3	191.8	200.1	213.3	20- 30	160.6	618.6	80,80
40	86.53	85.22	81.60	79.56	77.80	77.93	79.28	83.09	30- 40	82.26	700.8	90.7,90.7
50	33.96	33.64	31.91	30.95	30.55	30.77	31.52	32.54	40- 50	40.49	741.3	95.9,95.9
60	14.63	14.55	13.81	13.54	13.47	13.49	13.80	14.21	50- 60	19.04	760.4	98.4,98.4
70	6.447	6.352	5.597	5.976	5.911	5.819	5.496	6.198	60- 70	9.494	769.9	99.6,99.6
80	1.234	0.4178	0.1750	0.4121	1.090	0.4023	0.1907	0.4384	70- 80	3.015	772.9	100,100
90	0.0128	0	0.0116	0	0.0070	0	0.0061	0.0039	80- 90	0.1113	773.0	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 724.89 lm

%lum = 93.8%

%lamp = 93.8%

Conical surface Flux(120deg): 760.37 lm

%lum = 98.4%


%lamp = 98.4%

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

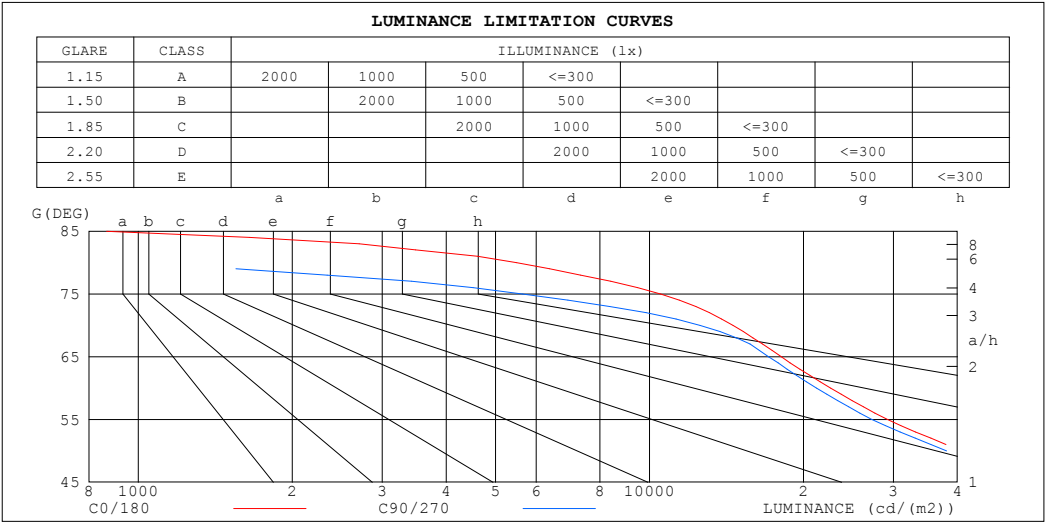

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	867	219
80	5493	774
75	10517	5648
70	14563	12564
65	18123	17096
60	22611	21213
55	29215	27222
50	40819	38117
45	59174	55742


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376		
Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.11	1.09	1.07	1.09	1.07	1.05	1.05	1.04	1.02	1.02	1.00	.99	.98	.97	.96	.94
2.0	1.04	1.01	.98	1.03	.99	.97	.00	.97	.94	.97	.94	.92	.94	.92	.91	.89
3.0	.98	.94	.90	.97	.93	.90	.94	.91	.88	.92	.89	.87	.90	.87	.85	.84
4.0	.93	.88	.84	.92	.87	.84	.90	.86	.83	.88	.84	.82	.86	.83	.81	.79
5.0	.88	.83	.79	.87	.82	.79	.86	.81	.78	.84	.80	.77	.82	.79	.77	.75
6.0	.84	.79	.75	.83	.78	.74	.82	.77	.74	.80	.76	.74	.79	.76	.73	.72
7.0	.80	.75	.71	.79	.74	.71	.78	.74	.70	.77	.73	.70	.76	.72	.70	.68
8.0	.76	.71	.68	.76	.71	.67	.75	.70	.67	.74	.70	.67	.73	.69	.67	.65
9.0	.73	.68	.65	.73	.68	.64	.72	.67	.64	.71	.67	.64	.70	.67	.64	.63
10.0	.70	.65	.62	.70	.65	.62	.69	.65	.62	.68	.64	.62	.68	.64	.61	.60

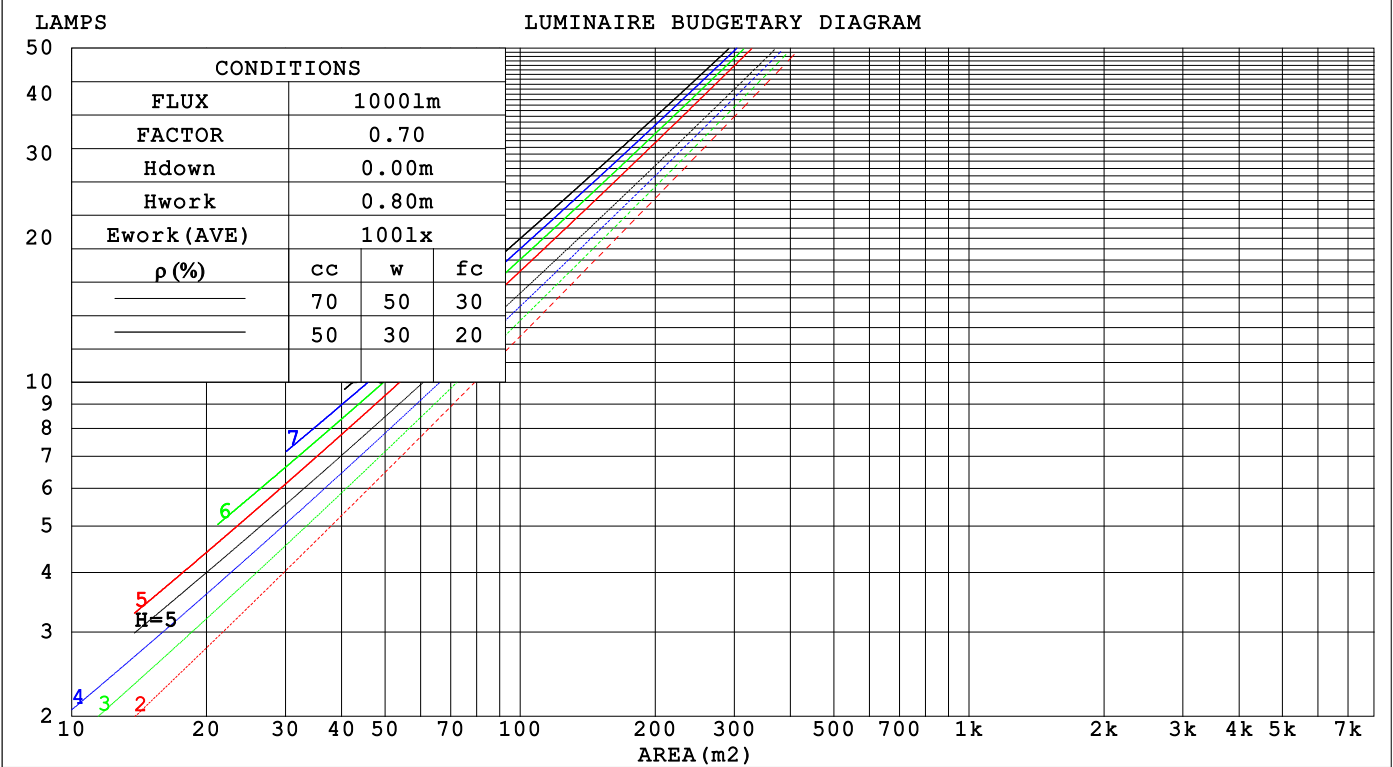

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.166	.094	.030	.159	.091	.029	.146	.084	.027	.135	.078	.025	.124	.072	.023															
2.0	.157	.086	.026	.151	.083	.026	.141	.078	.024	.131	.074	.023	.122	.069	.022															
3.0	.148	.079	.024	.143	.077	.023	.135	.073	.022	.126	.069	.021	.119	.066	.020															
4.0	.140	.073	.021	.136	.071	.021	.128	.068	.020	.121	.065	.020	.115	.062	.019															
5.0	.132	.067	.020	.129	.066	.019	.122	.064	.019	.116	.061	.018	.111	.059	.018															
6.0	.126	.063	.018	.123	.062	.018	.117	.060	.017	.111	.058	.017	.106	.056	.017															
7.0	.119	.059	.017	.117	.058	.017	.112	.056	.016	.107	.055	.016	.102	.053	.016															
8.0	.114	.056	.016	.111	.055	.015	.107	.053	.015	.103	.052	.015	.099	.051	.015															
9.0	.109	.053	.015	.106	.052	.015	.102	.051	.014	.099	.049	.014	.095	.048	.014															
10.0	.104	.050	.014	.102	.049	.014	.098	.048	.014	.095	.047	.013	.092	.046	.013															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.157	.146	.146	.135	.125	.100	.093	.087	.057	.054	.050	.018	.017	.016	
2.0	.154	.133	.114	.132	.114	.099	.091	.079	.069	.052	.046	.040	.017	.015	.013	
3.0	.141	.113	.092	.121	.098	.079	.083	.068	.056	.048	.040	.033	.015	.013	.011	
4.0	.130	.099	.075	.111	.085	.065	.077	.059	.046	.044	.035	.027	.014	.011	.009	
5.0	.121	.087	.062	.103	.075	.054	.071	.052	.038	.041	.031	.022	.013	.010	.007	
6.0	.112	.077	.052	.097	.067	.045	.067	.047	.032	.039	.028	.019	.012	.009	.006	
7.0	.105	.069	.044	.091	.060	.038	.063	.042	.027	.036	.025	.016	.012	.008	.005	
8.0	.099	.063	.038	.085	.055	.033	.059	.038	.023	.034	.023	.014	.011	.007	.005	
9.0	.094	.057	.033	.081	.050	.029	.056	.035	.020	.033	.021	.012	.011	.007	.004	
10.0	.089	.053	.029	.077	.046	.025	.053	.032	.018	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz										
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376					Lamp Flux:772.992x1 lm					
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: Norming lighting					SUR.: 41mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	20.8	21.7	21.1	21.8	22.0	20.6	21.4	20.8	21.6	21.7
3H	21.0	21.8	21.3	22.0	22.2	20.7	21.5	21.0	21.7	21.9
4H	21.1	21.8	21.3	22.0	22.2	20.7	21.5	21.0	21.7	21.9
6H	21.0	21.7	21.3	22.0	22.2	20.6	21.3	20.9	21.6	21.8
8H	21.0	21.7	21.3	21.9	22.2	20.6	21.3	20.9	21.5	21.8
12H	20.9	21.6	21.3	21.8	22.1	20.5	21.2	20.9	21.4	21.7
4H 2H	20.9	21.6	21.1	21.8	22.0	20.6	21.3	20.9	21.5	21.8
3H	21.1	21.8	21.5	22.0	22.3	20.8	21.5	21.2	21.8	22.0
4H	21.2	21.8	21.5	22.1	22.4	20.8	21.4	21.2	21.7	22.0
6H	21.1	21.7	21.5	22.0	22.3	20.7	21.3	21.1	21.6	21.9
8H	21.1	21.6	21.5	21.9	22.3	20.7	21.2	21.1	21.5	21.9
12H	21.1	21.5	21.5	21.9	22.3	20.6	21.1	21.0	21.5	21.8
8H 4H	21.1	21.6	21.5	21.9	22.3	20.7	21.2	21.1	21.6	21.9
6H	21.1	21.4	21.5	21.8	22.3	20.7	21.1	21.1	21.4	21.9
8H	21.0	21.4	21.5	21.8	22.2	20.6	20.9	21.0	21.4	21.8
12H	20.9	21.2	21.4	21.7	22.2	20.5	20.8	21.0	21.3	21.8
12H 4H	21.0	21.5	21.5	21.9	22.2	20.7	21.1	21.1	21.5	21.9
6H	21.0	21.3	21.4	21.8	22.2	20.6	21.0	21.0	21.4	21.8
8H	20.9	21.2	21.4	21.7	22.2	20.5	20.8	21.0	21.3	21.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.5 / - 2.5					+ 1.5 / - 2.7				
1.5H	+ 2.5 / - 2.0					+ 2.3 / - 2.0				
2.0H	+ 2.9 / - 2.1					+ 2.9 / - 2.1				

CIE Pub.117, 773.0 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -0.9$)
Area: 0.0013 m²

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	86	79	75	85	79	75	84	78	75	71
0.80	93	87	83	93	87	83	91	86	83	79
1.00	98	92	88	97	92	88	96	92	88	83
1.25	102	97	93	101	96	93	99	95	92	88
1.50	105	100	97	104	99	96	102	98	95	90
2.00	108	104	100	107	103	100	104	101	98	93
2.50	110	106	103	108	105	102	105	102	100	94
3.00	111	108	105	110	106	104	106	104	102	95
4.00	113	111	108	111	109	107	108	106	104	97
5.00	115	112	111	113	111	109	109	107	106	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-07-23

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 γ Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

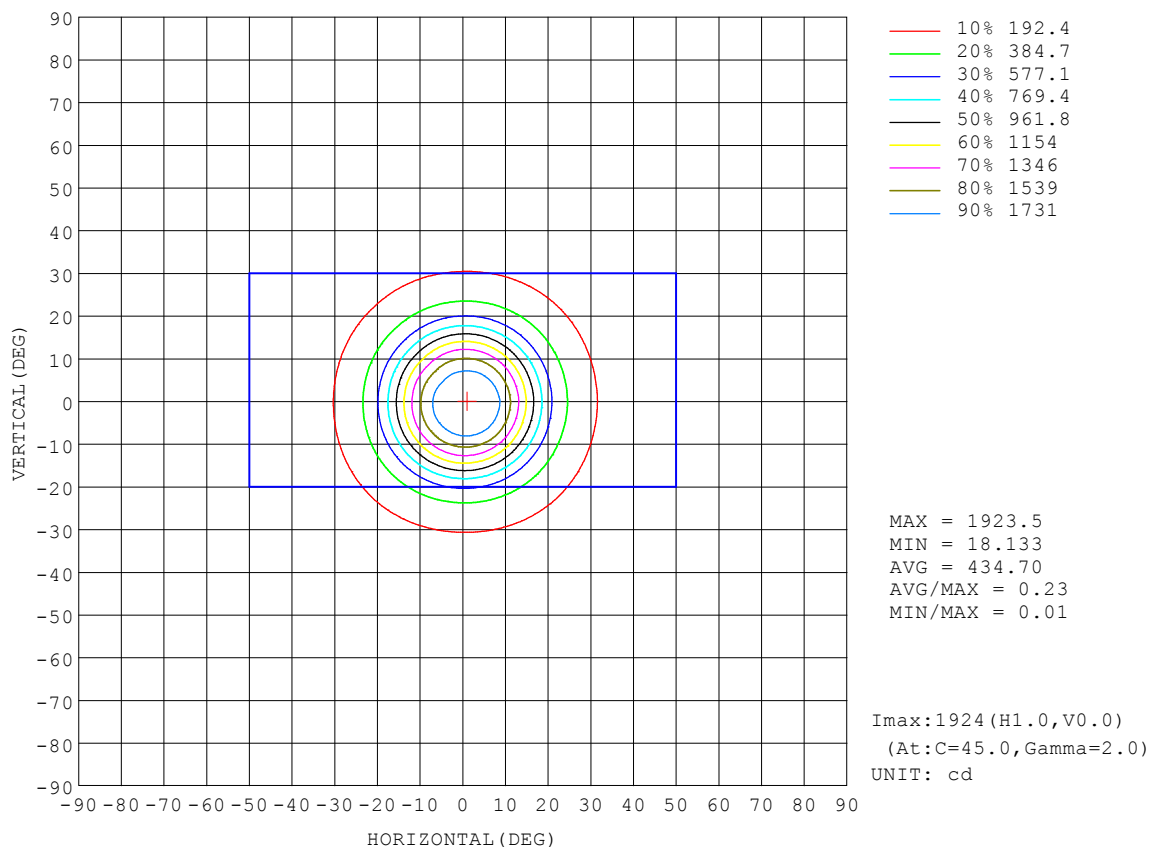


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

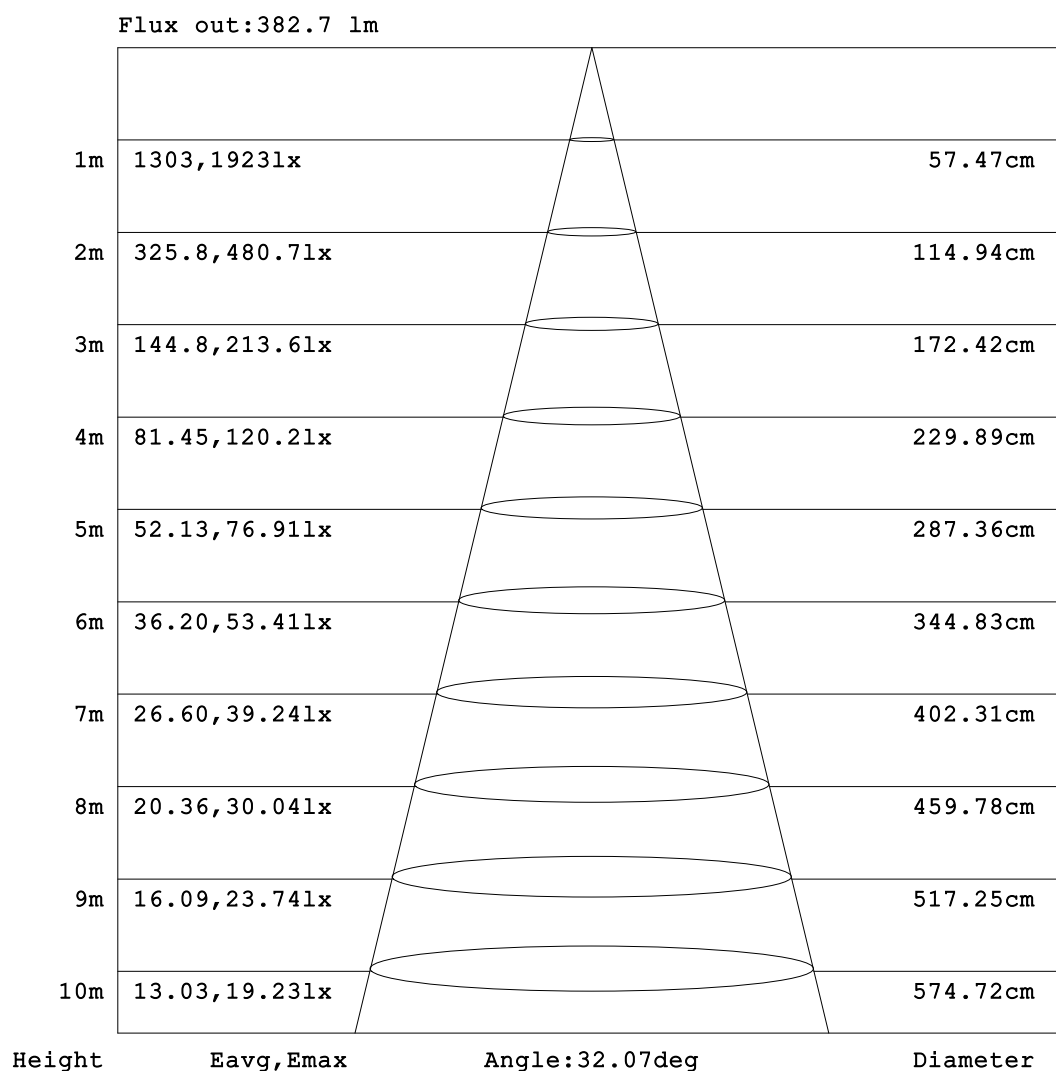


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

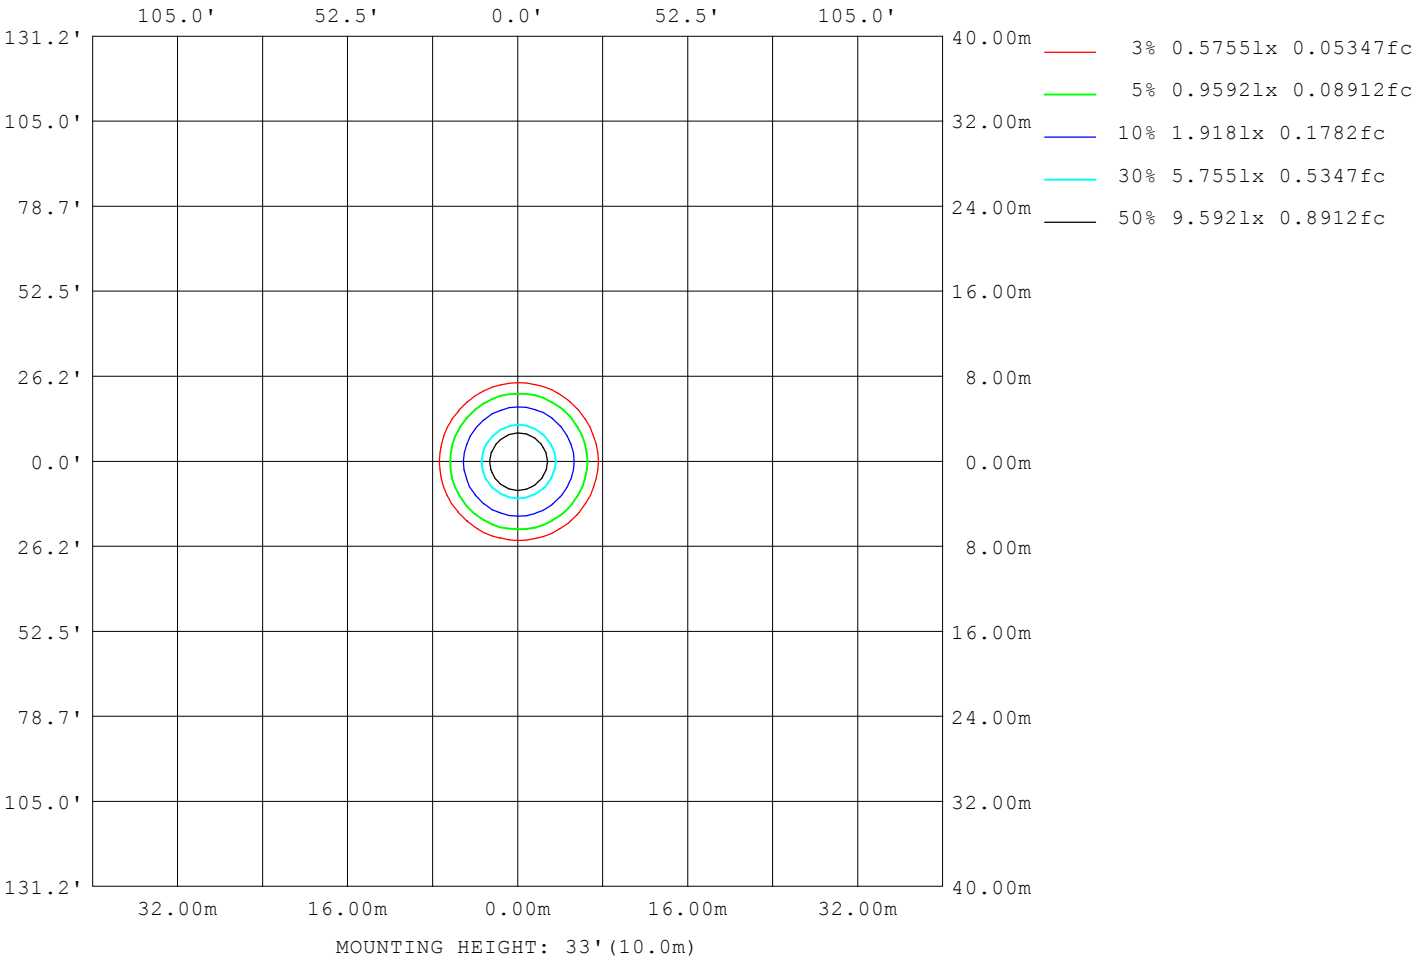

C Range: 0 - 360DEG	γ Range: 0 - 90DEG
C Interval: 45.0DEG	γ Interval: 1.0DEG
Test Speed: HIGH	Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Temperature:25.3DEG	Humidity:65.0%
Operators:DAMIN	Test Distance:3.090m [K=1.0000]
Test Date:2024-07-23	Remarks:

LED Avg.L Report

Test:U:240.4V I:0.0451A P:10.0W PF:0.9199 Freq:49.99Hz UTHDi:0.17% ITHDi:19.48% KDisp:0.9376 Lamp Flux:772.992x1 lm		
NAME: DL56-10-XX-02 3000K RA90 24D MAX 反光杯	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	17319
L_0~180 (75) av	9940
L_0~180 (85) av	772
L_90~270 (65) av	17020
L_90~270 (75) av	5628
L_90~270 (85) av	178
L_45 (65) av	17190
L_45 (75) av	7927
L_45 (85) av	12

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-07-23

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

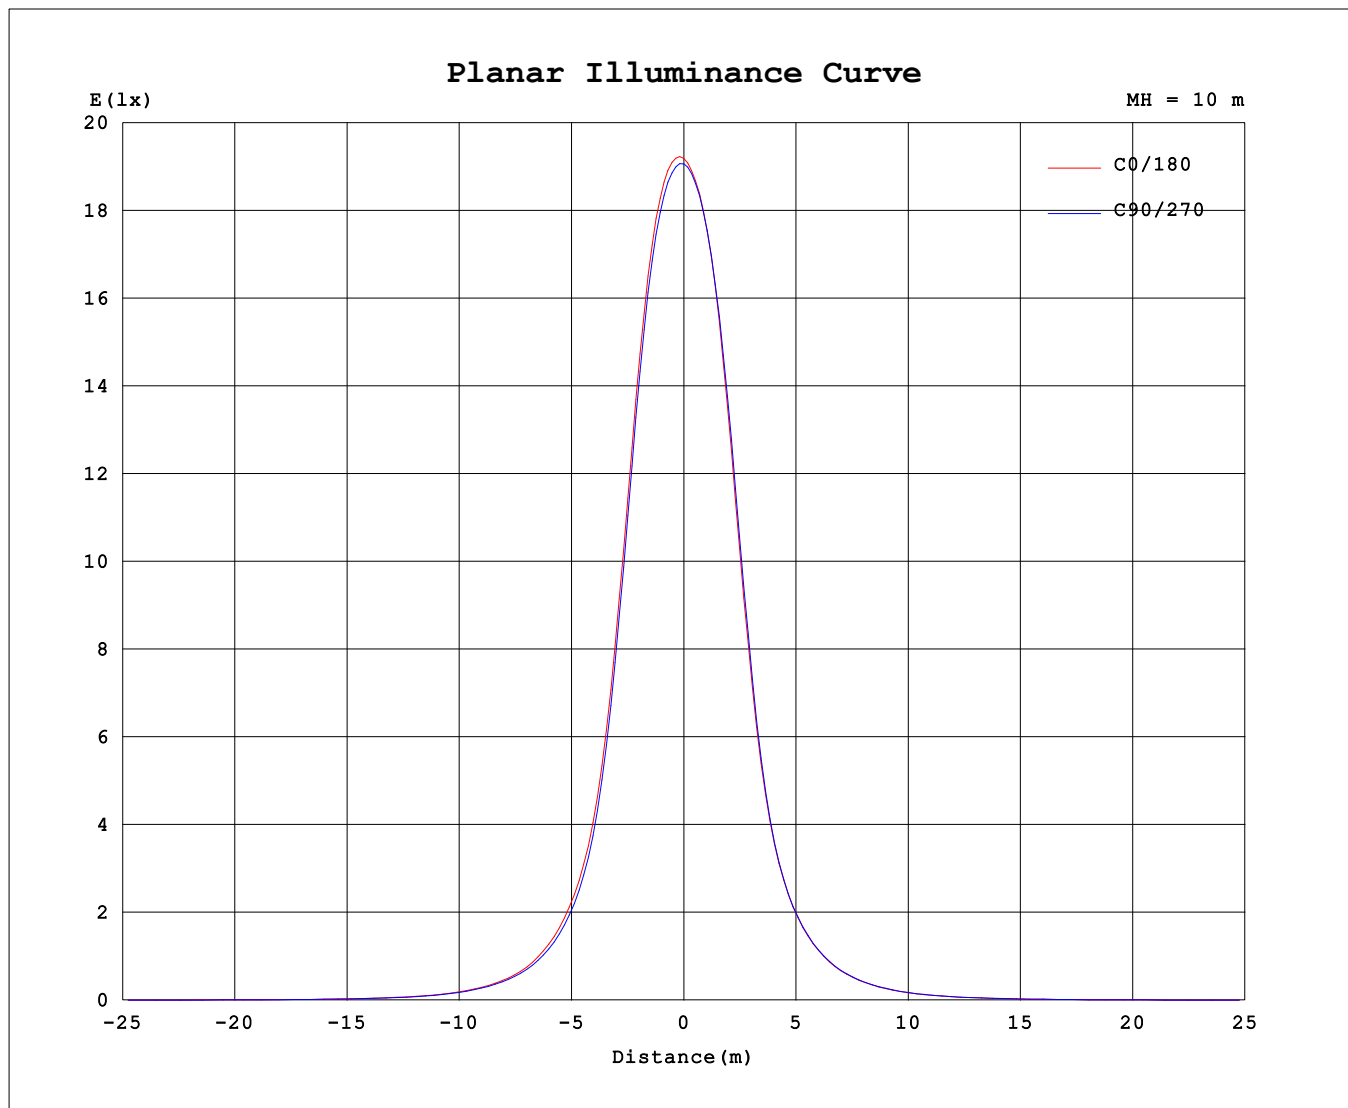

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-07-23

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	1910	1910	1910	1910	1910	1910	1910	1910
3.0	1909	1914	1898	1881	1868	1861	1874	1891
6.0	1850	1854	1829	1802	1773	1758	1786	1820
9.0	1706	1709	1678	1641	1597	1579	1620	1670
12.0	1457	1458	1423	1382	1329	1315	1365	1418
15.0	1135	1133	1098	1062	1013	1004	1048	1098
18.0	818.8	812.5	781.9	757.2	720.7	710.9	742.8	785.8
21.0	567.7	555.4	533.6	521.4	499.4	488.1	509.2	541.7
24.0	405.3	391.6	375.2	370.2	357.9	348.1	362.3	386.9
27.0	299.6	288.4	275.7	271.9	263.9	256.9	266.9	286.9
30.0	223.2	216.4	205.6	203.9	197.3	191.8	200.1	213.3
33.0	166.8	161.7	154.1	153.2	147.7	145.4	150.4	159.1
36.0	124.5	122.4	116.6	114.6	111.7	110.3	113.9	119.7
39.0	94.89	93.36	89.42	87.29	85.25	85.15	86.82	91.15
42.0	71.80	70.93	67.97	66.02	64.86	64.88	66.11	68.99
45.0	54.16	53.60	51.34	49.69	48.85	49.14	50.06	51.90
48.0	40.91	40.49	38.60	37.28	36.80	37.08	37.95	39.18
51.0	30.97	30.74	29.09	28.28	27.92	28.10	28.85	29.78
54.0	23.60	23.43	22.16	21.66	21.45	21.52	22.14	22.84
57.0	18.45	18.31	17.38	17.03	16.96	16.96	17.41	17.94
60.0	14.63	14.55	13.81	13.54	13.47	13.49	13.80	14.21
63.0	11.57	11.54	10.99	10.77	10.67	10.63	10.90	11.23
66.0	9.145	9.087	8.689	8.503	8.410	8.374	8.560	8.864
69.0	7.073	7.023	6.406	6.592	6.499	6.440	6.282	6.848
72.0	5.239	4.952	3.962	4.694	4.782	4.553	3.898	4.866
75.0	3.523	2.741	1.904	2.654	3.165	2.548	1.883	2.725
78.0	1.973	1.131	0.6342	1.110	1.756	1.057	0.6628	1.129
81.0	0.9334	0.1680	0.0919	0.1852	0.7705	0.1691	0.0905	0.1881
84.0	0.2229	0.0071	0.0274	0.0092	0.1322	0.0072	0.0199	0.0092
87.0	0.0180	0	0.0209	0.0000	0.0157	0	0.0142	0.0000
90.0	0.0128	0	0.0116	0	0.0070	0	0.0061	0.0039

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2024-07-23

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks: