


## LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm		
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 104mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 112.80 lm/W			
MODEL		Imax (cd)	4126	S/MH(C0/180)	0.86
NOMINAL POWER(W)	35	LOR(%)	100.0	S/MH(C90/270)	0.90
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	3944.3	$\eta$ UP,DN(C0-180)	0.0,49.8
NOMINAL FLUX(lm)	3944.34	CIE CLASS	DIRECT	$\eta$ UP,DN(C180-360)	0.0,50.2
LAMPS INSIDE	1	$\eta$ up (%)	0.0	CIBSE SHR NOM	0.75
TEST VOLTAGE(V)	240.3	$\eta$ down (%)	100.0	CIBSE SHR MAX	0.90

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

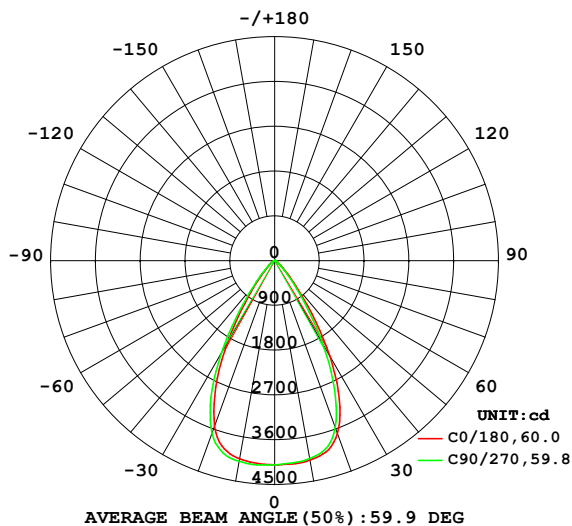

PLANAR ISOLUX DIAGRAM (UNIT:lx)

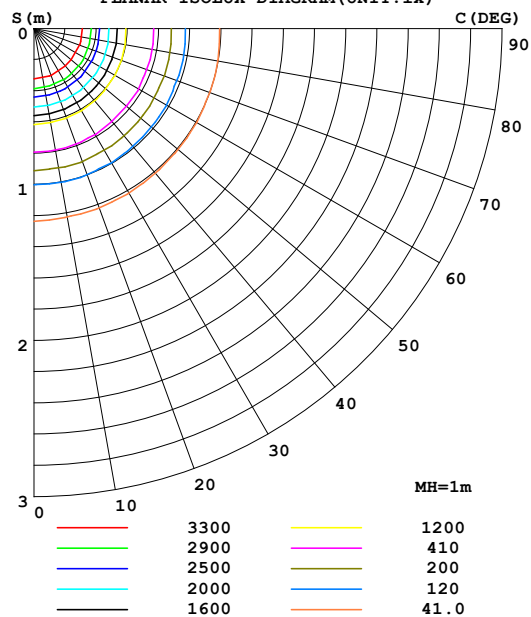

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-29

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

## ZONAL FLUX DIAGRAM

## ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	4073	4047	4038	4035	4043	4078	4097	4097	0- 10	390.1	390.1	9.89,9.89
20	3692	3616	3565	3539	3538	3600	3689	3711	10- 20	1104	1494	37.9,37.9
30	2226	2108	1953	1887	1887	1980	2141	2248	20- 30	1322	2816	71.4,71.4
40	666.8	614.8	552.4	525.7	525.7	572.4	640.1	675.8	30- 40	752.2	3568	90.5,90.5
50	180.8	164.7	151.5	148.5	147.3	156.1	175.7	186.9	40- 50	250.3	3819	96.8,96.8
60	62.67	55.38	49.74	46.71	44.52	45.46	53.23	58.68	50- 60	89.26	3908	99.1,99.1
70	17.69	17.04	15.15	12.24	10.18	12.13	15.47	16.99	60- 70	29.20	3937	99.8,99.8
80	3.313	3.313	3.061	2.594	2.290	2.439	2.795	3.043	70- 80	6.102	3943	100,100
90	0.1459	0.0950	0.1286	0.1069	0.1103	0.1002	0.1067	0.0946	80- 90	1.166	3944	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 3728 lm

%lum = 94.5%

%lamp = 94.5%

Conical surface Flux(120deg): 3907.9 lm

%lum = 99.1%


%lamp = 99.1%

C Range: 0 - 360DEG  
 C Interval: 45.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:DAMIN  
 Test Date:2024-10-29

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
 Humidity:65.0%  
 Test Distance:3.090m [K=1.0000]  
 Remarks:

## LUMINANCE LIMITATION CURVES

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm		
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 104mm	Shielding Angle:

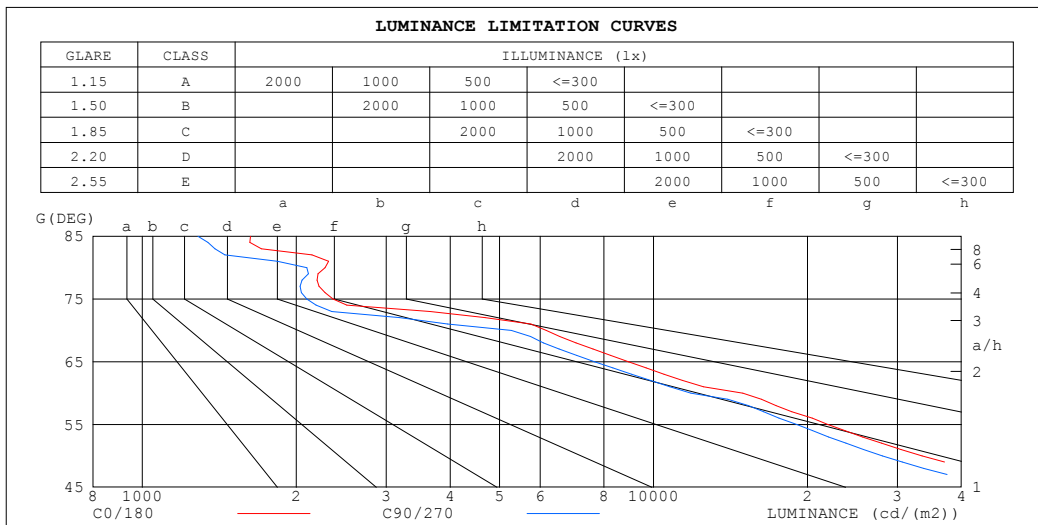

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	1626	1284
80	2276	2097
75	2359	2099
70	6169	5269
65	8930	7664
60	14949	11836
55	21946	19066
50	33540	28033
45	57514	46829


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm		
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 104mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

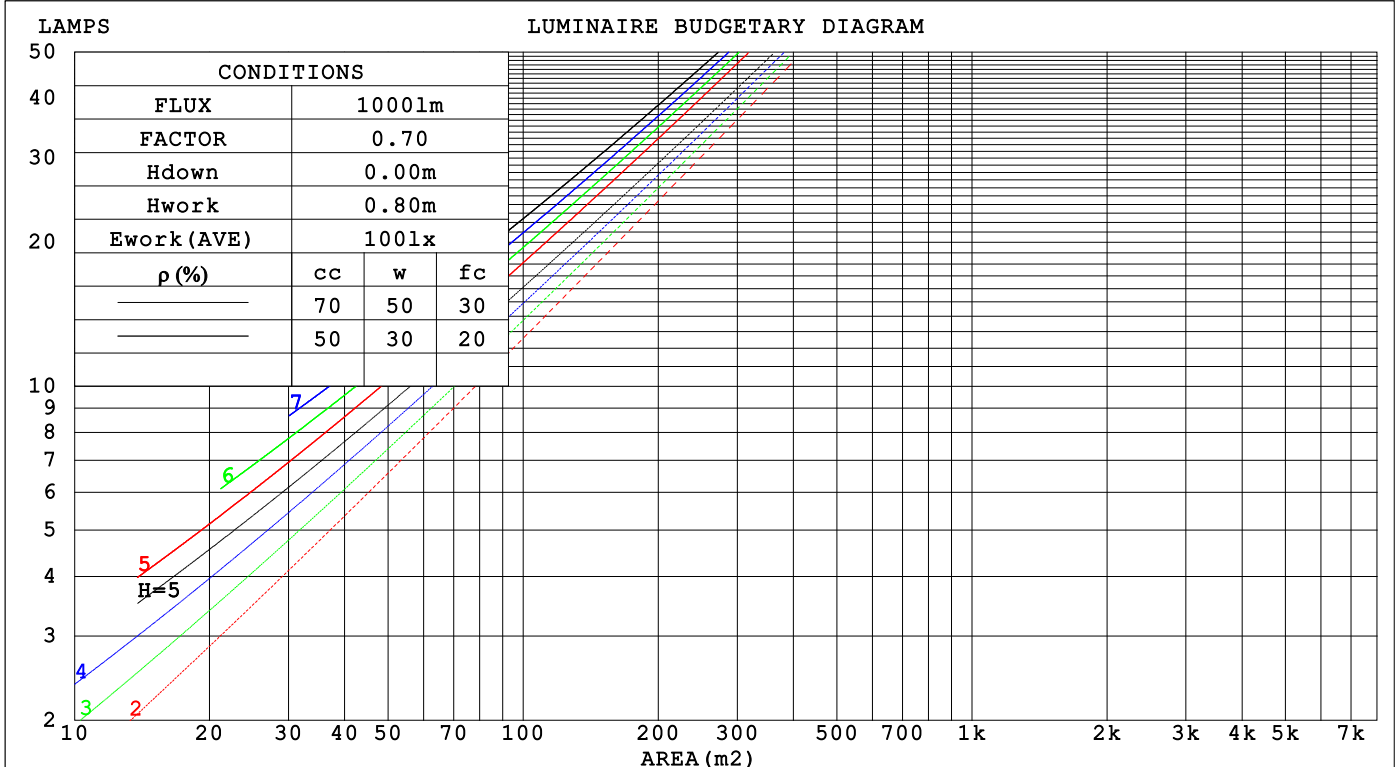

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### WEC AND CCEC

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm		
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:		WEIGHT:
SPEC.:		SERIAL No.:
MFR.: Norming lighting		Shielding Angle:
SUR.: 104mm		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.181	.103	.033	.174	.099	.032	.162	.093	.030	.150	.086	.028	.139	.081	.026		
2.0	.174	.095	.029	.168	.093	.029	.157	.088	.027	.148	.083	.026	.139	.078	.025		
3.0	.166	.088	.026	.161	.086	.026	.152	.082	.025	.143	.079	.024	.136	.075	.023		
4.0	.158	.082	.024	.154	.080	.024	.146	.077	.023	.139	.074	.022	.132	.072	.022		
5.0	.150	.077	.022	.147	.075	.022	.140	.073	.021	.134	.070	.021	.128	.068	.020		
6.0	.144	.072	.021	.140	.071	.020	.134	.069	.020	.129	.067	.020	.123	.065	.019		
7.0	.137	.068	.019	.134	.067	.019	.129	.065	.019	.124	.064	.018	.119	.062	.018		
8.0	.131	.064	.018	.129	.063	.018	.124	.062	.018	.119	.060	.017	.115	.059	.017		
9.0	.126	.061	.017	.123	.060	.017	.119	.059	.017	.115	.058	.017	.111	.056	.016		
10.0	.120	.058	.016	.118	.057	.016	.115	.056	.016	.111	.055	.016	.107	.054	.016		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.171	.157	.145	.147	.135	.124	.100	.093	.086	.058	.054	.050	.018	.017	.016		
2.0	.156	.132	.112	.134	.114	.097	.092	.079	.068	.053	.046	.040	.017	.015	.013		
3.0	.144	.114	.089	.124	.098	.077	.085	.068	.054	.049	.040	.032	.016	.013	.010		
4.0	.134	.099	.072	.115	.086	.062	.079	.060	.044	.046	.035	.026	.015	.011	.009		
5.0	.126	.087	.059	.108	.076	.051	.074	.053	.036	.043	.031	.022	.014	.010	.007		
6.0	.119	.078	.049	.102	.068	.043	.070	.047	.030	.041	.028	.018	.013	.009	.006		
7.0	.112	.071	.042	.096	.061	.036	.067	.043	.026	.039	.025	.015	.013	.008	.005		
8.0	.106	.064	.036	.092	.056	.031	.063	.039	.022	.037	.023	.013	.012	.008	.004		
9.0	.101	.059	.031	.087	.051	.027	.061	.036	.019	.035	.021	.011	.011	.007	.004		
10.0	.097	.055	.027	.084	.048	.024	.058	.034	.017	.034	.020	.010	.011	.007	.003		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## UGR(Unified Glare Rating) Table

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm											
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:						WEIGHT:					
SPEC.:						DIM.:		SERIAL No.:			
MFR.: Norming lighting						SUR.: 104mm		Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	22.4	23.4	22.6	23.5	23.7	21.7	22.7	21.9	22.8	23.0
	3H	22.3	23.2	22.5	23.4	23.6	21.6	22.5	21.8	22.7	22.9
	4H	22.2	23.0	22.5	23.3	23.5	21.5	22.3	21.8	22.6	22.8
	6H	22.1	22.9	22.4	23.1	23.4	21.4	22.2	21.7	22.4	22.7
	8H	22.1	22.8	22.4	23.1	23.3	21.4	22.1	21.7	22.4	22.6
	12H	22.0	22.8	22.4	23.0	23.3	21.3	22.0	21.6	22.3	22.6
4H	2H	22.2	23.0	22.5	23.3	23.5	21.5	22.4	21.8	22.6	22.8
	3H	22.1	22.8	22.4	23.1	23.4	21.4	22.1	21.7	22.4	22.7
	4H	22.0	22.7	22.4	23.0	23.3	21.3	22.0	21.7	22.3	22.6
	6H	21.9	22.5	22.3	22.8	23.2	21.2	21.8	21.6	22.1	22.5
	8H	21.9	22.4	22.3	22.8	23.1	21.2	21.7	21.6	22.1	22.4
	12H	21.8	22.3	22.2	22.7	23.1	21.1	21.6	21.5	22.0	22.4
8H	4H	21.9	22.4	22.3	22.8	23.1	21.2	21.7	21.6	22.1	22.4
	6H	21.8	22.2	22.2	22.6	23.0	21.1	21.5	21.5	21.9	22.3
	8H	21.7	22.1	22.2	22.5	23.0	21.0	21.4	21.5	21.8	22.3
	12H	21.7	22.0	22.1	22.5	22.9	21.0	21.3	21.5	21.8	22.2
12H	4H	21.8	22.3	22.2	22.7	23.1	21.1	21.6	21.5	22.0	22.4
	6H	21.7	22.1	22.2	22.5	23.0	21.0	21.4	21.5	21.8	22.3
	8H	21.7	22.0	22.1	22.5	22.9	21.0	21.3	21.5	21.8	22.2
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H		+ 3.0 / - 6.2					+ 2.6 / - 6.1				
1.5H		+ 4.7 / - 4.6					+ 4.3 / - 4.2				
2.0H		+ 4.8 / - 5.0					+ 4.1 / - 4.6				

CIE Pub.117, 3944 lm Total Lamp Luminous Flux Corrected ( $8\log(F/F_0) = 4.8$ )  
Area: 0.0084 m<sup>2</sup>

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### UTILIZATION FACTORS TABLE

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm		
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:		WEIGHT:
SPEC.:		SERIAL No.:
MFR.: Norming lighting		Shielding Angle:
SUR.: 104mm		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	85	79	75	85	79	75	84	78	75	71
0.80	93	87	83	93	87	83	91	86	83	79
1.00	98	92	88	97	92	88	96	92	88	84
1.25	102	97	93	101	96	93	99	95	92	88
1.50	105	100	97	104	100	96	102	98	95	91
2.00	108	104	101	107	103	100	104	101	98	93
2.50	110	106	103	108	105	102	105	102	100	94
3.00	111	108	105	110	107	104	106	104	102	95
4.00	114	111	108	111	109	107	108	106	104	97
5.00	115	112	111	113	111	109	109	107	106	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ISOCANDELA DIAGRAM

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm		
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 104mm	Shielding Angle:

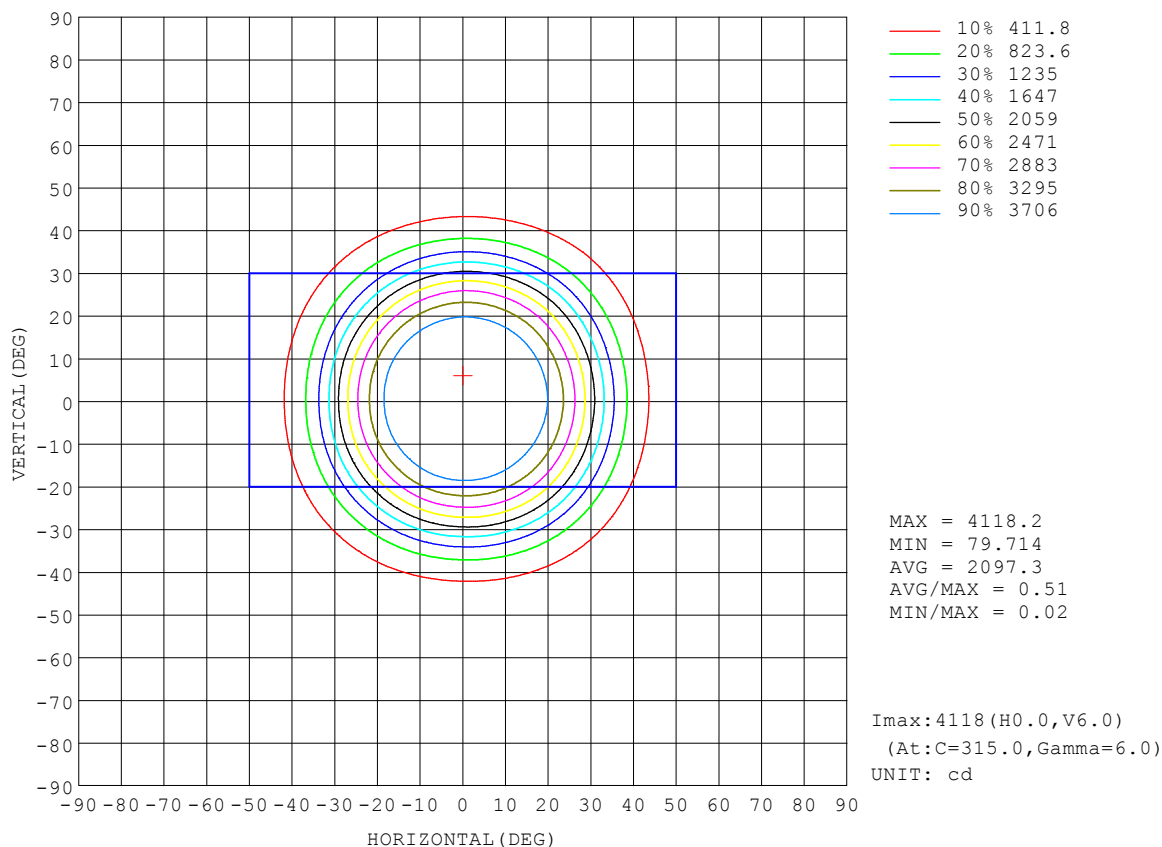


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:



AAI Figure

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850		Lamp Flux:3944.34x1 lm
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 104mm	Shielding Angle:

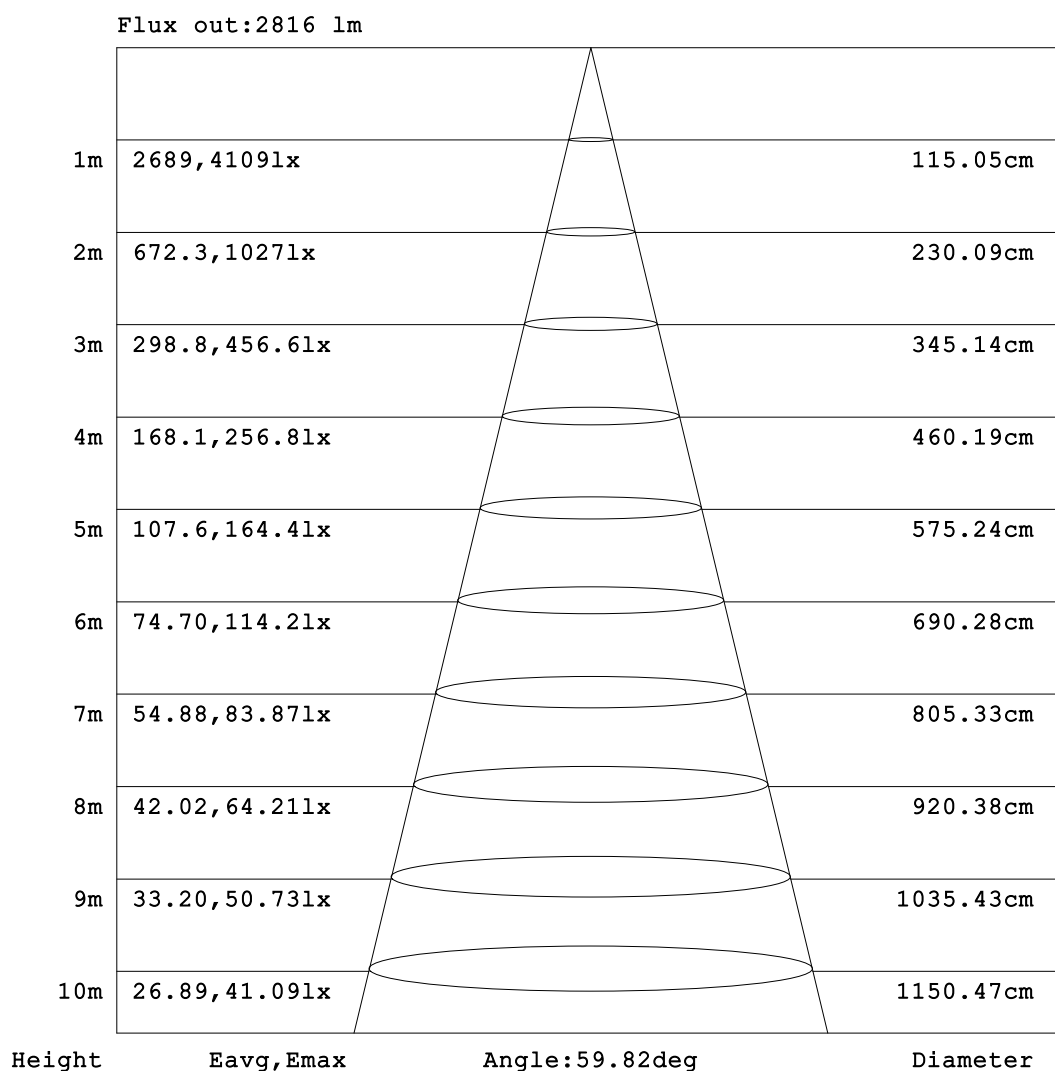


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-29

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

ISOLUX DIAGRAM

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz		
UTHDi:0.18% ITHDi:5.49% KDisp:0.9850		Lamp Flux:3944.34x1 lm
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 104mm	Shielding Angle:

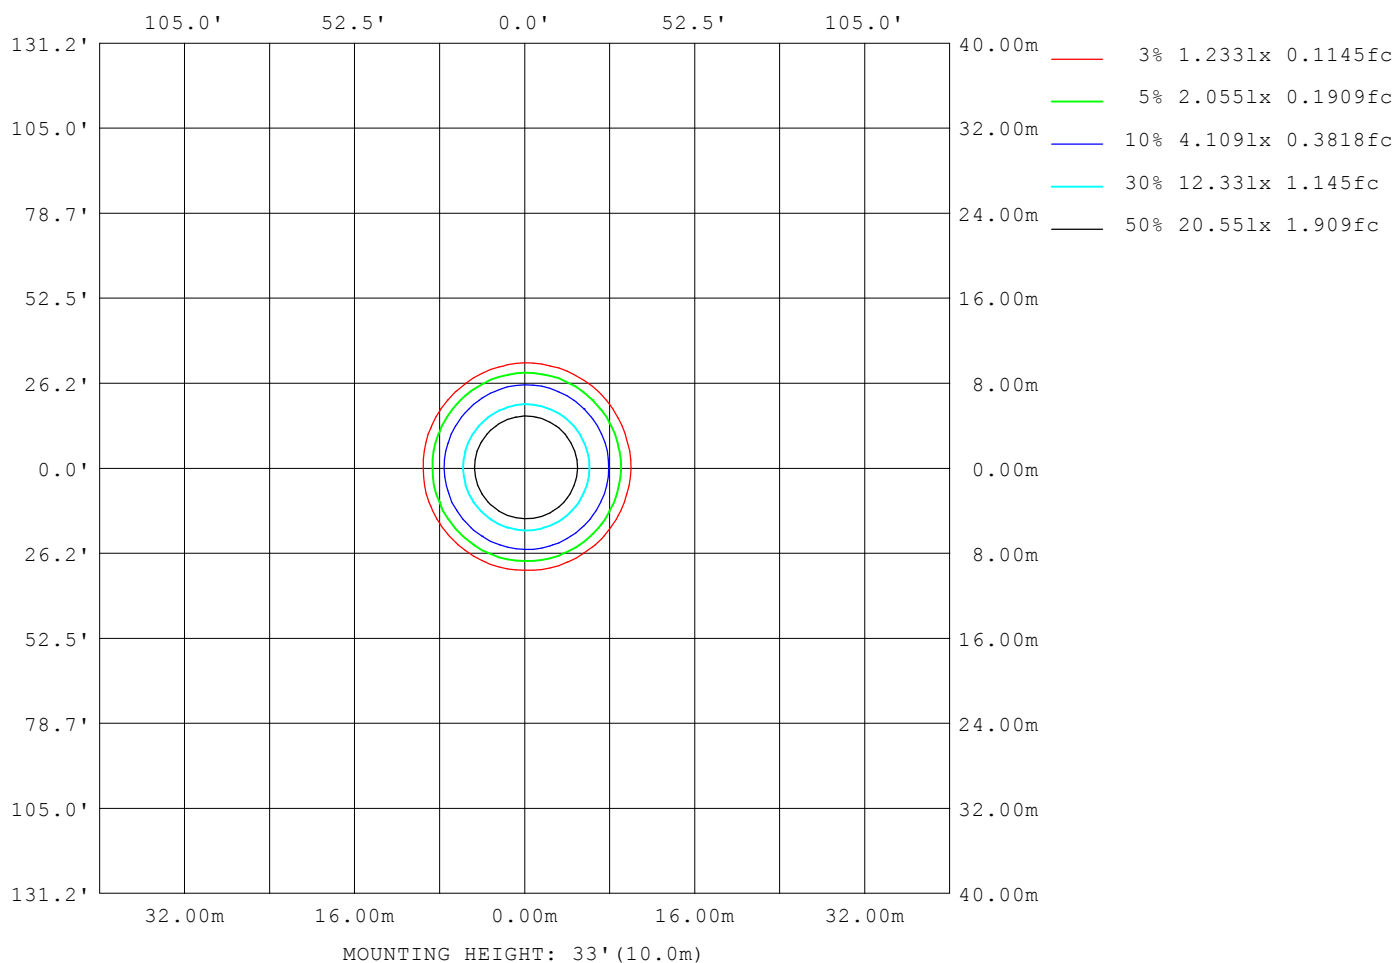

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## LED Avg.L Report

Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm		
NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D TYPE:	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 104mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	7933
L_0~180 (75) av	2090
L_0~180 (85) av	1271
L_90~270 (65) av	7872
L_90~270 (75) av	2062
L_90~270 (85) av	1263
L_45 (65) av	7798
L_45 (75) av	2070
L_45 (85) av	1230

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

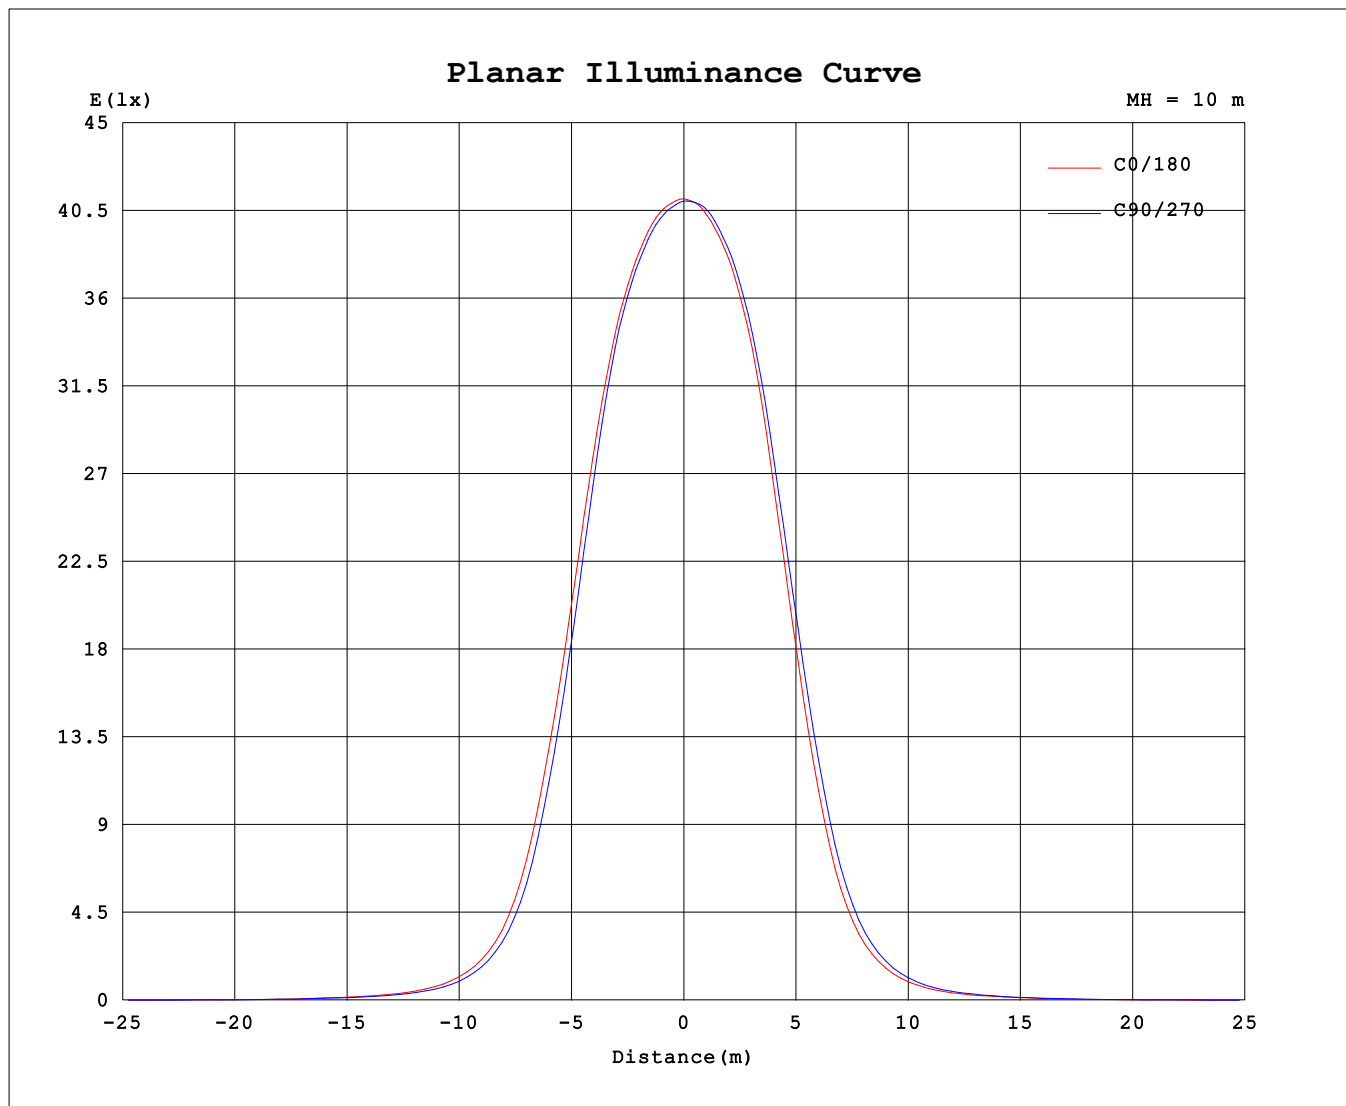

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-29

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

<b>Test:U:240.3V I:0.1478A P:35.0W PF:0.9845 Freq:49.99Hz</b> <b>UTHDi:0.18% ITHDi:5.49% KDisp:0.9850 Lamp Flux:3944.34x1 lm</b>		
<b>NAME: FUSION GT-TR02-AHD-035-COB-01SC 4000K RA90 60D 350PE:</b>	<b>WEIGHT:</b>	
<b>SPEC.:</b>	<b>DIM.:</b>	<b>SERIAL No.:</b>
<b>MFR.: Norming lighting</b>	<b>SUR.: 104mm</b>	<b>Shielding Angle:</b>

UNIT: cd

[illegible]

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

### Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	4102	4102	4102	4102	4102	4102	4102	4102
3.0	4098	4084	4088	4094	4099	4104	4109	4110
6.0	4100	4076	4078	4082	4082	4100	4121	4126
9.0	4085	4059	4052	4048	4055	4086	4105	4108
12.0	4046	4014	4006	4003	4011	4055	4078	4068
15.0	3981	3936	3925	3919	3915	3959	4001	4001
18.0	3843	3777	3756	3742	3737	3796	3853	3860
21.0	3597	3514	3446	3412	3407	3478	3579	3618
24.0	3235	3141	3016	2953	2970	3060	3184	3242
27.0	2762	2650	2497	2436	2450	2543	2694	2783
30.0	2226	2108	1953	1887	1887	1980	2141	2248
33.0	1671	1559	1415	1354	1347	1432	1579	1680
36.0	1149	1056	952.5	910.9	908.1	978.6	1090	1158
39.0	764.3	704.5	634.3	601.9	602.9	656.3	734.2	773.2
42.0	508.5	466.8	419.0	398.9	399.9	435.3	488.8	516.5
45.0	341.0	309.2	278.3	267.1	267.2	289.8	327.0	347.1
48.0	230.5	210.4	189.9	185.9	184.5	197.5	224.4	236.6
51.0	160.9	147.0	136.3	133.3	132.4	139.7	157.1	166.9
54.0	116.7	107.2	101.1	99.33	96.94	100.9	115.2	120.7
57.0	85.09	77.98	75.21	73.32	71.66	74.71	83.79	88.08
60.0	62.67	55.38	49.74	46.71	44.52	45.46	53.23	58.68
63.0	39.89	36.31	34.59	32.83	31.42	31.67	36.70	39.67
66.0	28.11	25.85	24.20	22.70	21.83	22.23	25.27	27.59
69.0	19.69	18.97	17.31	15.99	14.83	15.90	17.58	18.95
72.0	12.14	10.14	8.283	5.803	5.412	5.696	7.007	9.936
75.0	5.120	4.921	4.567	4.212	3.968	4.018	4.398	4.847
78.0	3.828	3.775	3.589	3.417	3.163	3.101	3.254	3.587
81.0	3.035	2.944	2.415	1.829	1.588	1.756	2.326	2.735
84.0	1.421	1.331	1.180	0.9719	0.8847	0.9188	1.127	1.286
87.0	0.7399	0.6364	0.5000	0.3275	0.2764	0.3273	0.5082	0.6309
90.0	0.1459	0.0950	0.1286	0.1069	0.1103	0.1002	0.1067	0.0946

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-29

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks: