


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm		
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D TYPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 109.95 lm/W			
MODEL		Imax (cd)	5429	S/MH(C0/180)	0.83
NOMINAL POWER(W)	40	LOR(%)	100.0	S/MH(C90/270)	0.82
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	4346.1	η UP,DN(C0-180)	0.0,49.5
NOMINAL FLUX(lm)	4346.09	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.5
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.75
TEST VOLTAGE(V)	240.24	η down (%)	100.0	CIBSE SHR MAX	0.85

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

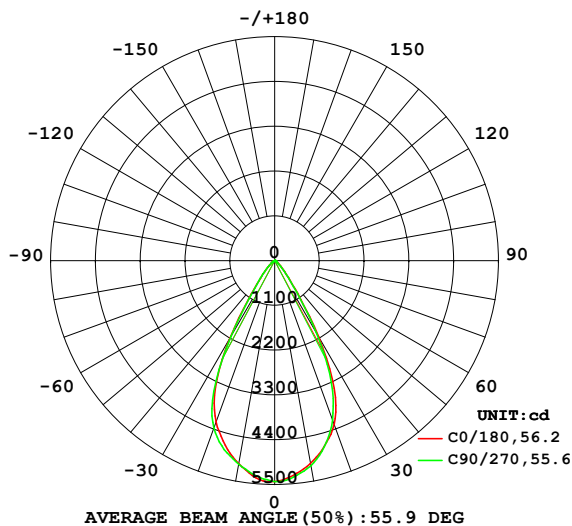

PLANAR ISOLUX DIAGRAM(UNIT:lx)

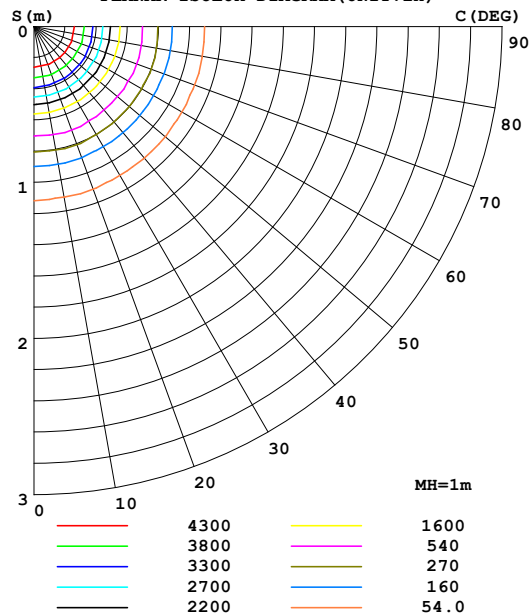

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	5058	5088	5120	5108	5067	5087	5077	5052	0- 10	500.1	500.1	11.5,11.5
20	4276	4192	4159	4193	4207	4331	4373	4337	10- 20	1326	1826	42,42
30	2173	2114	2061	2140	2206	2206	2149	2133	20- 30	1523	3349	77,77
40	485.3	461.5	452.7	475.9	489.7	498.2	500.8	476.2	30- 40	667.9	4016	92.4,92.4
50	143.7	132.3	129.3	137.5	143.1	143.1	143.5	143.7	40- 50	209.8	4226	97.2,97.2
60	56.29	52.58	53.54	54.37	55.31	56.76	55.79	56.70	50- 60	78.50	4305	99,99
70	15.74	15.47	15.64	15.84	16.37	16.83	16.26	15.93	60- 70	32.20	4337	99.8,99.8
80	2.801	2.725	2.823	2.945	2.995	2.918	2.853	2.805	70- 80	7.984	4345	100,100
90	0.1553	0.1182	0.1533	0.2017	0.1787	0.1198	0.1273	0.1200	80- 90	1.150	4346	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 4148.8 lm

%lum = 95.5%

%lamp = 95.5%

Conical surface Flux(120deg): 4304.8 lm

%lum = 99.0%


%lamp = 99.0%

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2024-10-28

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm		
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 40WPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

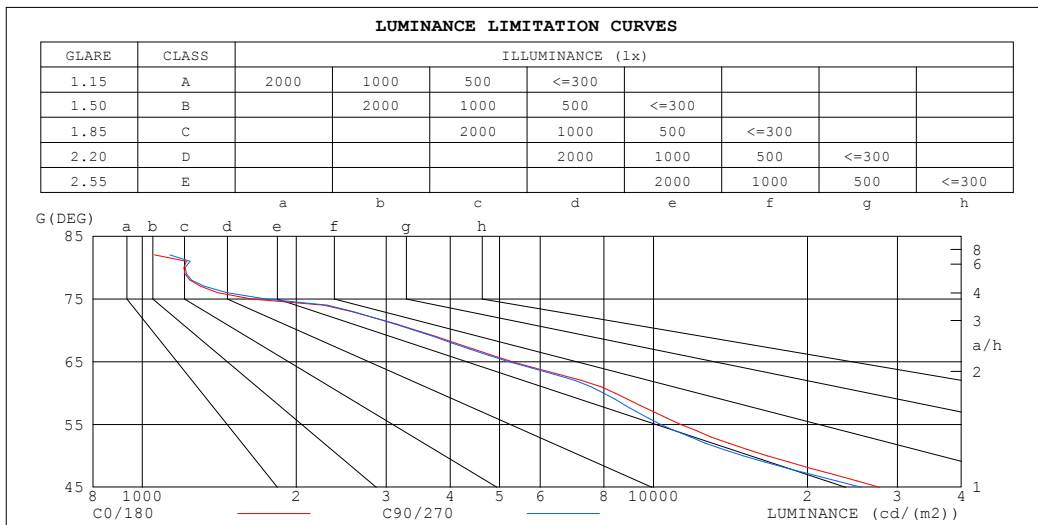


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm		
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 40WPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.11	1.08	1.06	1.09	1.07	1.05	1.05	1.03	1.01	1.01	.00	.98	.98	.96	.95	.94
2.0	1.03	.99	.96	1.02	.98	.95	.98	.95	.93	.95	.93	.91	.93	.91	.89	.87
3.0	.97	.92	.88	.95	.91	.87	.93	.89	.86	.90	.87	.84	.88	.85	.83	.82
4.0	.90	.85	.81	.89	.84	.81	.87	.83	.80	.85	.82	.79	.83	.80	.78	.76
5.0	.85	.79	.75	.84	.79	.75	.82	.78	.74	.81	.77	.73	.79	.76	.73	.71
6.0	.80	.74	.70	.79	.74	.70	.78	.73	.69	.76	.72	.69	.75	.71	.68	.67
7.0	.75	.70	.66	.75	.69	.65	.74	.69	.65	.72	.68	.65	.71	.67	.64	.63
8.0	.71	.66	.62	.71	.65	.61	.70	.65	.61	.69	.64	.61	.68	.64	.61	.59
9.0	.68	.62	.58	.67	.62	.58	.66	.61	.58	.65	.61	.57	.64	.60	.57	.56
10.0	.64	.58	.55	.64	.58	.55	.63	.58	.55	.62	.58	.54	.61	.57	.54	.53

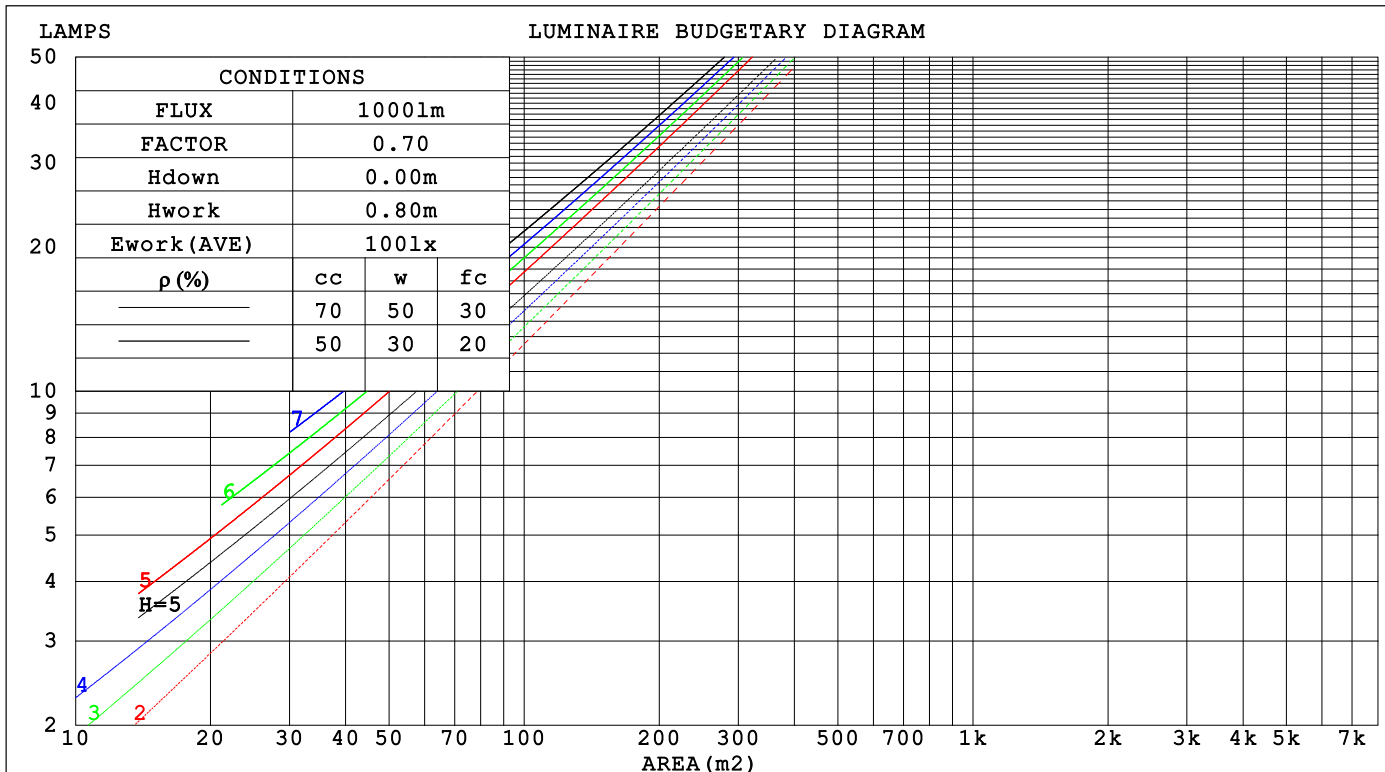

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm		
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D TYPE:		WEIGHT:
SPEC.:		SERIAL No.:
MFR.: Norming lighting		Shielding Angle:
SUR.: 131mm		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.175	.100	.032	.169	.096	.031	.156	.090	.029	.145	.083	.027	.134	.078	.025		
2.0	.168	.092	.028	.162	.089	.028	.152	.084	.026	.142	.080	.025	.133	.075	.024		
3.0	.160	.085	.025	.155	.083	.025	.146	.079	.024	.137	.075	.023	.130	.072	.022		
4.0	.152	.079	.023	.148	.077	.023	.140	.074	.022	.133	.071	.021	.126	.068	.021		
5.0	.145	.074	.021	.141	.072	.021	.134	.070	.021	.128	.067	.020	.122	.065	.020		
6.0	.138	.069	.020	.135	.068	.020	.129	.066	.019	.123	.064	.019	.118	.062	.018		
7.0	.132	.065	.018	.129	.064	.018	.124	.063	.018	.119	.061	.018	.114	.059	.017		
8.0	.126	.062	.017	.124	.061	.017	.119	.059	.017	.114	.058	.017	.110	.057	.016		
9.0	.121	.058	.016	.119	.058	.016	.114	.057	.016	.110	.055	.016	.107	.054	.016		
10.0	.116	.056	.015	.114	.055	.015	.110	.054	.015	.107	.053	.015	.103	.052	.015		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.171	.157	.145	.146	.135	.125	.100	.093	.086	.058	.054	.050	.018	.017	.016		
2.0	.156	.133	.113	.133	.114	.098	.091	.079	.068	.053	.046	.040	.017	.015	.013		
3.0	.143	.114	.090	.123	.098	.078	.084	.068	.055	.049	.040	.032	.016	.013	.011		
4.0	.133	.099	.073	.114	.085	.063	.078	.060	.045	.045	.035	.026	.015	.011	.009		
5.0	.124	.087	.060	.107	.075	.052	.073	.053	.037	.043	.031	.022	.014	.010	.007		
6.0	.117	.078	.050	.100	.067	.044	.069	.047	.031	.040	.028	.018	.013	.009	.006		
7.0	.110	.070	.042	.095	.061	.037	.065	.043	.026	.038	.025	.016	.012	.008	.005		
8.0	.104	.064	.036	.090	.056	.032	.062	.039	.022	.036	.023	.013	.012	.008	.004		
9.0	.099	.059	.031	.086	.051	.027	.059	.036	.019	.035	.021	.012	.011	.007	.004		
10.0	.095	.054	.028	.082	.047	.024	.057	.033	.017	.033	.020	.010	.011	.006	.003		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm										
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 40WPE:								WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: Norming lighting					SUR.: 131mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	19.0	19.9	19.2	20.1	20.2	18.7	19.7	18.9	19.8	20.0
3H	18.9	19.7	19.1	19.9	20.1	18.6	19.5	18.9	19.7	19.9
4H	18.8	19.6	19.1	19.8	20.1	18.6	19.4	18.8	19.6	19.8
6H	18.7	19.5	19.0	19.7	20.0	18.5	19.2	18.8	19.5	19.7
8H	18.7	19.4	19.0	19.7	19.9	18.4	19.2	18.7	19.4	19.7
12H	18.6	19.3	18.9	19.6	19.9	18.4	19.1	18.7	19.4	19.6
4H 2H	18.8	19.6	19.1	19.8	20.0	18.6	19.4	18.8	19.6	19.8
3H	18.7	19.4	19.0	19.7	20.0	18.5	19.2	18.8	19.4	19.7
4H	18.6	19.3	19.0	19.6	19.9	18.4	19.0	18.8	19.3	19.6
6H	18.6	19.1	18.9	19.4	19.8	18.3	18.9	18.7	19.2	19.6
8H	18.5	19.0	18.9	19.4	19.7	18.3	18.8	18.7	19.1	19.5
12H	18.5	18.9	18.9	19.3	19.7	18.2	18.7	18.6	19.1	19.5
8H 4H	18.5	19.0	18.9	19.4	19.7	18.3	18.8	18.7	19.1	19.5
6H	18.4	18.8	18.8	19.2	19.6	18.2	18.6	18.6	19.0	19.4
8H	18.4	18.7	18.8	19.2	19.6	18.1	18.5	18.6	18.9	19.4
12H	18.3	18.6	18.8	19.1	19.5	18.1	18.4	18.6	18.8	19.3
12H 4H	18.5	18.9	18.9	19.3	19.7	18.2	18.7	18.6	19.1	19.5
6H	18.4	18.7	18.8	19.2	19.6	18.1	18.5	18.6	18.9	19.4
8H	18.3	18.6	18.8	19.1	19.5	18.1	18.4	18.6	18.8	19.3
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.8 / - 5.0					+ 2.6 / - 5.0				
1.5H	+ 4.4 / - 4.0					+ 4.3 / - 3.9				
2.0H	+ 4.2 / - 3.7					+ 4.0 / - 3.4				

CIE Pub.117, 4346 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = 5.1)
Area: 0.0134 m2

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm		
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 40WPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	80	76	86	80	76	85	80	76	73
0.80	94	88	85	94	88	84	92	87	84	80
1.00	99	93	90	98	93	89	96	93	89	85
1.25	103	98	94	102	97	94	100	96	93	89
1.50	106	101	98	104	100	97	102	99	96	91
2.00	108	104	101	107	103	100	104	101	99	94
2.50	110	106	103	109	105	102	105	103	101	95
3.00	112	108	106	110	107	104	107	104	102	96
4.00	114	111	109	112	109	107	108	106	105	98
5.00	115	113	111	113	111	109	109	107	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2024-10-28

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm		
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 40WPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

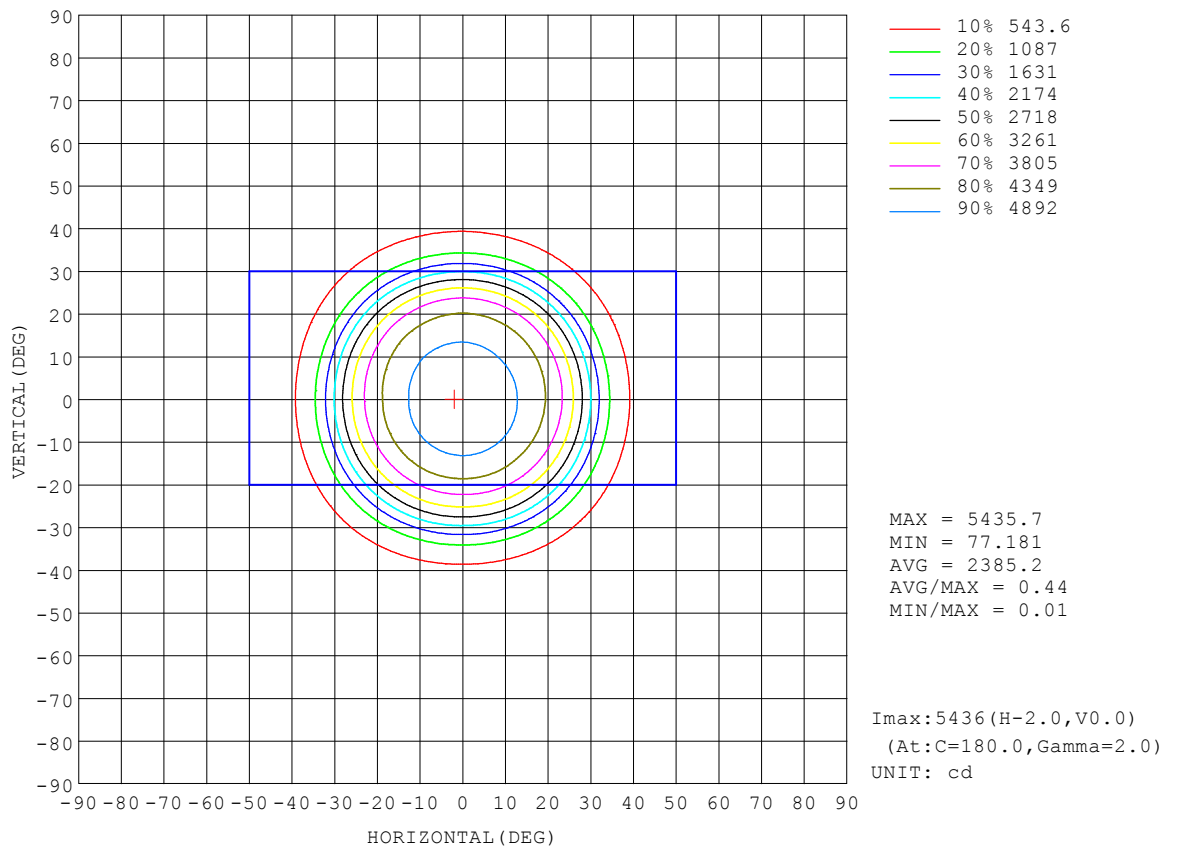


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892		Lamp Flux:4346.09x1 lm
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 40WPE:	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

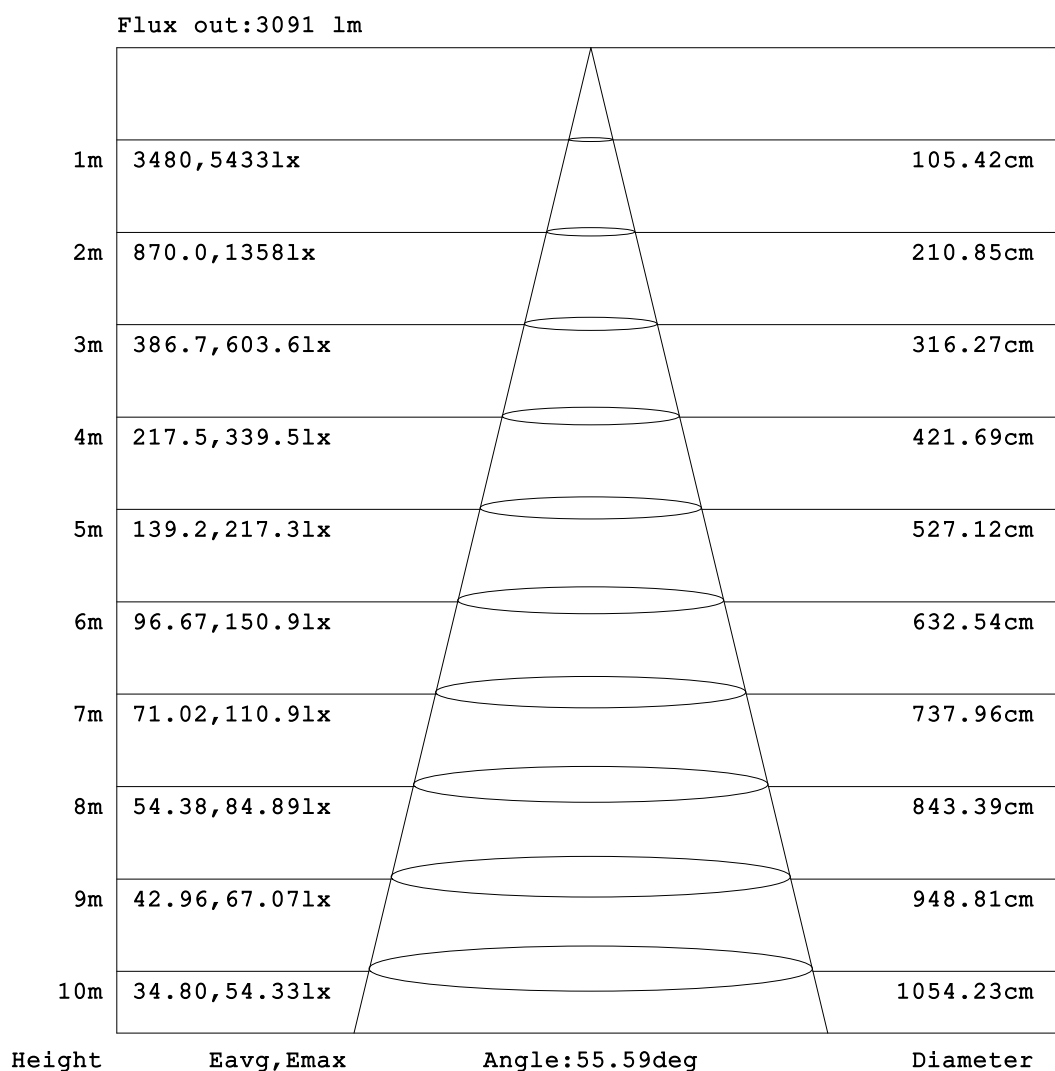


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892		Lamp Flux:4346.09x1 lm
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 40WPE:		WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

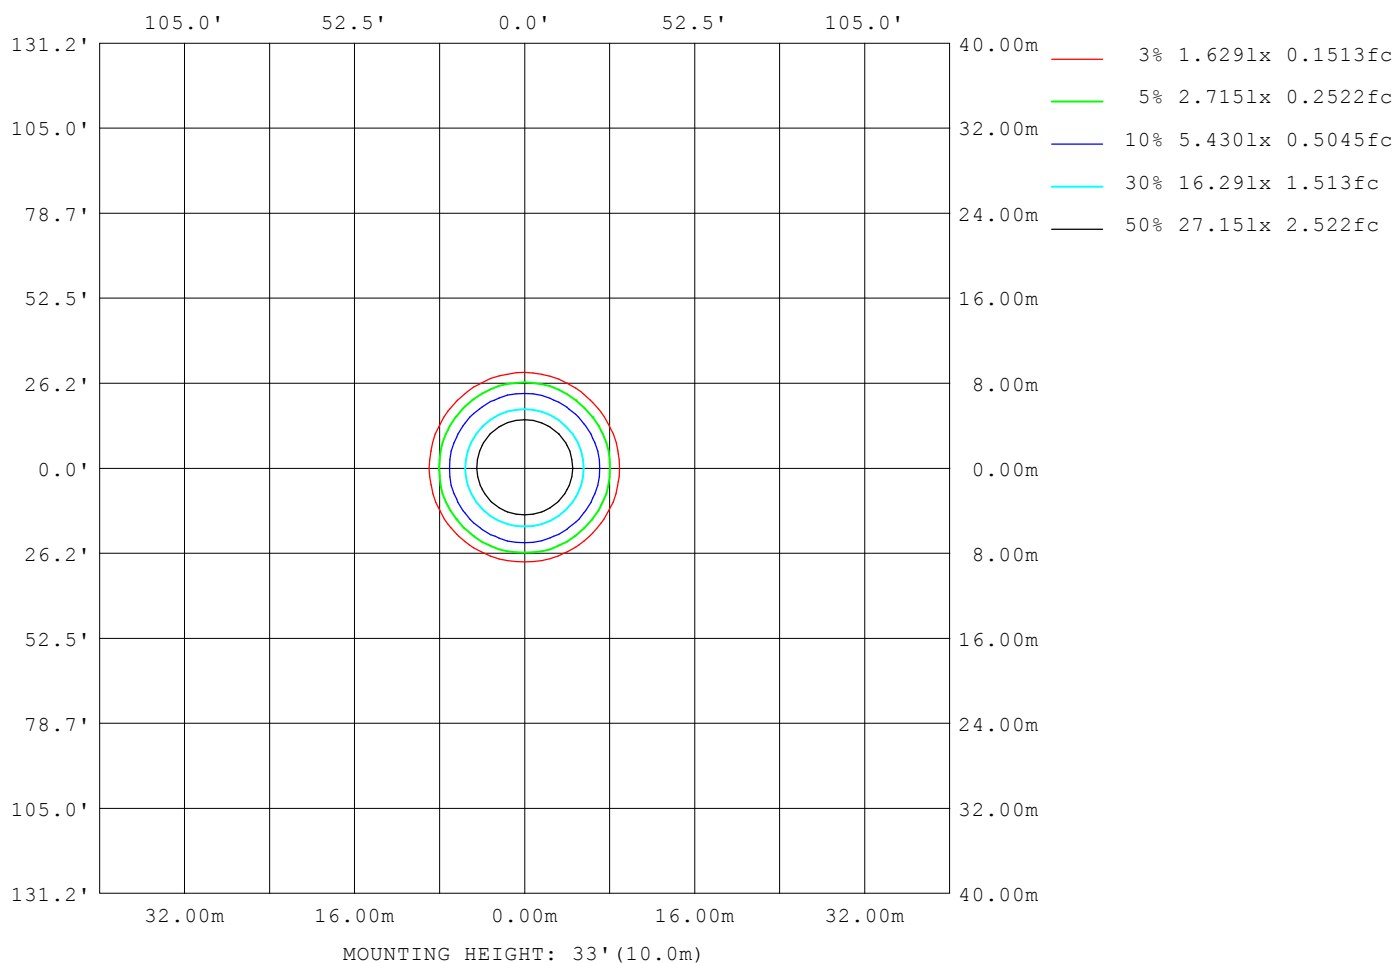

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.3V I:0.1665A P:39.5W PF:0.9881 Freq:49.99Hz		
UTHDi:0.15% ITHDi:4.23% KDisp:0.9892 Lamp Flux:4346.09x1 lm		
NAME: FUSION GT-TR03-AHD-045-COB-01SC 4000K RA90 60D 400PE:	WEIGHT:	
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	5392
L_0~180 (75) av	1829
L_0~180 (85) av	634
L_90~270 (65) av	5375
L_90~270 (75) av	1814
L_90~270 (85) av	606
L_45 (65) av	5397
L_45 (75) av	1828
L_45 (85) av	601

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

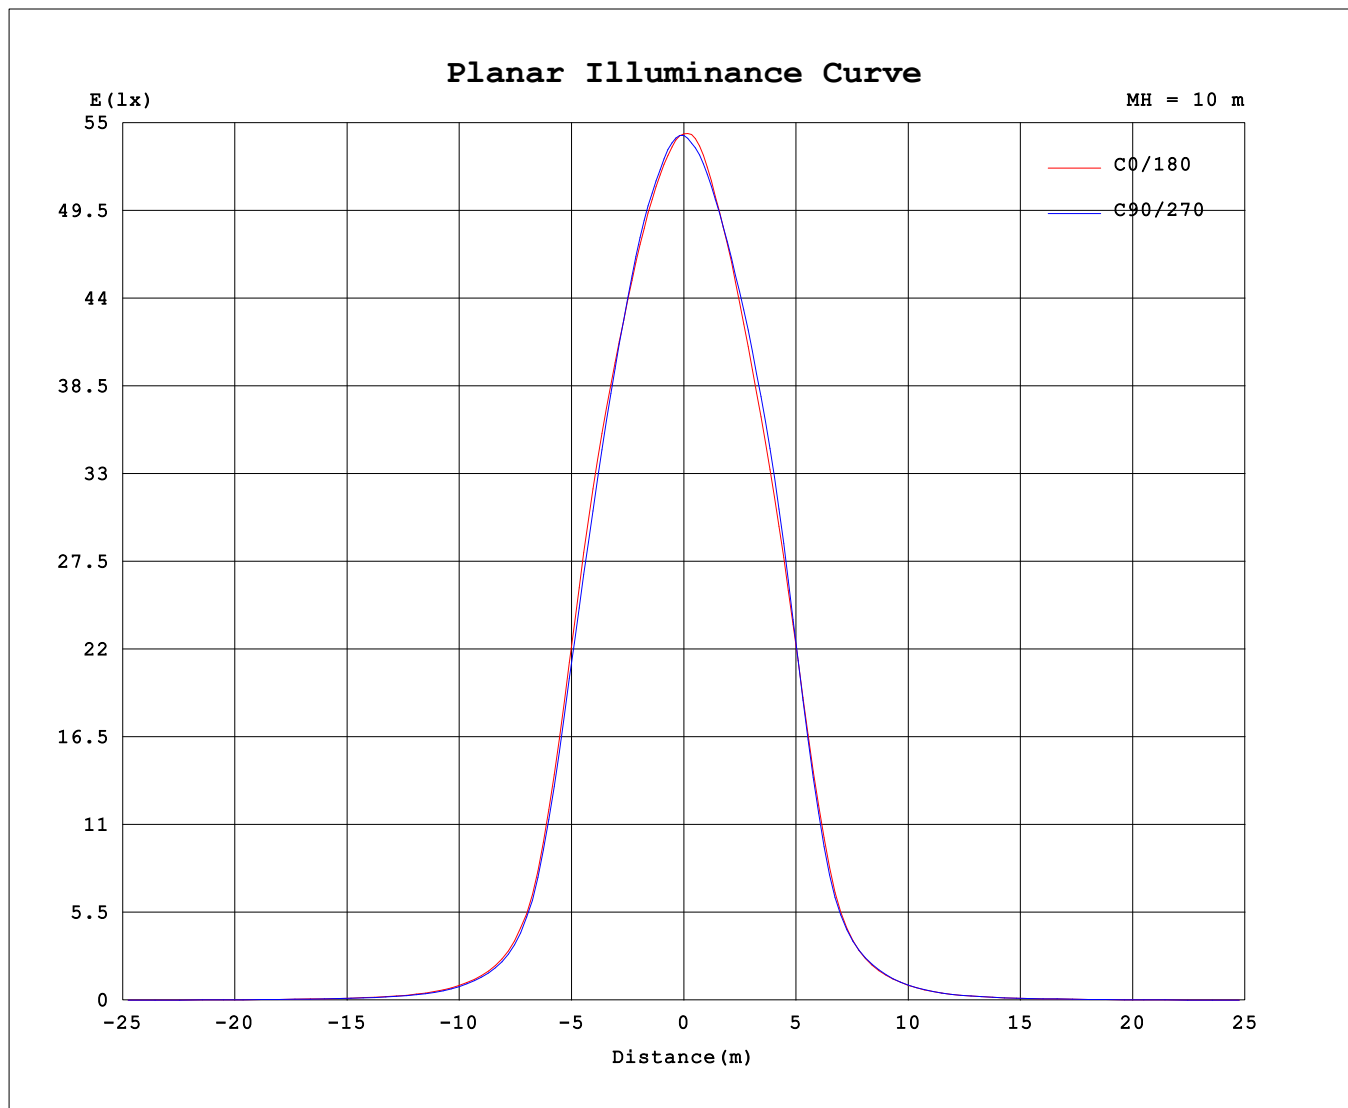

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-10-28

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	5423	5423	5423	5423	5423	5423	5423	5423
3.0	5363	5383	5399	5409	5415	5400	5367	5344
6.0	5252	5283	5294	5310	5303	5296	5266	5233
9.0	5116	5140	5169	5169	5126	5145	5126	5105
12.0	4937	4973	4984	4975	4936	4975	4970	4940
15.0	4722	4730	4731	4728	4697	4783	4804	4770
18.0	4482	4432	4422	4438	4420	4532	4565	4536
21.0	4155	4061	4012	4049	4082	4210	4253	4218
24.0	3677	3569	3504	3567	3636	3738	3758	3727
27.0	2987	2904	2852	2937	3003	3052	3013	2994
30.0	2173	2114	2061	2140	2206	2206	2149	2133
33.0	1370	1333	1306	1374	1412	1373	1333	1313
36.0	858.4	814.5	797.8	835.4	854.5	858.8	836.6	819.8
39.0	552.7	526.2	514.8	541.9	556.1	564.2	565.5	540.2
42.0	377.9	357.1	355.0	371.6	384.8	390.1	393.3	374.4
45.0	262.0	244.5	241.7	255.0	265.5	268.0	269.2	261.2
48.0	181.9	168.1	164.0	174.6	181.9	182.6	183.7	181.7
51.0	128.6	118.0	115.6	122.6	127.6	127.4	127.7	128.4
54.0	95.46	86.97	86.68	90.24	93.02	94.47	93.41	95.41
57.0	72.90	67.29	67.66	69.32	70.89	72.97	71.78	73.20
60.0	56.29	52.58	53.54	54.37	55.31	56.76	55.79	56.70
63.0	39.56	37.96	38.86	39.51	40.93	42.85	41.31	40.75
66.0	26.34	25.66	25.94	26.26	27.18	28.41	27.43	26.89
69.0	18.02	17.69	17.85	18.12	18.77	19.28	18.77	18.27
72.0	11.73	11.56	11.73	11.89	12.29	12.58	12.15	11.91
75.0	5.668	5.750	6.063	6.590	7.017	7.166	6.522	5.854
78.0	3.446	3.393	3.479	3.603	3.657	3.558	3.500	3.467
81.0	2.553	2.479	2.599	2.743	2.782	2.711	2.649	2.568
84.0	0.8335	0.8114	0.8899	1.023	1.025	0.9109	0.8888	0.8081
87.0	0.3410	0.3048	0.3728	0.4413	0.4399	0.3881	0.3821	0.3164
90.0	0.1553	0.1182	0.1533	0.2017	0.1787	0.1198	0.1273	0.1200

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-10-28

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks: