


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz		
UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 112.31 lm/W
MODEL		Imax (cd)	2133	S/MH(C0/180)	0.90	
NOMINAL POWER(W)	20	LOR(%)	100.0	S/MH(C90/270)	0.92	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	2212.8	η UP,DN(C0-180)	0.0,50.4	
NOMINAL FLUX(lm)	2212.81	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,49.6	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.75	
TEST VOLTAGE(V)	240.39	η down (%)	100.0	CIBSE SHR MAX	0.95	

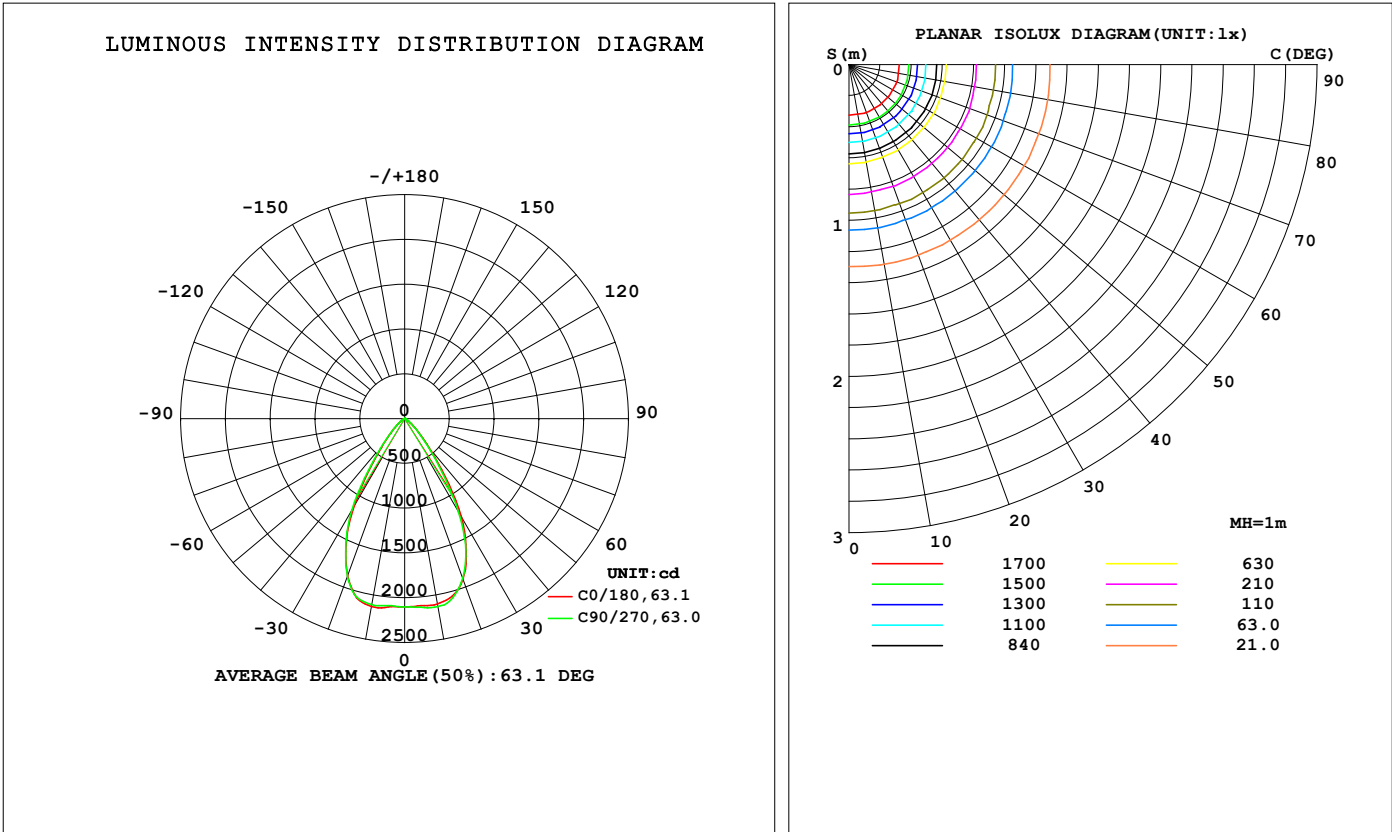

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ZONAL FLUX DIAGRAM

## ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	2102	2125	2132	2120	2129	2110	2110	2113	0- 10	201.6	201.6	9.11,9.11
20	1907	1919	1898	1838	1868	1854	1869	1920	10- 20	574.9	776.6	35.1,35.1
30	1265	1248	1206	1122	1133	1133	1182	1289	20- 30	719.3	1496	67.6,67.6
40	432.6	429.6	405.7	357.2	367.0	359.6	386.7	444.6	30- 40	462.9	1959	88.5,88.5
50	122.5	124.8	118.0	102.0	105.6	103.1	112.1	125.3	40- 50	174.0	2133	96.4,96.4
60	32.97	32.74	32.57	28.57	29.23	30.17	33.18	34.51	50- 60	58.00	2191	99,99
70	9.142	8.904	8.448	8.042	8.426	8.853	9.341	9.565	60- 70	17.23	2208	99.8,99.8
80	1.998	1.797	1.670	1.732	1.746	1.993	2.289	2.054	70- 80	4.237	2212	100,100
90	0.0507	0.0414	0.0576	0.0416	0.0455	0.0407	0.0454	0.0387	80- 90	0.6307	2213	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 2068.4 lm

%lum = 93.5%

%lamp = 93.5%

Conical surface Flux(120deg): 2190.7 lm

%lum = 99.0%


%lamp = 99.0%

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz		
UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:

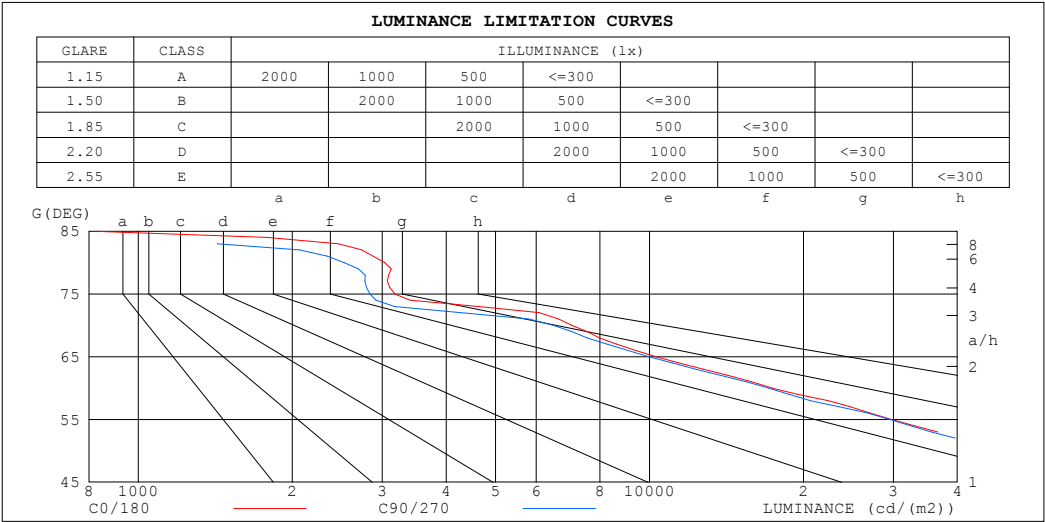

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	823	471
80	3035	2527
75	3179	2838
70	7053	6492
65	10304	9984
60	17398	17119
55	29787	29536
50	50302	48251
45	87461	82071


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz		
UTHDi:0.18% ITHDi:6.49% KDisp:0.9871		
Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.10	1.08	1.05	1.08	1.06	1.04	1.04	1.02	1.01	1.00	.99	.98	.97	.96	.95	.93
2.0	1.02	.98	.95	1.01	.97	.93	.97	.94	.91	.94	.92	.89	.92	.89	.88	.86
3.0	.95	.90	.86	.94	.89	.85	.91	.87	.84	.88	.85	.82	.86	.83	.81	.79
4.0	.88	.83	.78	.87	.82	.78	.85	.80	.77	.83	.79	.76	.81	.78	.75	.73
5.0	.82	.76	.72	.81	.76	.71	.80	.75	.71	.78	.74	.70	.76	.73	.70	.68
6.0	.77	.71	.66	.76	.70	.66	.75	.69	.66	.73	.69	.65	.72	.68	.65	.63
7.0	.72	.66	.62	.71	.66	.61	.70	.65	.61	.69	.64	.61	.68	.64	.60	.59
8.0	.68	.62	.57	.67	.61	.57	.66	.61	.57	.65	.60	.57	.64	.60	.56	.55
9.0	.64	.58	.54	.63	.57	.53	.62	.57	.53	.61	.57	.53	.61	.56	.53	.51
10.0	.60	.54	.50	.60	.54	.50	.59	.54	.50	.58	.53	.50	.57	.53	.50	.48

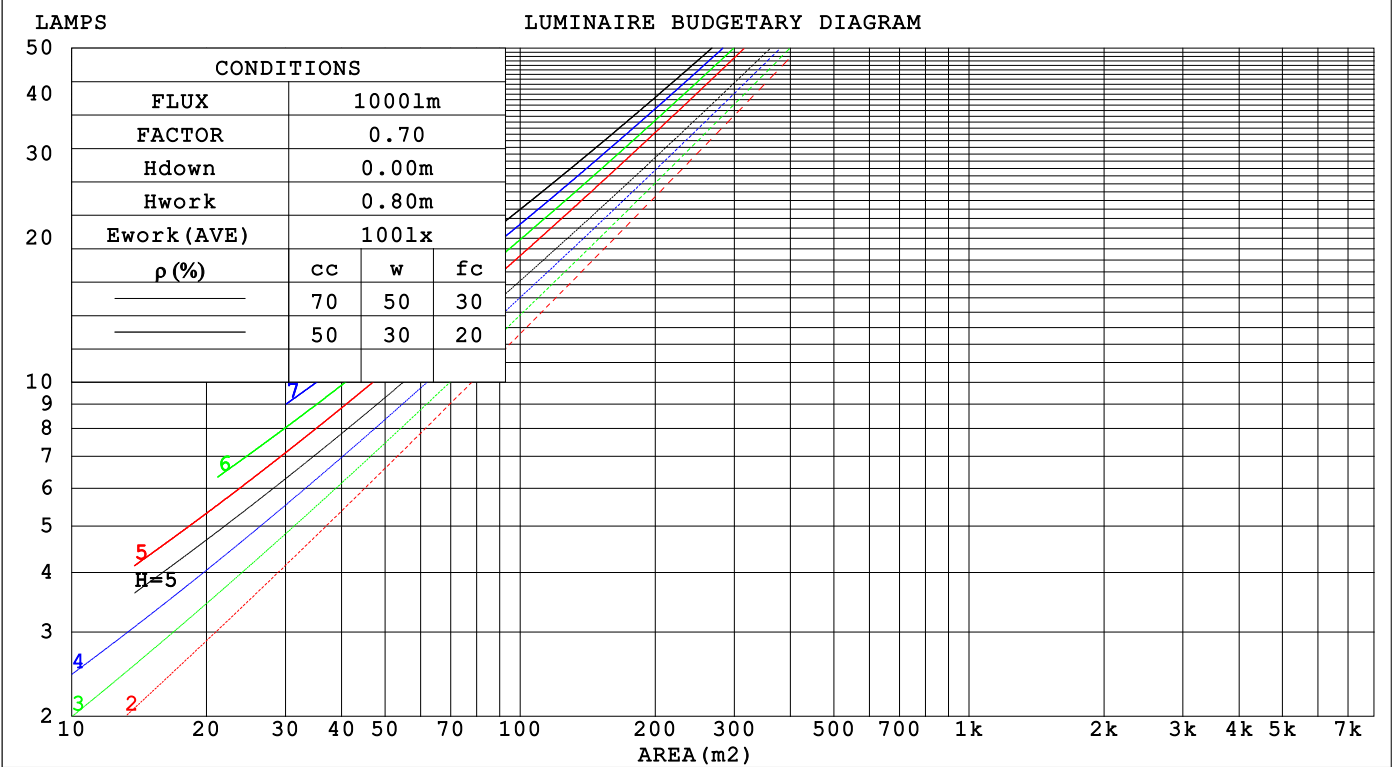

C Range: 0 - 360DEG

C Interval: 45.0DEG

Test Speed: HIGH

Temperature:25.3DEG

Operators:DAMIN

Test Date:2024-08-14

γ Range: 0 - 90DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453

Humidity:65.0%

Test Distance:3.090m [K=1.0000]

Remarks:

## WEC AND CCEC

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz		
UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.185	.105	.033	.178	.102	.032	.166	.095	.030	.154	.089	.029	.143	.083	.027															
2.0	.178	.098	.030	.173	.095	.029	.162	.090	.028	.152	.085	.027	.143	.081	.025															
3.0	.170	.091	.027	.165	.089	.027	.156	.085	.026	.148	.081	.025	.140	.077	.024															
4.0	.162	.084	.025	.158	.083	.024	.150	.080	.024	.143	.077	.023	.136	.074	.022															
5.0	.155	.079	.023	.151	.078	.023	.144	.075	.022	.138	.073	.022	.132	.070	.021															
6.0	.148	.074	.021	.144	.073	.021	.138	.071	.021	.133	.069	.020	.127	.067	.020															
7.0	.141	.070	.020	.138	.069	.020	.133	.067	.019	.128	.065	.019	.123	.064	.019															
8.0	.135	.066	.019	.132	.065	.018	.127	.064	.018	.123	.062	.018	.118	.061	.018															
9.0	.129	.062	.017	.127	.062	.017	.122	.060	.017	.118	.059	.017	.114	.058	.017															
10.0	.124	.059	.016	.122	.059	.016	.118	.058	.016	.114	.057	.016	.110	.056	.016															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.172	.157	.144	.147	.135	.124	.100	.093	.086	.058	.054	.050	.019	.017	.016	
2.0	.157	.132	.112	.135	.114	.097	.092	.079	.067	.053	.046	.039	.017	.015	.013	
3.0	.145	.114	.088	.125	.098	.077	.085	.068	.054	.049	.040	.032	.016	.013	.010	
4.0	.135	.099	.071	.116	.086	.062	.080	.060	.044	.046	.035	.026	.015	.011	.008	
5.0	.127	.088	.058	.109	.076	.051	.075	.053	.036	.044	.031	.021	.014	.010	.007	
6.0	.120	.078	.049	.103	.068	.042	.071	.048	.030	.041	.028	.018	.013	.009	.006	
7.0	.114	.071	.041	.098	.062	.036	.067	.043	.025	.039	.025	.015	.013	.008	.005	
8.0	.108	.065	.035	.093	.056	.031	.064	.039	.022	.037	.023	.013	.012	.008	.004	
9.0	.103	.060	.031	.089	.052	.027	.061	.036	.019	.036	.022	.011	.012	.007	.004	
10.0	.098	.055	.027	.085	.048	.023	.059	.034	.017	.034	.020	.010	.011	.007	.003	

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz											
UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm											
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W						TYPE:		WEIGHT:			
SPEC.:						DIM.:		SERIAL No.:			
MFR.: Norming lighting						SUR.: 70mm		Shielding Angle:			
ceiling/cavity		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	24.0	25.0	24.3	25.2	25.4	23.8	24.8	24.0	24.9	25.1
	3H	23.9	24.8	24.1	25.0	25.2	23.6	24.6	23.9	24.8	25.0
	4H	23.8	24.7	24.1	24.9	25.1	23.5	24.4	23.8	24.6	24.9
	6H	23.7	24.5	24.0	24.8	25.0	23.5	24.3	23.8	24.5	24.8
	8H	23.7	24.5	24.0	24.7	25.0	23.4	24.2	23.7	24.5	24.7
	12H	23.6	24.4	24.0	24.6	24.9	23.4	24.1	23.7	24.4	24.7
4H	2H	23.8	24.7	24.1	24.9	25.1	23.6	24.4	23.8	24.7	24.9
	3H	23.7	24.4	24.0	24.7	25.0	23.4	24.2	23.8	24.5	24.7
	4H	23.6	24.3	23.9	24.6	24.9	23.3	24.0	23.7	24.3	24.6
	6H	23.5	24.1	23.9	24.4	24.8	23.3	23.9	23.6	24.2	24.5
	8H	23.5	24.0	23.9	24.4	24.7	23.2	23.8	23.6	24.1	24.5
	12H	23.4	23.9	23.8	24.3	24.7	23.2	23.7	23.6	24.0	24.4
8H	4H	23.5	24.0	23.9	24.4	24.7	23.2	23.8	23.6	24.1	24.5
	6H	23.4	23.8	23.8	24.2	24.6	23.1	23.6	23.5	24.0	24.4
	8H	23.3	23.7	23.8	24.1	24.6	23.1	23.5	23.5	23.9	24.3
	12H	23.3	23.6	23.7	24.1	24.5	23.0	23.4	23.5	23.8	24.3
12H	4H	23.4	23.9	23.8	24.3	24.7	23.2	23.7	23.6	24.0	24.4
	6H	23.3	23.7	23.8	24.1	24.6	23.1	23.5	23.5	23.9	24.3
	8H	23.3	23.6	23.7	24.1	24.5	23.0	23.4	23.5	23.8	24.3
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H		+ 2.8 / - 6.8					+ 2.6 / - 6.7				
1.5H		+ 4.3 / - 4.9					+ 4.0 / - 4.7				
2.0H		+ 5.0 / - 6.1					+ 4.7 / - 6.0				

CIE Pub.117, 2213 lm Total Lamp Luminous Flux Corrected ( $8\log(F/F_0) = 2.8$ )  
Area: 0.0038 m<sup>2</sup>

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz		
UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	84	77	73	84	77	73	83	77	73	69
0.80	92	86	82	91	85	82	90	85	81	77
1.00	97	91	87	96	91	87	95	91	87	82
1.25	102	96	92	101	96	92	99	94	91	87
1.50	105	100	96	103	99	95	101	97	94	90
2.00	108	103	100	106	102	99	104	100	98	92
2.50	110	105	102	108	104	101	105	102	100	93
3.00	111	108	105	109	106	104	106	103	101	95
4.00	113	110	108	111	109	107	108	106	104	97
5.00	115	112	110	112	110	109	108	107	105	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 $\gamma$  Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

## ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:

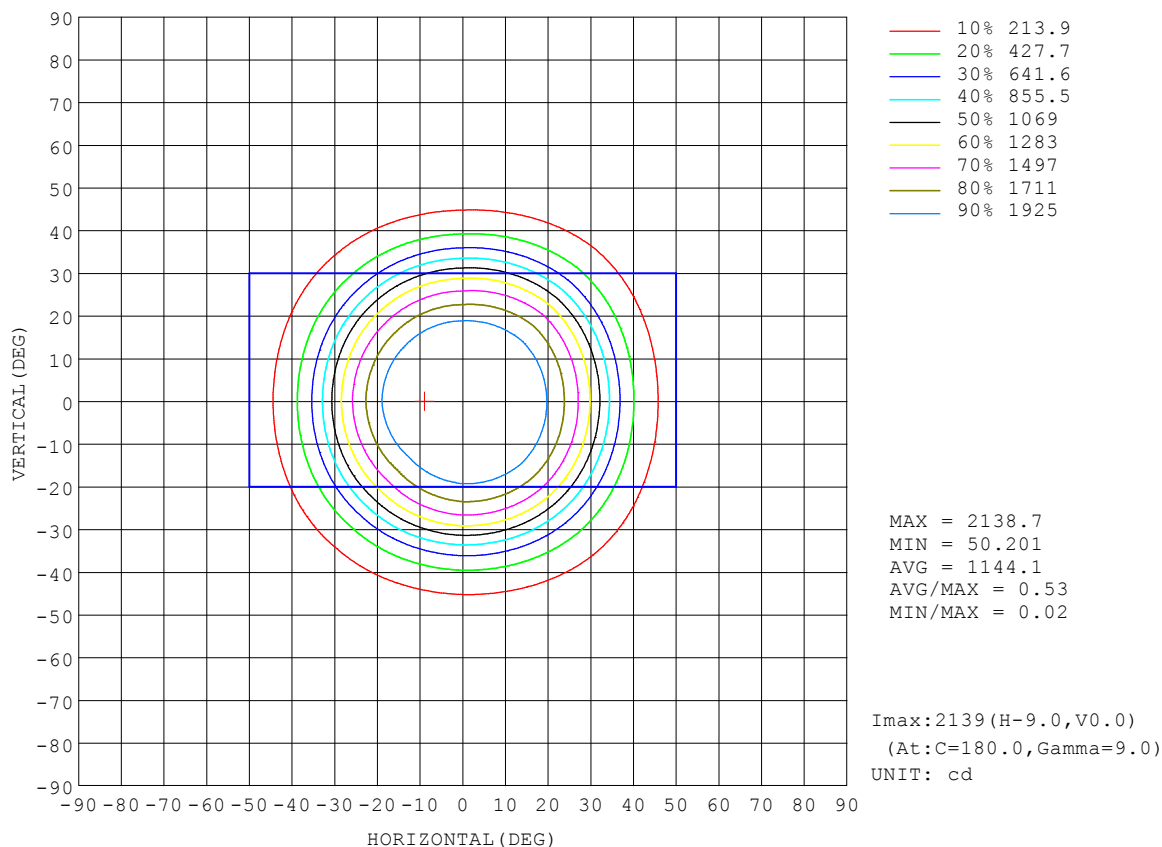


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:



## AAI Figure

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz		
UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:

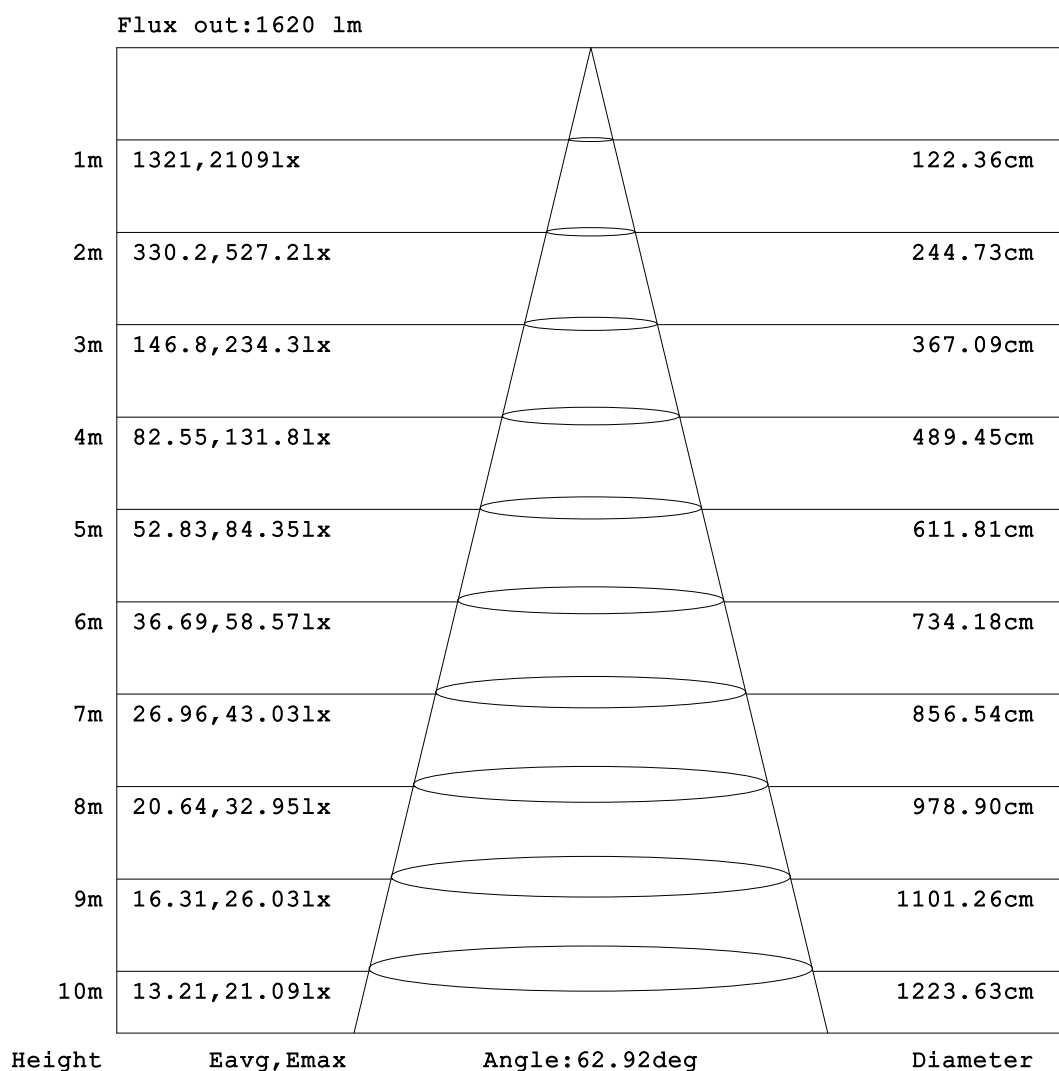


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ISOLUX DIAGRAM

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:

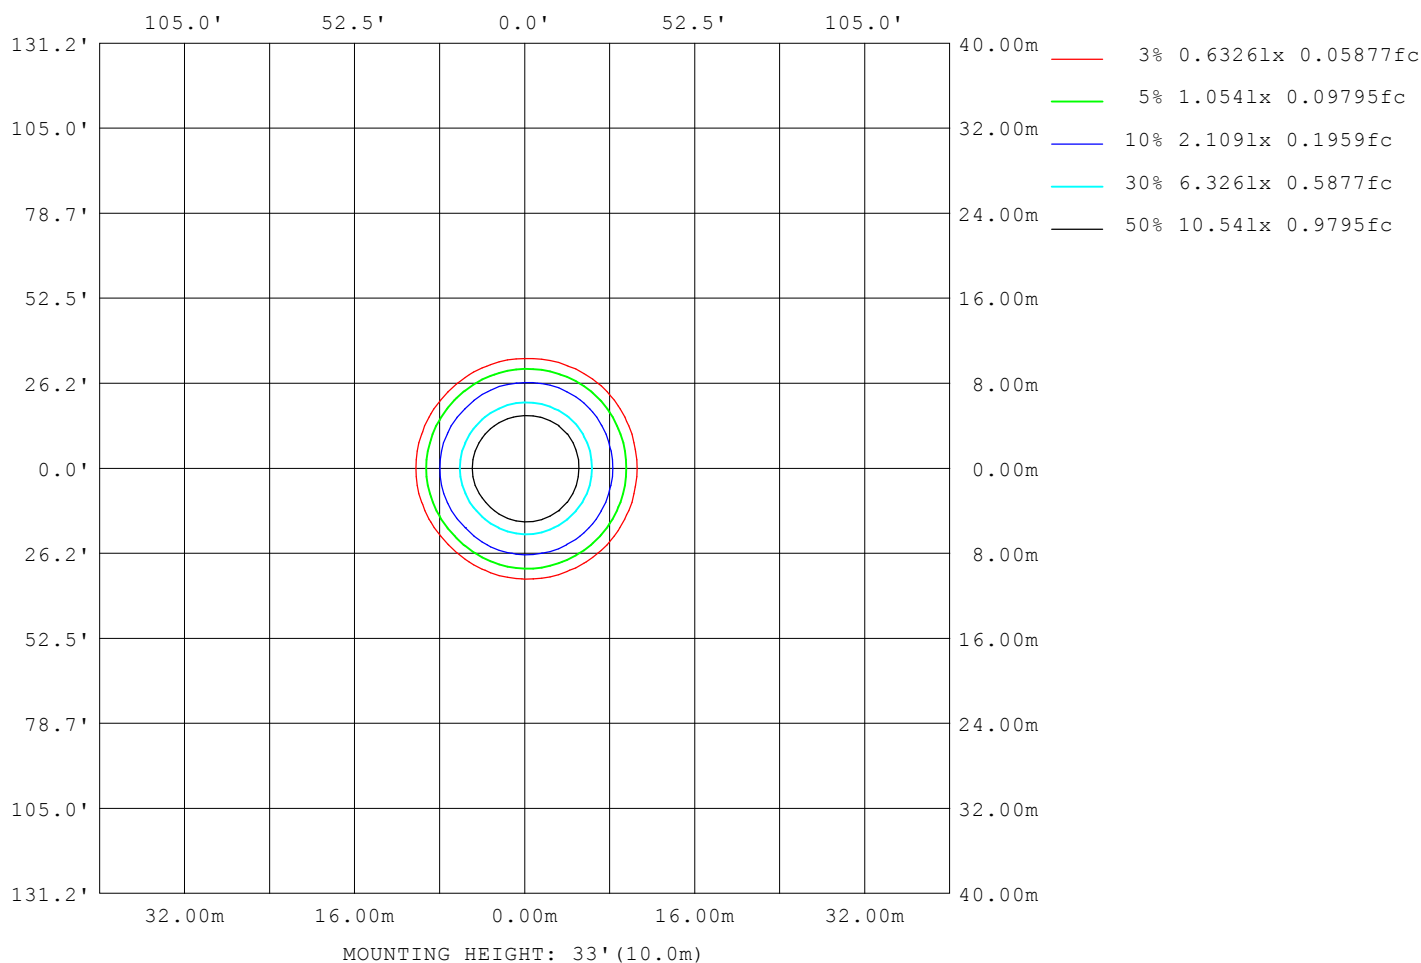

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

## LED Avg.L Report

Test:U:240.4V I:0.0834A P:19.7W PF:0.9826 Freq:49.99Hz UTHDi:0.18% ITHDi:6.49% KDisp:0.9871 Lamp Flux:2212.81x1 lm		
NAME: TR11-20-XX-01+白色防眩环 3000K RA90 60D 20W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 70mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	9760
L_0~180 (75) av	3109
L_0~180 (85) av	640
L_90~270 (65) av	10305
L_90~270 (75) av	3201
L_90~270 (85) av	576
L_45 (65) av	9849
L_45 (75) av	3130
L_45 (85) av	562

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-14

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

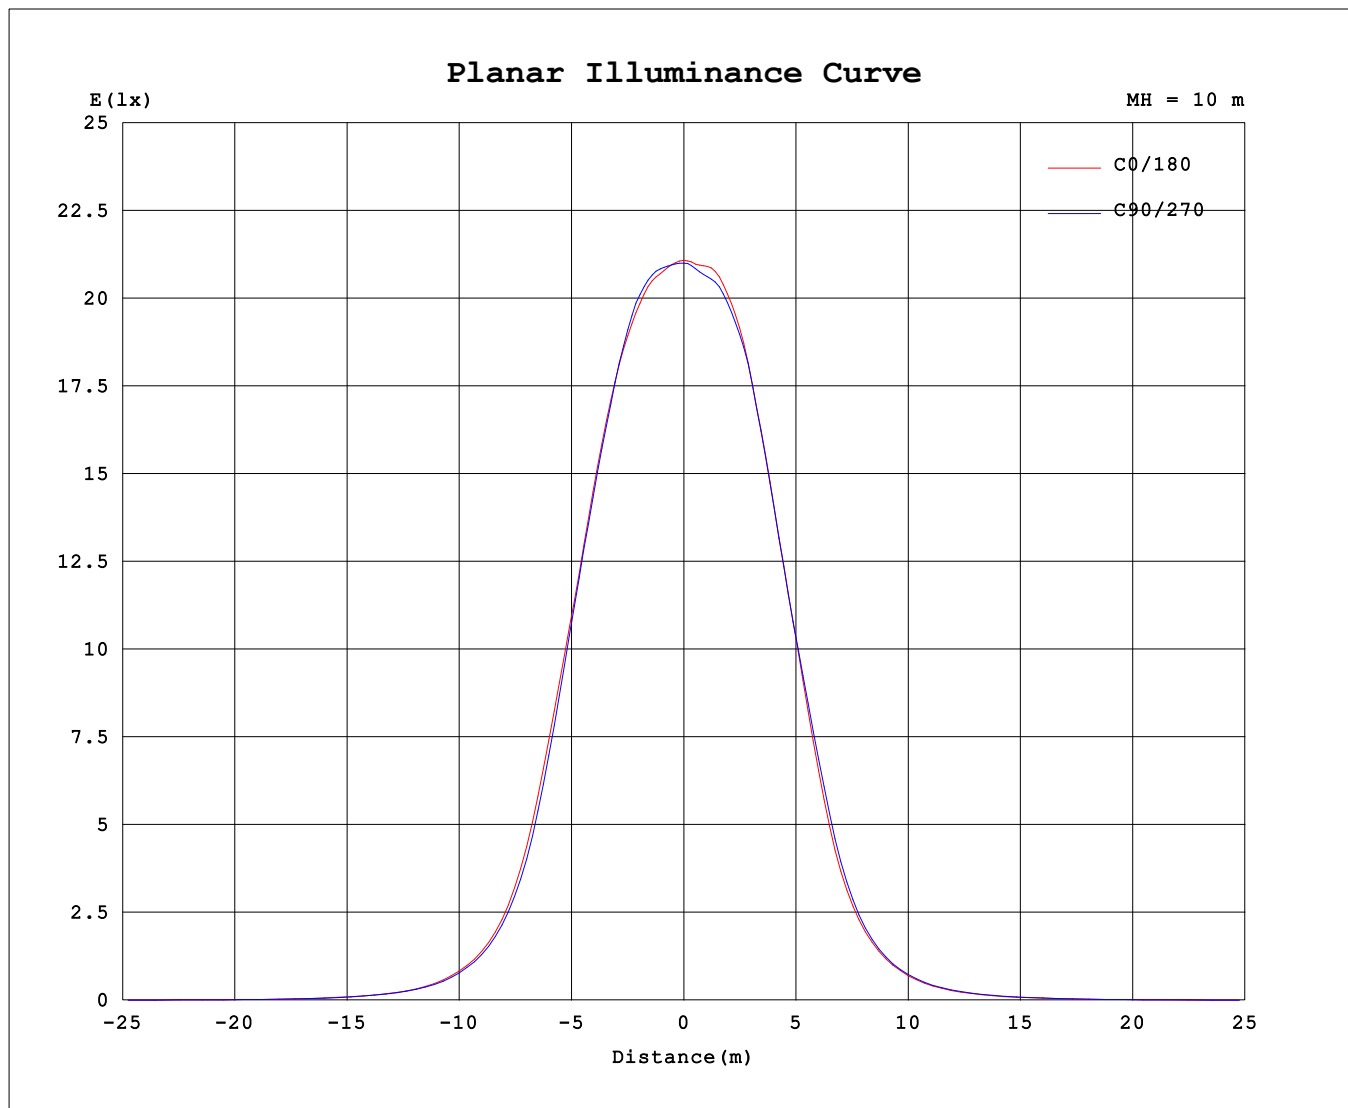

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

## Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	2103	2103	2103	2103	2103	2103	2103	2103
3.0	2100	2104	2107	2103	2100	2097	2096	2098
6.0	2099	2110	2121	2113	2120	2108	2099	2106
9.0	2105	2126	2132	2126	2133	2116	2112	2115
12.0	2088	2119	2125	2101	2114	2094	2096	2101
15.0	2056	2078	2073	2045	2071	2059	2066	2070
18.0	1983	1995	1979	1934	1959	1952	1964	1989
21.0	1863	1875	1852	1782	1812	1800	1814	1878
24.0	1693	1712	1684	1591	1620	1604	1624	1718
27.0	1496	1511	1470	1380	1402	1391	1417	1528
30.0	1265	1248	1206	1122	1133	1133	1182	1289
33.0	983.0	950.2	915.8	841.0	839.7	842.1	903.8	998.1
36.0	706.8	687.7	653.5	587.9	591.9	588.3	637.6	717.6
39.0	490.1	484.6	458.3	405.5	414.2	406.8	438.2	502.4
42.0	337.7	336.5	318.2	278.3	287.2	281.4	300.8	346.7
45.0	234.4	234.7	220.8	192.0	197.9	193.9	208.4	238.9
48.0	159.8	161.1	151.4	131.3	135.4	132.7	143.1	162.8
51.0	107.6	110.0	104.1	90.19	92.93	92.10	99.43	109.9
54.0	73.32	74.38	72.37	62.61	64.42	63.85	69.37	75.30
57.0	50.98	51.27	48.66	43.90	45.43	45.57	49.62	52.87
60.0	32.97	32.74	32.57	28.57	29.23	30.17	33.18	34.51
63.0	21.94	21.25	21.28	18.89	19.47	20.25	22.32	22.99
66.0	14.47	14.06	14.03	12.63	13.14	13.72	15.00	15.24
69.0	10.23	9.971	9.602	9.060	9.447	9.899	10.42	10.67
72.0	7.123	6.138	5.012	4.748	5.091	6.605	7.265	7.428
75.0	3.118	2.896	2.795	2.977	2.997	3.274	3.502	3.169
78.0	2.432	2.253	2.199	2.330	2.288	2.583	2.804	2.468
81.0	1.709	1.528	1.398	1.435	1.468	1.697	1.954	1.775
84.0	0.7068	0.3930	0.2418	0.1725	0.2061	0.4258	0.7162	0.7596
87.0	0.1337	0.0964	0.0959	0.0733	0.0881	0.0917	0.1209	0.1151
90.0	0.0507	0.0414	0.0576	0.0416	0.0455	0.0407	0.0454	0.0387

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-14

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks: