


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz		
UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 103.28 lm/W
MODEL		Imax (cd)	24087	S/MH(C0/180)	0.37	
NOMINAL POWER(W)	45	LOR(%)	100.0	S/MH(C90/270)	0.37	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	4524.0	η UP,DN(C0-180)	0.0,49.5	
NOMINAL FLUX(lm)	4524.03	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.5	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	240.36	η down (%)	100.0	CIBSE SHR MAX	0.30	

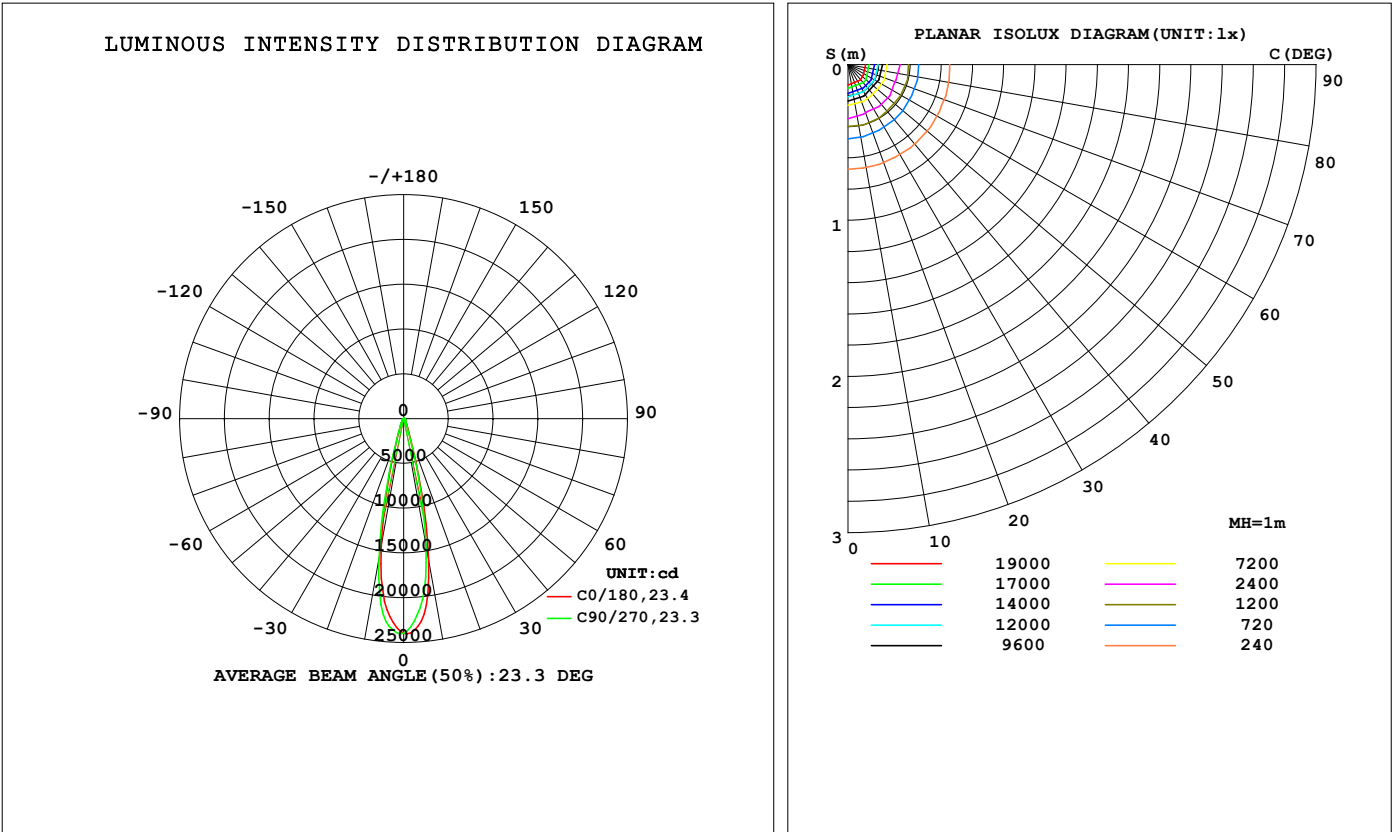

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1613	1561	1444	1407	1459	1535	1602	1610	0- 10	1893	1893	41.8,41.8
20	181.2	170.8	156.5	153.4	156.2	166.8	178.1	183.1	10- 20	1749	3642	80.5,80.5
30	57.90	54.78	51.00	49.90	51.12	54.44	56.07	58.63	20- 30	433.7	4075	90.1,90.1
40	23.80	23.03	21.99	21.89	21.75	22.31	23.23	23.82	30- 40	225.5	4301	95.1,95.1
50	10.41	10.32	9.767	9.727	9.561	9.922	10.14	10.49	40- 50	118.1	4419	97.7,97.7
60	4.865	4.694	4.514	4.479	4.466	4.718	4.771	4.897	50- 60	62.92	4482	99.1,99.1
70	1.859	1.857	1.846	1.837	1.823	1.829	1.829	1.851	60- 70	31.99	4514	99.8,99.8
80	0.2619	0.2545	0.2631	0.2511	0.2566	0.2545	0.2907	0.2547	70- 80	9.140	4523	100,100
90	0.0209	0.0129	0.0225	0.0131	0.0141	0.0141	0.0331	0.0158	80- 90	1.131	4524	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:X10cd									UNIT:lm		

Conical surface Flux(90deg): 4369.1 lm

%lum = 96.6%

%lamp = 96.6%

Conical surface Flux(120deg): 4481.8 lm

%lum = 99.1%


%lamp = 99.1%

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz		
UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

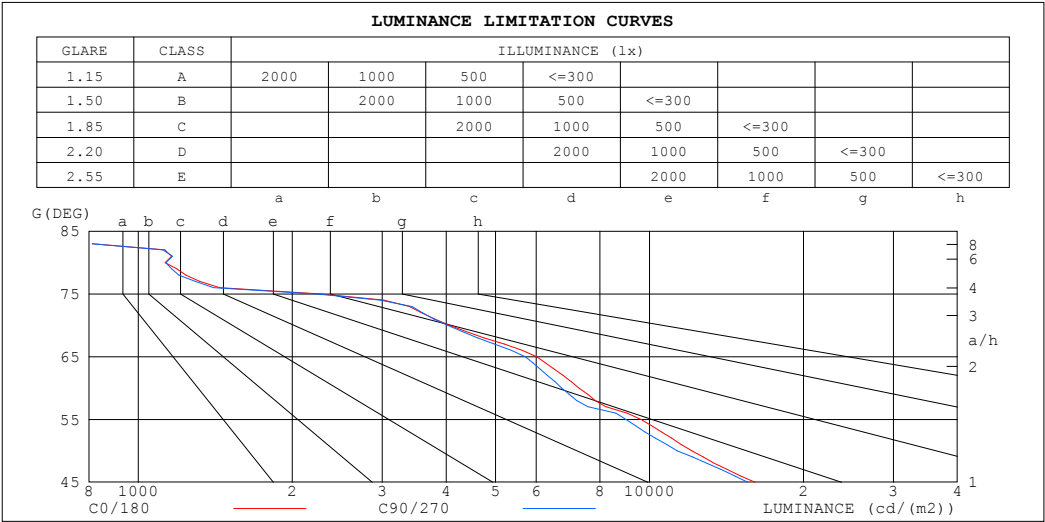

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	663	674
80	1129	1131
75	2284	2240
70	4067	4029
65	6015	5713
60	7281	6740
55	9630	8994
50	12115	11343
45	16091	15560


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz		
UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.13	1.11	1.09	1.11	1.09	1.07	1.07	1.05	1.04	1.03	1.02	1.01	.00	.99	.98	.96
2.0	1.07	1.04	1.02	1.06	1.03	1.01	1.03	1.00	.98	.00	.98	.96	.97	.96	.94	.93
3.0	1.03	.99	.96	1.01	.98	.95	.99	.96	.94	.97	.94	.92	.95	.93	.91	.90
4.0	.99	.95	.92	.98	.94	.91	.96	.93	.90	.94	.91	.89	.92	.90	.88	.87
5.0	.95	.91	.88	.94	.90	.88	.93	.89	.87	.91	.88	.86	.90	.87	.85	.84
6.0	.92	.88	.85	.91	.87	.85	.90	.87	.84	.89	.86	.83	.88	.85	.83	.82
7.0	.89	.85	.82	.89	.85	.82	.87	.84	.81	.86	.83	.81	.85	.83	.81	.80
8.0	.87	.82	.80	.86	.82	.80	.85	.82	.79	.84	.81	.79	.84	.81	.79	.78
9.0	.84	.80	.78	.84	.80	.77	.83	.80	.77	.82	.79	.77	.82	.79	.77	.76
10.0	.82	.78	.76	.82	.78	.75	.81	.78	.75	.80	.77	.75	.80	.77	.75	.74

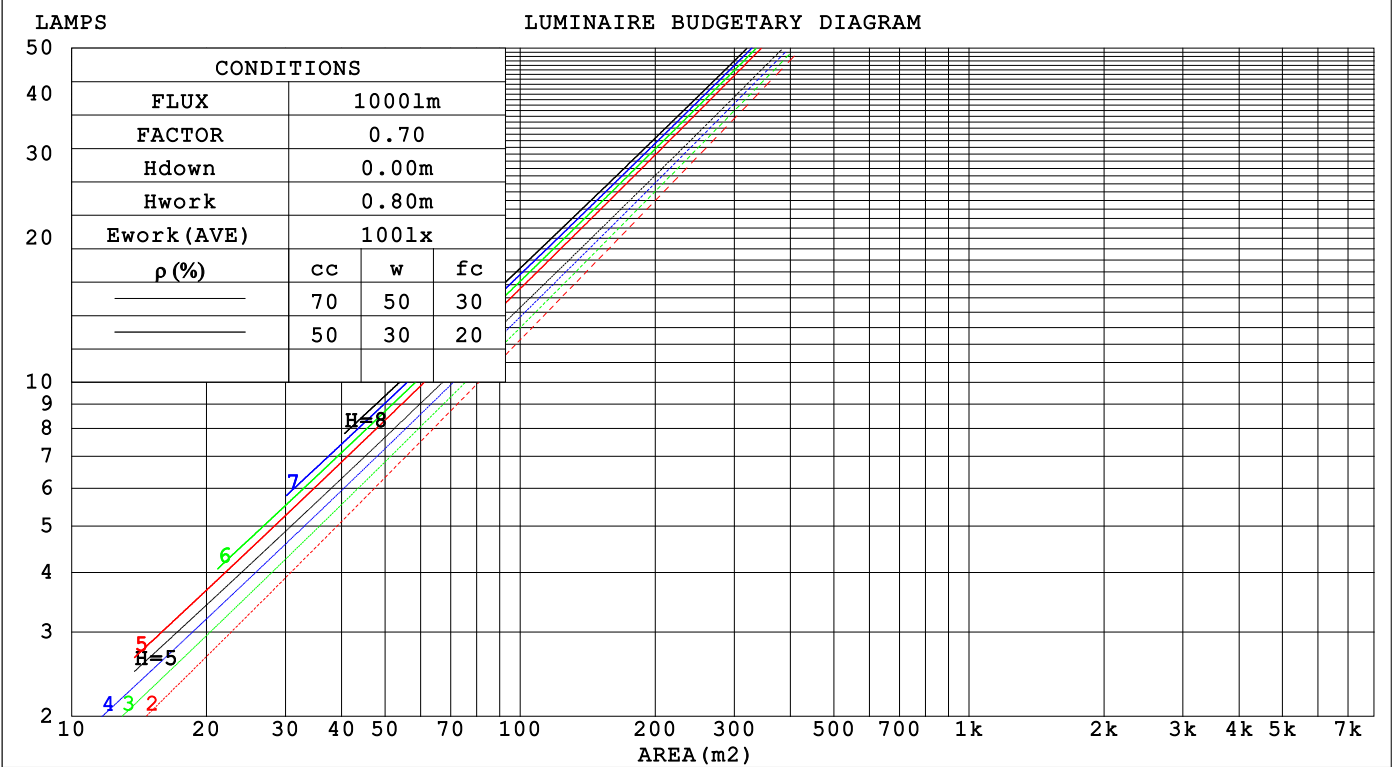

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz		
UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.139	.079	.025	.132	.076	.024	.120	.069	.022	.109	.063	.020	.098	.057	.018	
2.0	.129	.071	.022	.124	.068	.021	.114	.063	.020	.104	.058	.018	.095	.054	.017	
3.0	.120	.064	.019	.116	.062	.019	.107	.058	.018	.099	.054	.017	.092	.051	.016	
4.0	.112	.058	.017	.109	.057	.017	.101	.054	.016	.095	.051	.015	.088	.048	.015	
5.0	.105	.054	.016	.102	.052	.015	.096	.050	.015	.090	.048	.014	.085	.045	.014	
6.0	.099	.050	.014	.096	.049	.014	.091	.047	.014	.086	.045	.013	.082	.043	.013	
7.0	.094	.046	.013	.091	.046	.013	.087	.044	.013	.083	.042	.012	.079	.041	.012	
8.0	.089	.044	.012	.087	.043	.012	.083	.041	.012	.079	.040	.012	.076	.039	.011	
9.0	.085	.041	.011	.083	.040	.011	.079	.039	.011	.076	.038	.011	.073	.037	.011	
10.0	.081	.039	.011	.079	.038	.011	.076	.037	.010	.073	.036	.010	.070	.035	.010	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.168	.158	.148	.144	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.017	
2.0	.151	.133	.118	.129	.114	.102	.088	.079	.071	.051	.046	.042	.016	.015	.014	
3.0	.136	.113	.095	.116	.098	.083	.080	.068	.058	.046	.040	.034	.015	.013	.011	
4.0	.123	.098	.079	.106	.085	.068	.073	.059	.048	.042	.035	.028	.014	.011	.009	
5.0	.113	.086	.066	.097	.074	.057	.067	.052	.040	.039	.030	.024	.012	.010	.008	
6.0	.104	.076	.056	.089	.065	.048	.061	.046	.034	.036	.027	.020	.011	.009	.007	
7.0	.096	.067	.048	.082	.058	.041	.057	.041	.029	.033	.024	.017	.011	.008	.006	
8.0	.089	.061	.041	.077	.053	.036	.053	.037	.025	.031	.022	.015	.010	.007	.005	
9.0	.083	.055	.036	.072	.048	.031	.050	.033	.022	.029	.020	.013	.009	.006	.004	
10.0	.078	.050	.031	.067	.044	.027	.047	.031	.019	.027	.018	.012	.009	.006	.004	

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz										
UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm										
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: Norming lighting					SUR.: 131mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	14.2	14.8	14.4	15.0	15.1	13.9	14.5	14.1	14.7	14.8
3H	14.4	15.0	14.6	15.2	15.4	14.1	14.7	14.4	14.9	15.1
4H	14.4	15.0	14.7	15.2	15.4	14.1	14.7	14.4	14.9	15.1
6H	14.4	14.9	14.6	15.1	15.4	14.1	14.6	14.4	14.9	15.1
8H	14.3	14.8	14.6	15.1	15.3	14.0	14.6	14.3	14.8	15.1
12H	14.3	14.8	14.6	15.0	15.3	14.0	14.5	14.3	14.8	15.0
4H 2H	14.2	14.8	14.5	15.0	15.2	14.0	14.6	14.2	14.8	15.0
3H	14.6	15.1	14.9	15.3	15.6	14.3	14.8	14.6	15.1	15.4
4H	14.6	15.0	14.9	15.3	15.6	14.3	14.8	14.7	15.1	15.4
6H	14.5	14.9	14.9	15.2	15.6	14.3	14.7	14.6	15.0	15.3
8H	14.5	14.8	14.8	15.2	15.6	14.2	14.6	14.6	15.0	15.3
12H	14.4	14.8	14.8	15.1	15.5	14.2	14.5	14.6	14.9	15.3
8H 4H	14.5	14.9	14.9	15.2	15.6	14.2	14.6	14.6	15.0	15.3
6H	14.4	14.7	14.8	15.1	15.5	14.2	14.5	14.6	14.9	15.3
8H	14.3	14.6	14.8	15.1	15.5	14.1	14.4	14.6	14.8	15.3
12H	14.3	14.5	14.8	15.0	15.4	14.1	14.3	14.5	14.7	15.2
12H 4H	14.4	14.8	14.8	15.1	15.5	14.2	14.5	14.6	14.9	15.3
6H	14.3	14.6	14.8	15.0	15.5	14.1	14.4	14.5	14.8	15.2
8H	14.3	14.5	14.8	15.0	15.4	14.1	14.3	14.5	14.7	15.2
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.4 / - 2.1					+ 1.3 / - 2.1				
1.5H	+ 2.1 / - 1.2					+ 1.9 / - 1.3				
2.0H	+ 2.3 / - 1.9					+ 2.4 / - 1.8				

CIE Pub.117, 4524 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = 5.2$)
Area: 0.0134 m²

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	82	79	88	82	79	87	82	78	75
0.80	96	90	86	95	90	86	94	89	86	82
1.00	100	95	91	99	94	91	98	94	90	86
1.25	104	99	95	103	98	95	101	97	94	90
1.50	106	102	99	105	101	98	103	100	97	93
2.00	109	105	102	108	104	101	105	102	99	94
2.50	111	107	104	109	106	103	106	103	101	95
3.00	112	109	106	110	107	105	107	105	103	96
4.00	114	111	109	112	110	108	108	107	105	98
5.00	115	113	111	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-09-25

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 γ Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

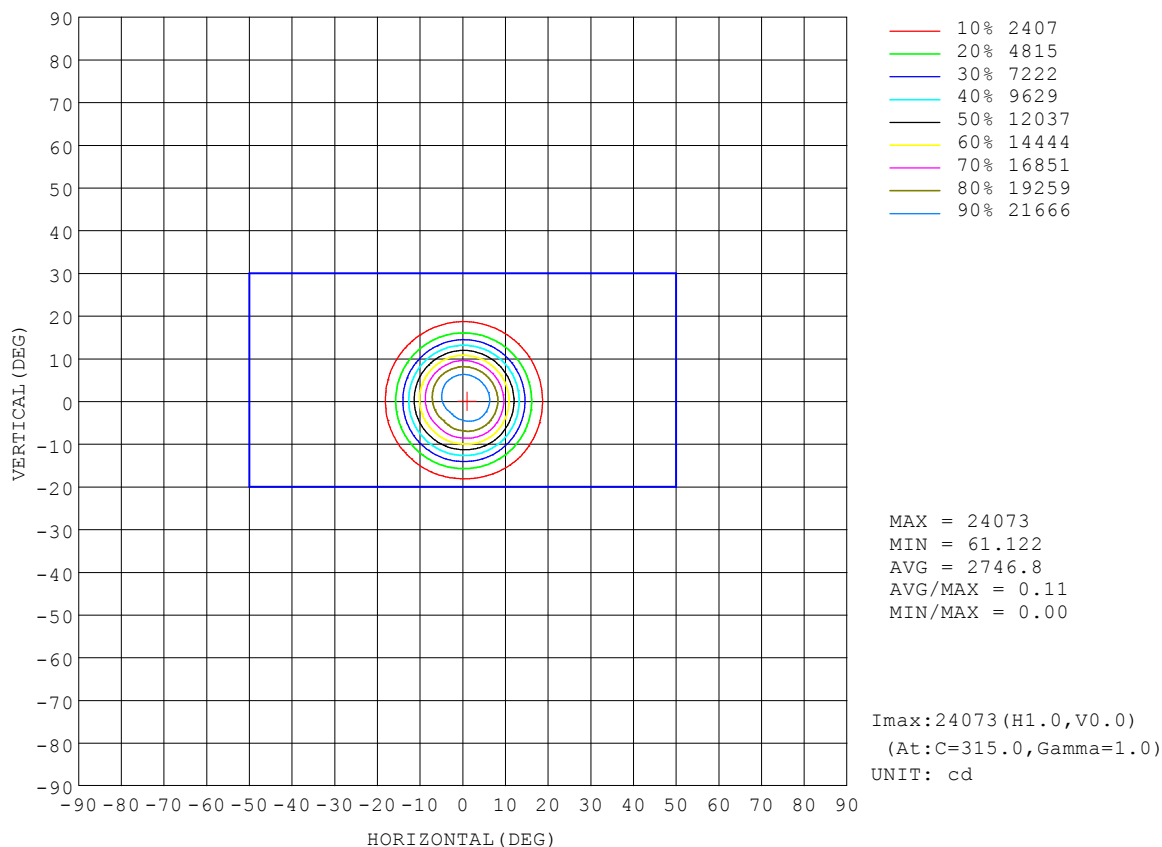


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz		
UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

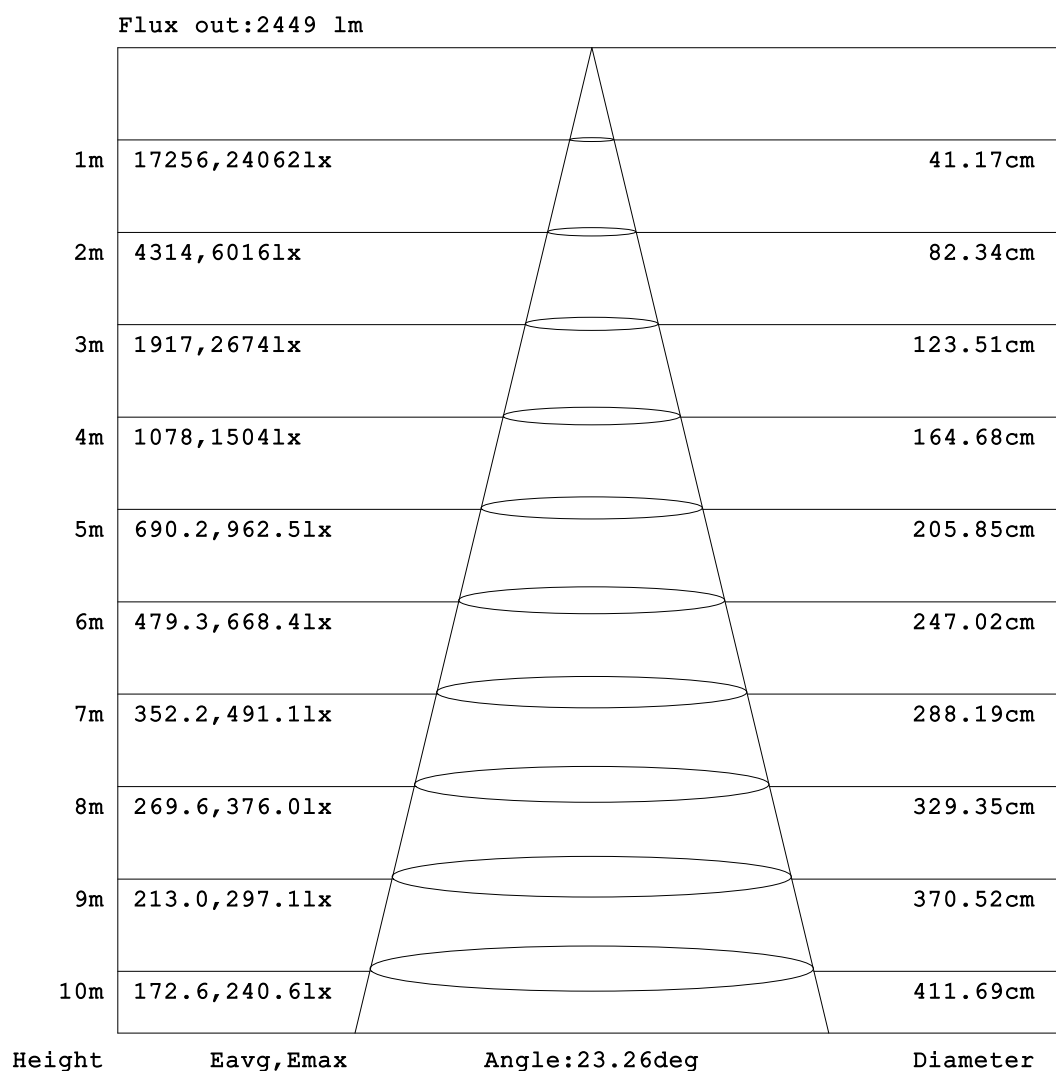


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:

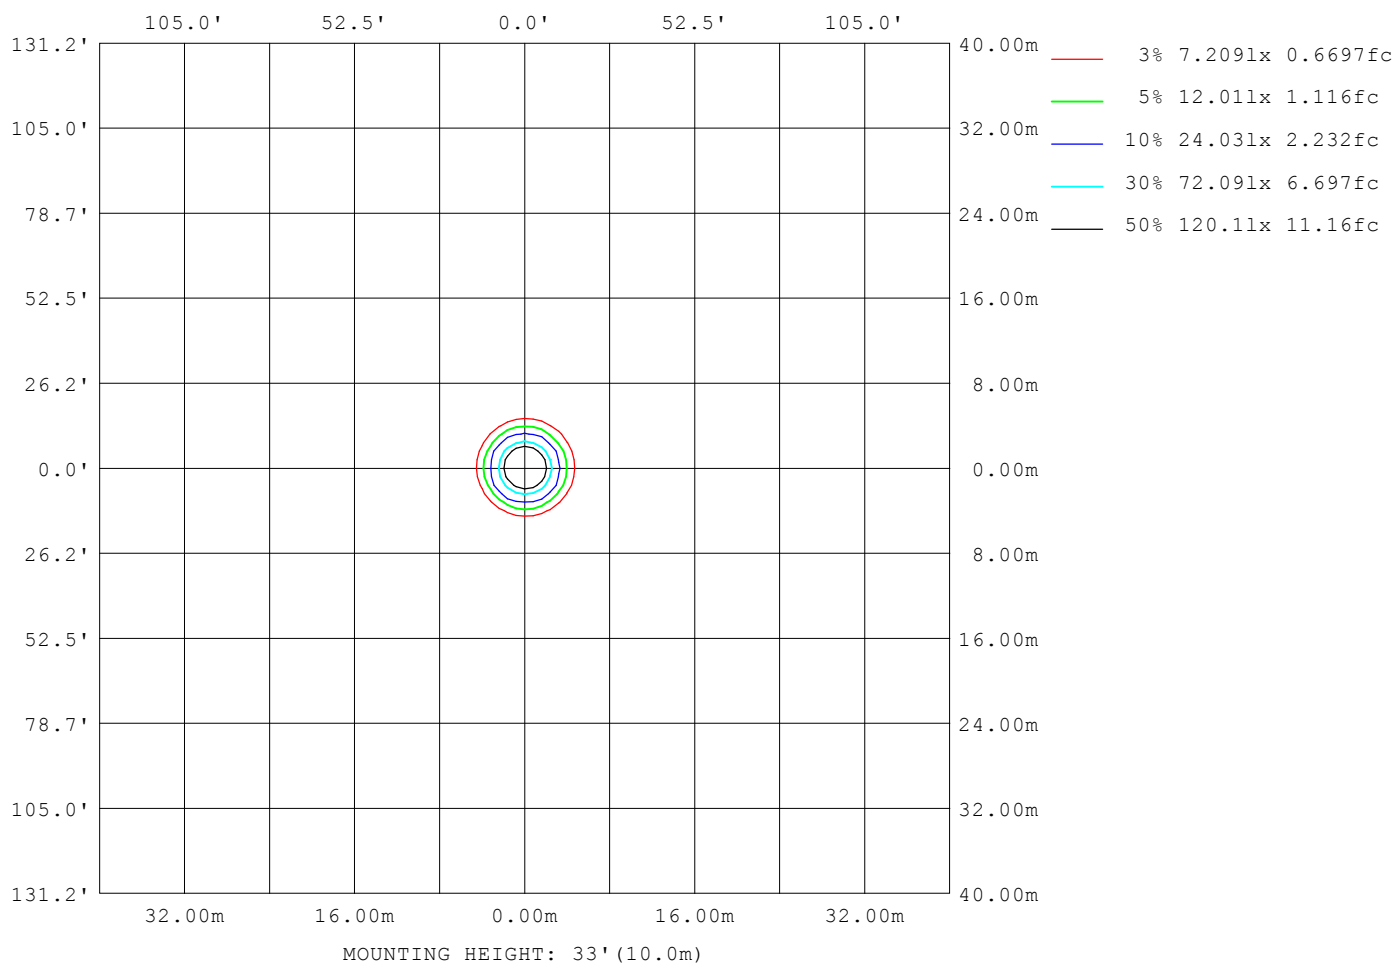

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-09-25

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.4V I:0.1837A P:43.8W PF:0.9921 Freq:49.99Hz UTHDi:0.18% ITHDi:7.40% KDisp:0.9953 Lamp Flux:4524.03x1 lm		
NAME: TR11-45-XX-01+白色防眩环 4000K RA90 24D 45W	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 131mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	5828
L_0~180 (75) av	2018
L_0~180 (85) av	646
L_90~270 (65) av	5808
L_90~270 (75) av	2038
L_90~270 (85) av	854
L_45 (65) av	5840
L_45 (75) av	1820
L_45 (85) av	590

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-09-25

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

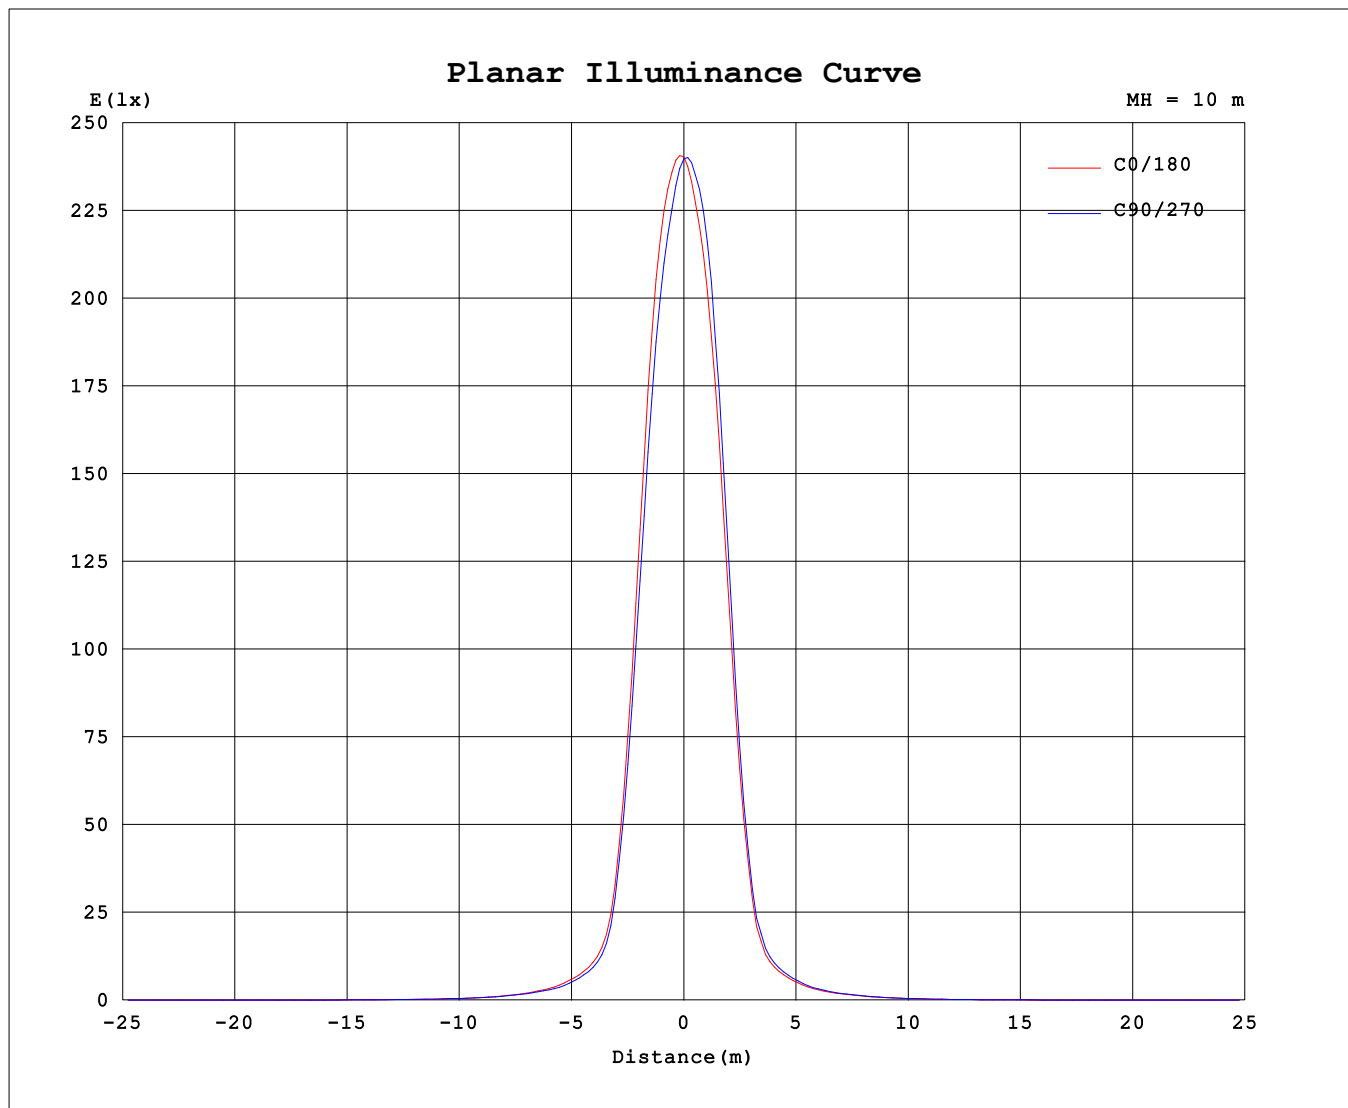

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-09-25

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	23962	23962	23962	23962	23962	23962	23962	23962
3.0	23633	23213	22649	22426	22751	23258	23600	23780
6.0	21958	21377	20322	19739	20518	21456	21975	22100
9.0	17999	17457	16209	15757	16397	17250	17918	17974
12.0	12046	11596	10766	10544	10779	11277	11881	12029
15.0	6482	6209	5828	5690	5720	5867	6250	6454
18.0	2837	2706	2477	2403	2439	2582	2733	2795
21.0	1542	1449	1340	1319	1343	1430	1523	1571
24.0	1079	1016	950.8	931.3	950.4	1003	1061	1103
27.0	797.8	749.6	691.6	679.9	695.8	739.3	774.5	809.3
30.0	579.0	547.8	510.0	499.0	511.2	544.4	560.7	586.3
33.0	459.1	438.0	411.6	388.4	393.5	422.7	432.4	452.7
36.0	333.1	332.6	319.6	309.2	309.9	330.7	328.4	337.9
39.0	258.6	251.6	240.6	236.9	236.6	244.4	254.8	258.1
42.0	198.6	197.1	187.4	185.2	182.7	190.1	193.6	199.6
45.0	152.0	154.3	147.4	146.4	144.0	150.0	149.1	151.7
48.0	119.8	120.8	116.2	115.8	114.1	117.3	117.3	120.5
51.0	96.93	95.58	91.16	89.67	88.30	92.95	94.19	97.71
54.0	79.19	77.44	73.85	72.56	71.58	75.71	76.27	79.69
57.0	59.77	57.90	55.31	54.64	54.38	57.72	58.54	60.43
60.0	48.65	46.94	45.14	44.79	44.66	47.18	47.71	48.97
63.0	39.51	38.27	37.17	36.88	36.81	38.53	38.90	39.64
66.0	30.66	29.95	29.26	29.07	28.89	29.45	29.89	30.53
69.0	20.96	20.75	20.64	20.69	20.53	20.48	20.74	20.82
72.0	14.78	14.71	14.87	14.77	14.72	14.74	14.76	14.79
75.0	7.898	6.541	7.767	6.351	6.103	5.958	6.370	6.401
78.0	3.441	3.318	3.344	3.308	3.310	3.243	3.559	3.386
81.0	2.426	2.358	2.444	2.313	2.368	2.348	2.778	2.354
84.0	0.9408	0.8701	0.9449	0.8639	0.9072	0.8358	1.279	0.8684
87.0	0.4619	0.3812	0.4722	0.3650	0.3729	0.3527	0.6245	0.3840
90.0	0.2089	0.1289	0.2252	0.1311	0.1407	0.1407	0.3315	0.1580

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-09-25

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks: