


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948 Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 91.35 lm/W
MODEL		Imax (cd)	4013	S/MH (C0/180)		0.30
NOMINAL POWER(W)	6	LOR (%)	100.0	S/MH (C90/270)		0.31
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	507.87	η UP,DN (C0-180)		0.0,48.7
NOMINAL FLUX(lm)	507.868	CIE CLASS	DIRECT	η UP,DN (C180-360)		0.0,51.3
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM		0.00
TEST VOLTAGE(V)	240.27	η down (%)	100.0	CIBSE SHR MAX		0.30

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

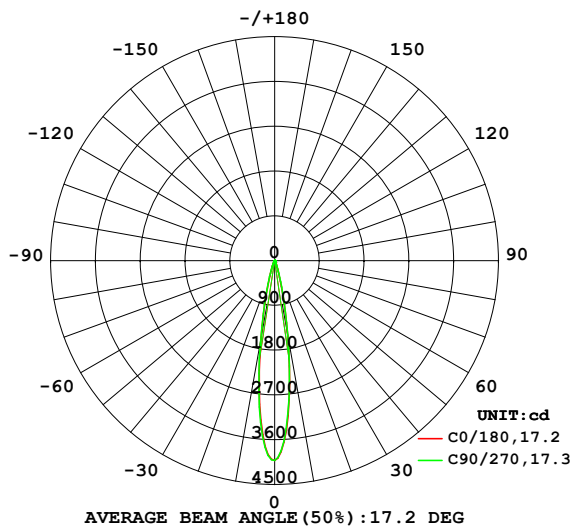

PLANAR ISOLUX DIAGRAM (UNIT:lx)

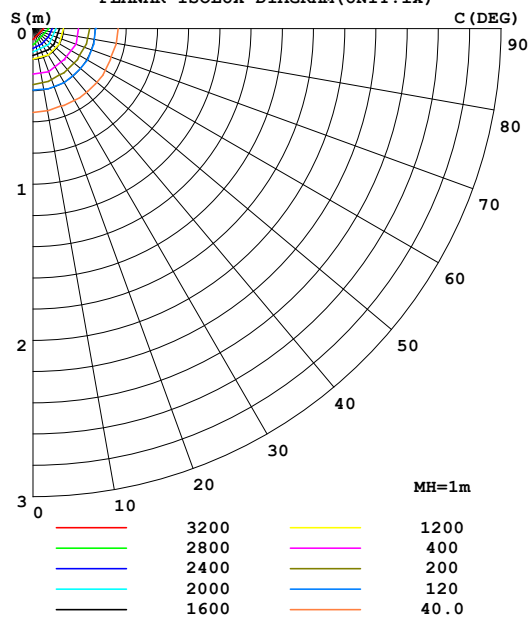

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1545	1512	1524	1588	1607	1641	1659	1588	0- 10	249.3	249.3	49.1,49.1
20	190.2	191.3	206.4	225.1	225.3	227.8	230.1	209.6	10- 20	174.4	423.6	83.4,83.4
30	45.13	45.71	47.13	50.12	49.79	50.97	50.92	48.44	20- 30	46.87	470.5	92.6,92.6
40	17.79	18.42	18.93	19.48	19.24	19.50	19.70	18.61	30- 40	18.79	489.3	96.3,96.3
50	7.967	8.149	8.231	8.461	8.562	8.665	8.442	8.011	40- 50	9.909	499.2	98.3,98.3
60	3.546	3.625	3.660	3.703	3.701	3.744	3.705	3.573	50- 60	4.923	504.1	99.3,99.3
70	1.406	1.413	1.745	1.822	1.748	1.690	1.771	1.522	60- 70	2.602	506.7	99.8,99.8
80	0.4134	0.3794	0.3785	0.4539	0.4773	0.4319	0.3882	0.4163	70- 80	0.9975	507.7	100,100
90	0.0160	0.0093	0.0180	0.0077	0.0083	0.0083	0.0113	0.0087	80- 90	0.1263	507.9	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 495.06 lm

%lum = 97.5%

%lamp = 97.5%

Conical surface Flux(120deg): 504.14 lm

%lum = 99.3%


%lamp = 99.3%

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948 Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

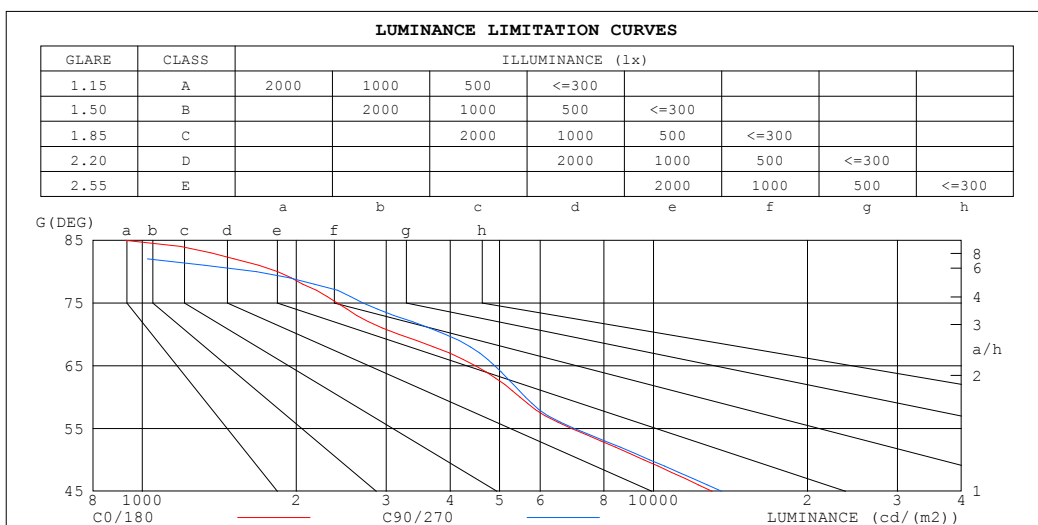


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948 Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00														
1.0	1.13	1.11	1.10	1.11	1.09	1.08	1.07	1.06	1.05	1.03	1.02	1.02	1.00	.99	.99	.97														
2.0	1.08	1.05	1.03	1.06	1.04	1.02	1.03	1.01	.00	1.01	.99	.97	.98	.97	.95	.94														
3.0	1.04	1.00	.98	1.03	.99	.97	1.00	.98	.95	.98	.96	.94	.96	.94	.93	.91														
4.0	1.00	.96	.94	.99	.96	.93	.97	.94	.92	.95	.93	.91	.94	.92	.90	.89														
5.0	.97	.93	.90	.96	.93	.90	.95	.92	.89	.93	.90	.88	.92	.90	.88	.87														
6.0	.94	.90	.87	.93	.90	.87	.92	.89	.87	.91	.88	.86	.90	.87	.86	.85														
7.0	.92	.88	.85	.91	.87	.85	.90	.87	.84	.89	.86	.84	.88	.86	.84	.83														
8.0	.89	.85	.83	.89	.85	.83	.88	.85	.82	.87	.84	.82	.86	.84	.82	.81														
9.0	.87	.83	.81	.87	.83	.81	.86	.83	.81	.85	.82	.80	.85	.82	.80	.79														
10.0	.85	.82	.79	.85	.81	.79	.84	.81	.79	.84	.81	.79	.83	.81	.79	.78														

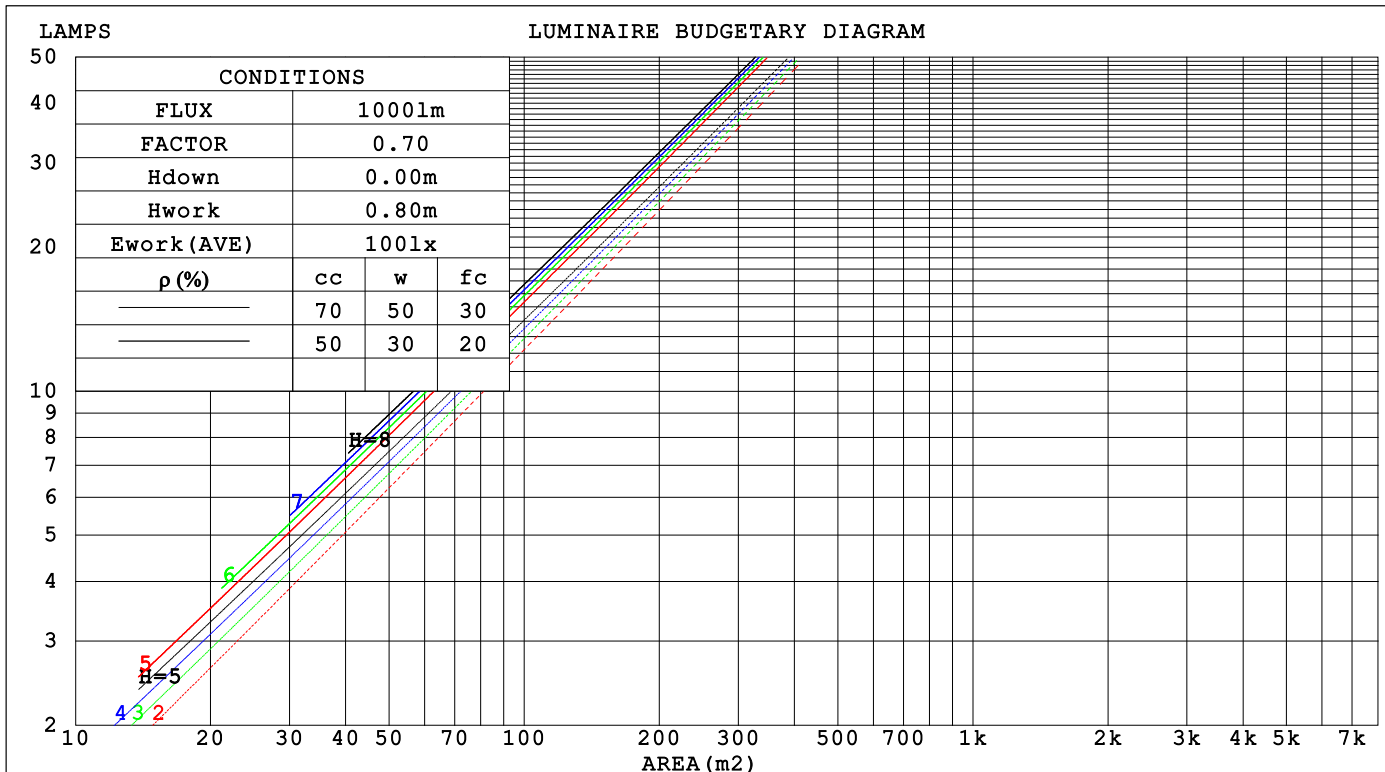

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz			UTHDi:0.18% ITHDi:24.58% KDisp:0.8948			Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D			TYPE:			WEIGHT:		
SPEC.:			DIM.:			SERIAL No.:		
MFR.: Norming Lighting			SUR.: 41mm			Shielding Angle:		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.132	.075	.024	.125	.071	.023	.113	.065	.021	.102	.059	.019	.091	.053	.017		
2.0	.122	.067	.020	.116	.064	.020	.106	.059	.018	.097	.054	.017	.088	.050	.016		
3.0	.113	.060	.018	.108	.058	.017	.100	.054	.016	.092	.050	.015	.085	.047	.015		
4.0	.105	.055	.016	.101	.053	.016	.094	.050	.015	.088	.047	.014	.081	.044	.013		
5.0	.098	.050	.015	.095	.049	.014	.089	.046	.014	.083	.044	.013	.078	.042	.013		
6.0	.092	.046	.013	.090	.045	.013	.084	.043	.013	.080	.041	.012	.075	.040	.012		
7.0	.087	.043	.012	.085	.042	.012	.080	.041	.012	.076	.039	.011	.072	.038	.011		
8.0	.083	.040	.011	.080	.040	.011	.077	.038	.011	.073	.037	.011	.069	.036	.010		
9.0	.078	.038	.011	.077	.037	.010	.073	.036	.010	.070	.035	.010	.067	.034	.010		
10.0	.075	.036	.010	.073	.035	.010	.070	.034	.010	.067	.033	.009	.065	.032	.009		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.168	.158	.148	.144	.135	.128	.098	.093	.088	.057	.054	.051	.018	.017	.017		
2.0	.150	.133	.119	.128	.114	.103	.088	.079	.071	.051	.046	.042	.016	.015	.014		
3.0	.134	.113	.097	.115	.098	.084	.079	.068	.059	.046	.040	.035	.015	.013	.011		
4.0	.121	.098	.080	.104	.084	.069	.072	.059	.049	.041	.034	.029	.013	.011	.009		
5.0	.110	.085	.067	.095	.074	.058	.065	.052	.041	.038	.030	.024	.012	.010	.008		
6.0	.101	.075	.057	.087	.065	.049	.060	.046	.035	.035	.027	.021	.011	.009	.007		
7.0	.093	.067	.048	.080	.058	.042	.055	.041	.030	.032	.024	.018	.010	.008	.006		
8.0	.086	.060	.042	.074	.052	.036	.051	.037	.026	.030	.022	.015	.010	.007	.005		
9.0	.080	.054	.036	.069	.047	.032	.048	.033	.023	.028	.020	.013	.009	.006	.004		
10.0	.075	.049	.032	.065	.043	.028	.045	.030	.020	.026	.018	.012	.009	.006	.004		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz UTHDi:0.18% ITHDi:24.58% KDisp:0.8948Lamp Flux:507.868x1 lm											
NAME: MD10-06-XX-04 3000K RA90 15D						TYPE:		WEIGHT:			
SPEC.:						DIM.:		SERIAL No.:			
MFR.: Norming Lighting						SUR.: 41mm		Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
x = 2H y = 2H	11.9	12.5	12.1	12.6	12.8	12.0	12.6	12.2	12.8	12.9	
	3H	12.1	12.7	12.4	12.9	13.1	12.4	12.9	12.6	13.1	13.3
	4H	12.2	12.7	12.4	12.9	13.1	12.4	13.0	12.7	13.2	13.4
	6H	12.2	12.7	12.5	12.9	13.2	12.4	12.9	12.7	13.2	13.4
	8H	12.2	12.7	12.4	12.9	13.1	12.4	12.9	12.7	13.1	13.4
	12H	12.1	12.6	12.4	12.9	13.1	12.3	12.8	12.6	13.1	13.3
4H	2H	12.0	12.5	12.2	12.7	12.9	12.1	12.7	12.4	12.9	13.1
	3H	12.3	12.8	12.6	13.0	13.3	12.5	13.0	12.8	13.3	13.5
	4H	12.4	12.8	12.7	13.1	13.4	12.6	13.0	12.9	13.3	13.6
	6H	12.4	12.8	12.8	13.1	13.4	12.6	13.0	13.0	13.3	13.7
	8H	12.4	12.7	12.7	13.1	13.4	12.6	12.9	13.0	13.3	13.7
	12H	12.3	12.7	12.7	13.0	13.4	12.5	12.9	12.9	13.2	13.6
8H	4H	12.3	12.7	12.7	13.0	13.4	12.5	12.9	12.9	13.3	13.6
	6H	12.3	12.7	12.8	13.0	13.5	12.6	12.9	13.0	13.3	13.7
	8H	12.3	12.6	12.8	13.0	13.5	12.5	12.8	13.0	13.2	13.6
	12H	12.3	12.5	12.7	13.0	13.4	12.5	12.7	12.9	13.1	13.6
12H	4H	12.3	12.6	12.7	13.0	13.4	12.5	12.8	12.9	13.2	13.6
	6H	12.3	12.6	12.7	13.0	13.4	12.5	12.8	13.0	13.2	13.6
	8H	12.3	12.5	12.7	13.0	13.4	12.5	12.7	12.9	13.1	13.6
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H	+ 1.3 / - 2.0					+ 1.3 / - 1.9					
1.5H	+ 1.8 / - 1.6					+ 1.9 / - 1.6					
2.0H	+ 2.4 / - 1.6					+ 2.5 / - 1.6					

CIE Pub.117, 507.9 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -2.4)
Area: 0.0013 m2

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948 Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	89	83	80	89	83	80	88	83	79	76
0.80	96	91	87	96	91	87	95	90	87	83
1.00	100	95	92	100	95	92	98	95	91	87
1.25	104	99	96	103	99	96	101	98	95	91
1.50	107	102	99	106	102	99	103	100	98	93
2.00	109	105	102	108	104	101	105	102	100	95
2.50	111	107	104	109	106	103	106	104	102	96
3.00	112	109	106	110	108	105	107	105	103	97
4.00	114	112	109	112	110	108	109	107	105	98
5.00	115	113	112	113	111	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948 Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

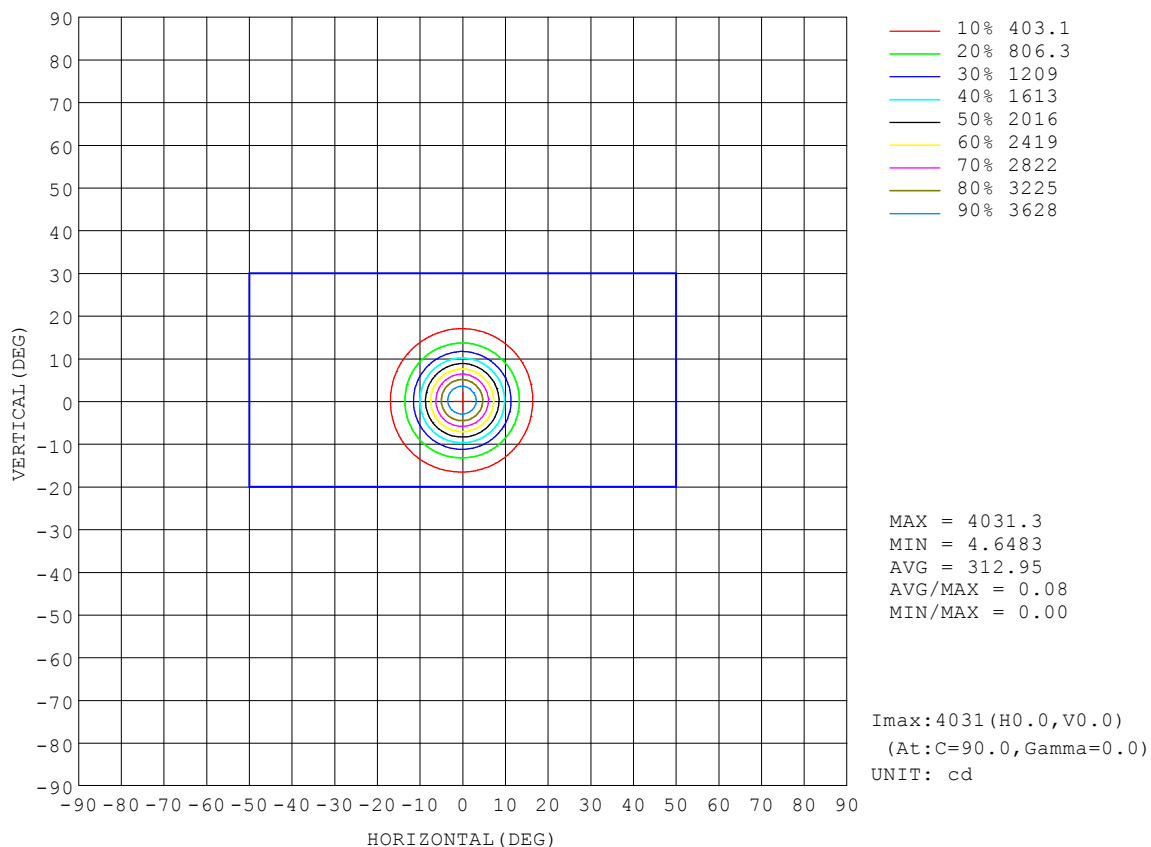


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948		Lamp Flux:507.868x1 lm
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

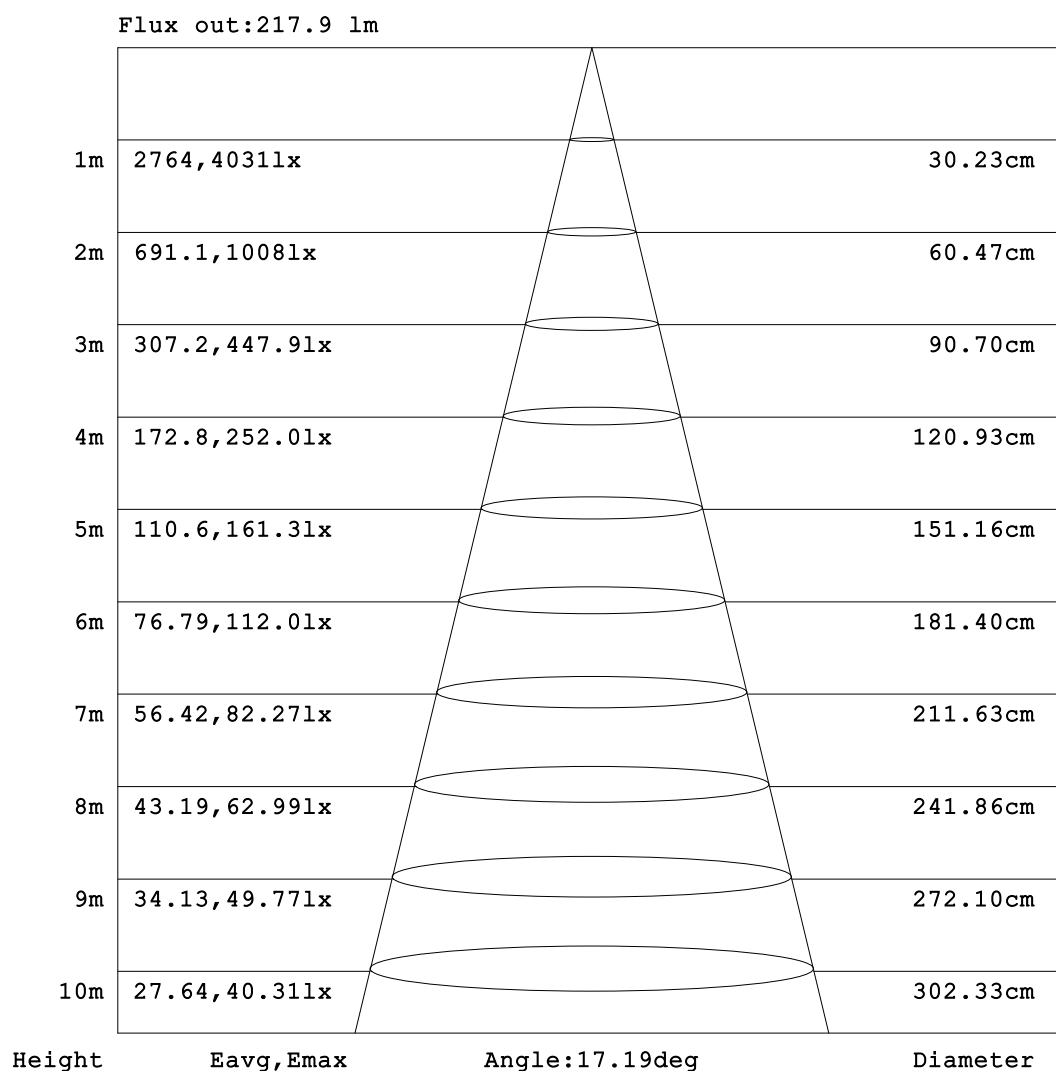


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948 Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

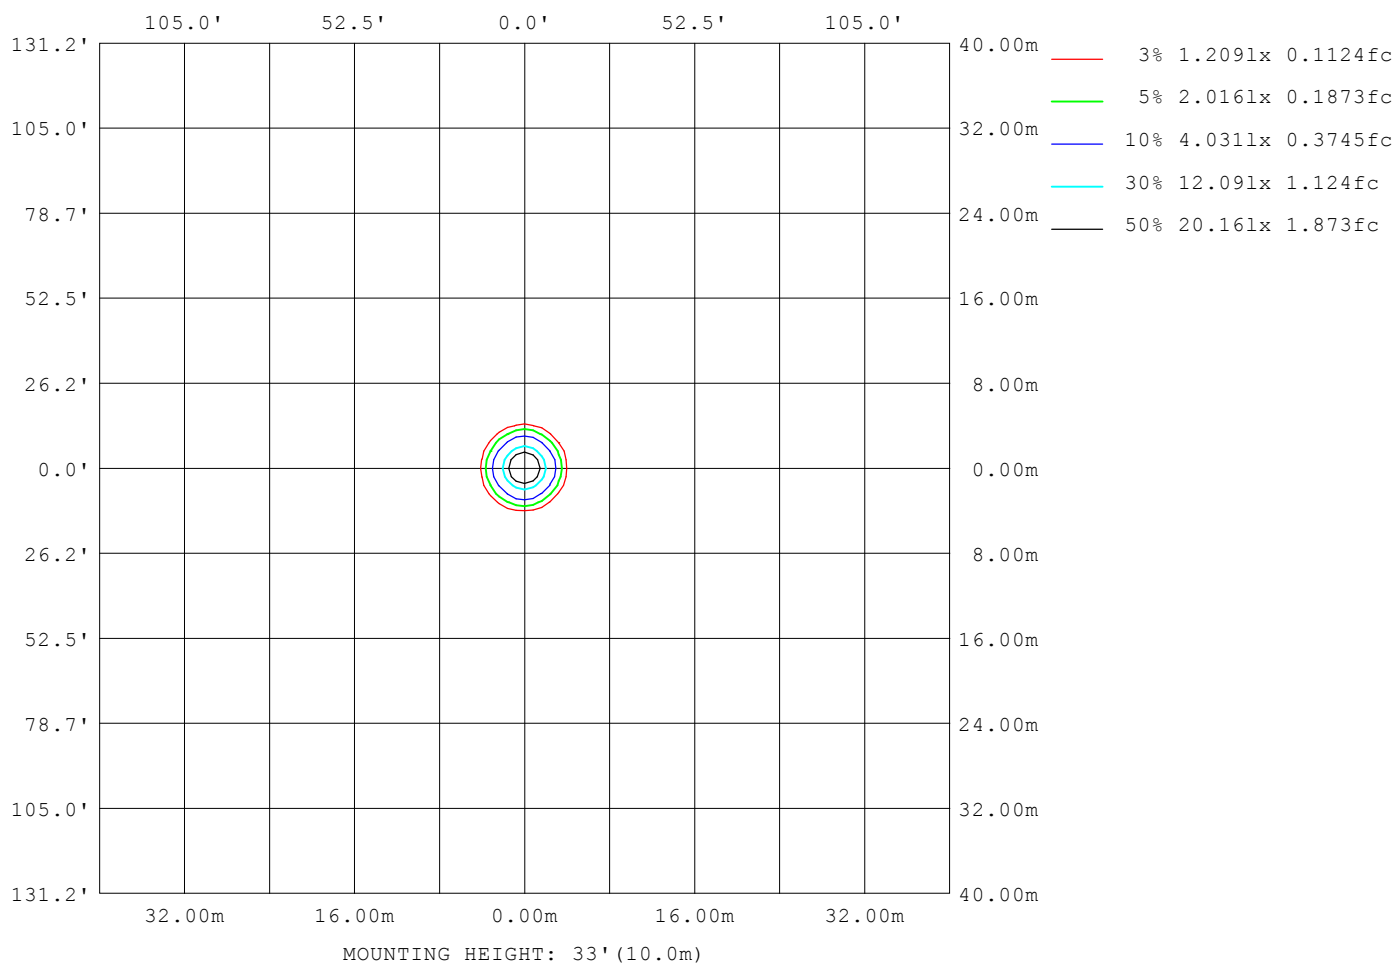

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.3V I:0.0267A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.58% KDisp:0.8948 Lamp Flux:507.868x1 lm		
NAME: MD10-06-XX-04 3000K RA90 15D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	4690
L_0~180 (75) av	2636
L_0~180 (85) av	1122
L_90~270 (65) av	4925
L_90~270 (75) av	2794
L_90~270 (85) av	172
L_45 (65) av	4770
L_45 (75) av	2672
L_45 (85) av	111

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

Planar Illuminance Curve

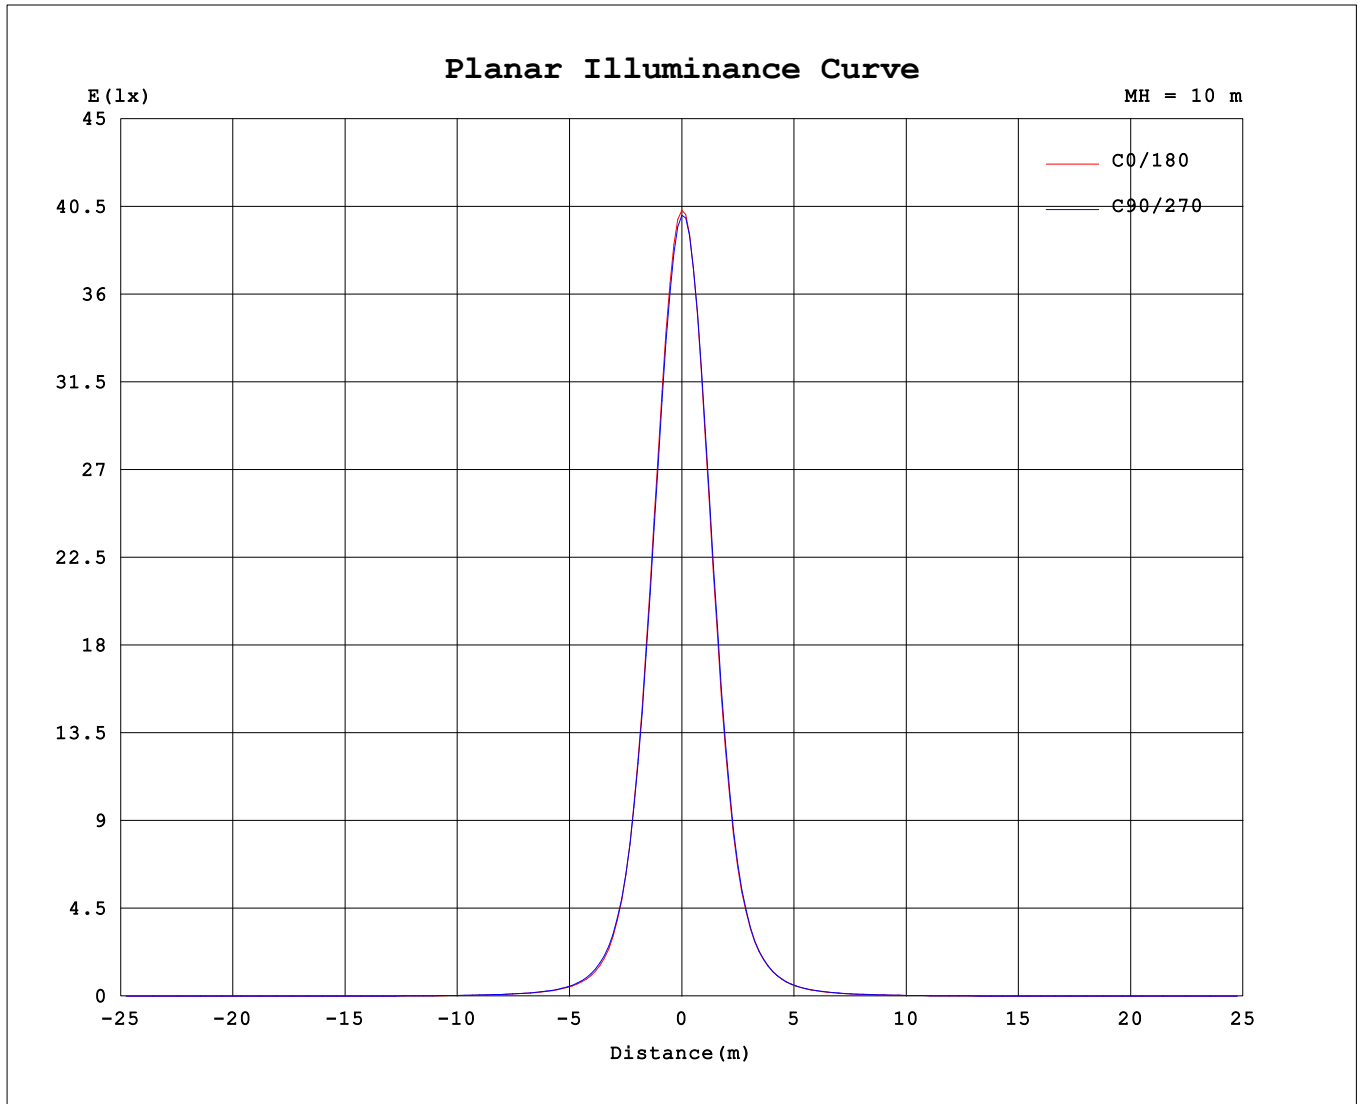

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	4013	4013	4013	4013	4013	4013	4013	4013
3.0	3655	3621	3631	3685	3728	3762	3756	3694
6.0	2813	2764	2781	2859	2902	2953	2956	2867
9.0	1843	1806	1818	1890	1919	1952	1974	1891
12.0	1043	1020	1036	1086	1094	1114	1133	1075
15.0	542.9	534.1	555.5	588.1	590.6	599.9	610.0	570.8
18.0	283.0	281.6	300.8	324.3	325.6	330.2	333.8	305.6
21.0	158.3	160.1	172.9	189.6	189.4	191.1	193.3	175.4
24.0	96.70	98.80	105.4	115.5	114.9	116.5	117.5	107.3
27.0	64.51	65.50	68.78	73.98	73.65	75.43	75.29	70.30
30.0	45.13	45.71	47.13	50.12	49.79	50.97	50.92	48.44
33.0	32.87	33.41	34.29	35.77	35.50	36.26	36.46	34.98
36.0	24.92	25.54	26.27	27.07	26.74	27.31	27.58	26.38
39.0	19.31	19.94	20.54	21.05	20.78	21.17	21.39	20.31
42.0	15.12	15.71	16.04	16.49	16.35	16.62	16.64	15.72
45.0	11.91	12.34	12.52	12.88	12.93	13.08	12.94	12.18
48.0	9.393	9.642	9.761	10.03	10.14	10.28	10.03	9.496
51.0	7.318	7.466	7.545	7.746	7.845	7.948	7.735	7.353
54.0	5.620	5.705	5.738	5.870	5.953	6.043	5.909	5.638
57.0	4.323	4.401	4.410	4.470	4.497	4.573	4.505	4.347
60.0	3.546	3.625	3.660	3.703	3.701	3.744	3.705	3.573
63.0	2.884	2.943	3.060	3.110	3.081	3.107	3.090	2.949
66.0	2.233	2.273	2.512	2.571	2.512	2.501	2.531	2.335
69.0	1.595	1.605	1.944	2.016	1.937	1.892	1.963	1.716
72.0	1.106	1.115	1.358	1.443	1.385	1.339	1.401	1.197
75.0	0.8058	0.8054	0.9119	0.9695	0.9684	0.9517	0.9685	0.8702
78.0	0.5542	0.5497	0.5876	0.6559	0.6632	0.6373	0.5925	0.6025
81.0	0.3418	0.2969	0.2697	0.3575	0.4005	0.3427	0.2862	0.3277
84.0	0.1605	0.0635	0.0233	0.1076	0.2014	0.1009	0.0222	0.0926
87.0	0.0278	0.0055	0.0200	0.0081	0.0249	0.0093	0.0203	0.0058
90.0	0.0160	0.0093	0.0180	0.0077	0.0083	0.0083	0.0113	0.0087

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks: