


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 94.52 lm/W
MODEL		Imax (cd)	3029	S/MH (C0/180)	0.37	
NOMINAL POWER(W)	6	LOR (%)	100.0	S/MH (C90/270)	0.37	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	525.04	η UP,DN (C0-180)	0.0,49.7	
NOMINAL FLUX(lm)	525.04	CIE CLASS	DIRECT	η UP,DN (C180-360)	0.0,50.3	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	240.25	η down (%)	100.0	CIBSE SHR MAX	0.30	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

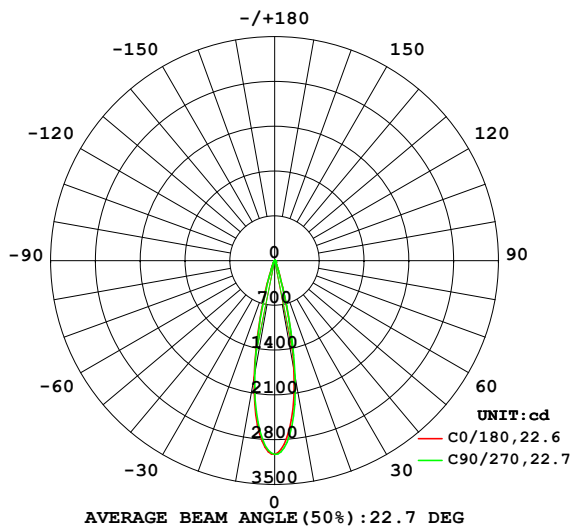

PLANAR ISOLUX DIAGRAM (UNIT: lx)

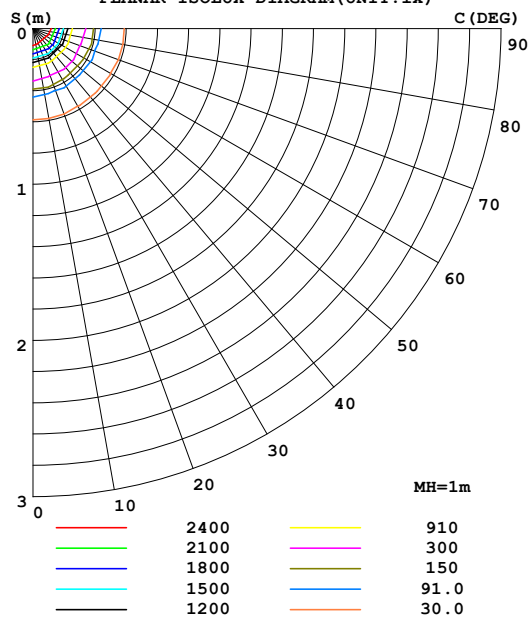

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1755	1780	1849	1885	1855	1806	1796	1756	0- 10	228.7	228.7	43.6,43.6
20	209.2	195.8	207.1	230.8	241.0	228.2	230.6	213.6	10- 20	214.4	443.1	84.4,84.4
30	46.93	45.26	47.23	50.00	50.30	48.69	48.21	48.20	20- 30	45.87	488.9	93.1,93.1
40	18.45	18.17	18.72	19.07	19.57	19.16	19.65	18.83	30- 40	18.67	507.6	96.7,96.7
50	8.329	8.296	8.418	8.600	8.699	9.057	9.004	8.583	40- 50	10.14	517.7	98.6,98.6
60	2.469	2.468	2.609	2.681	2.626	2.687	2.771	2.561	50- 60	4.649	522.4	99.5,99.5
70	1.077	1.082	1.165	1.229	1.202	1.173	1.165	1.117	60- 70	1.728	524.1	99.8,99.8
80	0.3930	0.3717	0.3785	0.4583	0.4641	0.4061	0.3645	0.4041	70- 80	0.7946	524.9	100,100
90	0.0161	0.0071	0.0202	0.0106	0.0112	0.0074	0.0135	0.0058	80- 90	0.1320	525.0	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 513.41 lm

%lum = 97.8%

%lamp = 97.8%

Conical surface Flux(120deg): 522.38 lm

%lum = 99.5%


%lamp = 99.5%

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

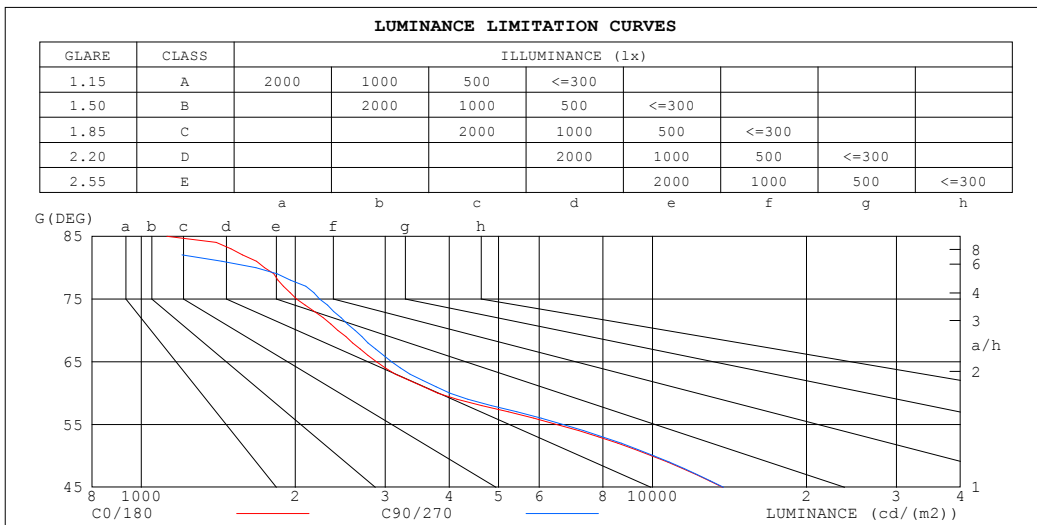


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00														
1.0	1.13	1.11	1.10	1.11	1.09	1.08	1.07	1.06	1.05	1.03	1.02	1.01	.00	.99	.99	.97														
2.0	1.08	1.05	1.03	1.06	1.04	1.01	1.03	1.01	.99	1.00	.99	.97	.98	.96	.95	.94														
3.0	1.04	1.00	.97	1.02	.99	.97	.00	.97	.95	.98	.95	.94	.95	.94	.92	.91														
4.0	.00	.96	.93	.99	.95	.93	.97	.94	.92	.95	.93	.91	.93	.91	.90	.88														
5.0	.96	.93	.90	.96	.92	.89	.94	.91	.89	.93	.90	.88	.91	.89	.87	.86														
6.0	.93	.90	.87	.93	.89	.86	.92	.88	.86	.90	.87	.85	.89	.87	.85	.84														
7.0	.91	.87	.84	.90	.87	.84	.89	.86	.83	.88	.85	.83	.87	.85	.83	.82														
8.0	.88	.84	.82	.88	.84	.82	.87	.84	.81	.86	.83	.81	.85	.83	.81	.80														
9.0	.86	.82	.80	.86	.82	.80	.85	.82	.79	.84	.81	.79	.84	.81	.79	.78														
10.0	.84	.80	.78	.84	.80	.78	.83	.80	.78	.82	.80	.77	.82	.79	.77	.76														

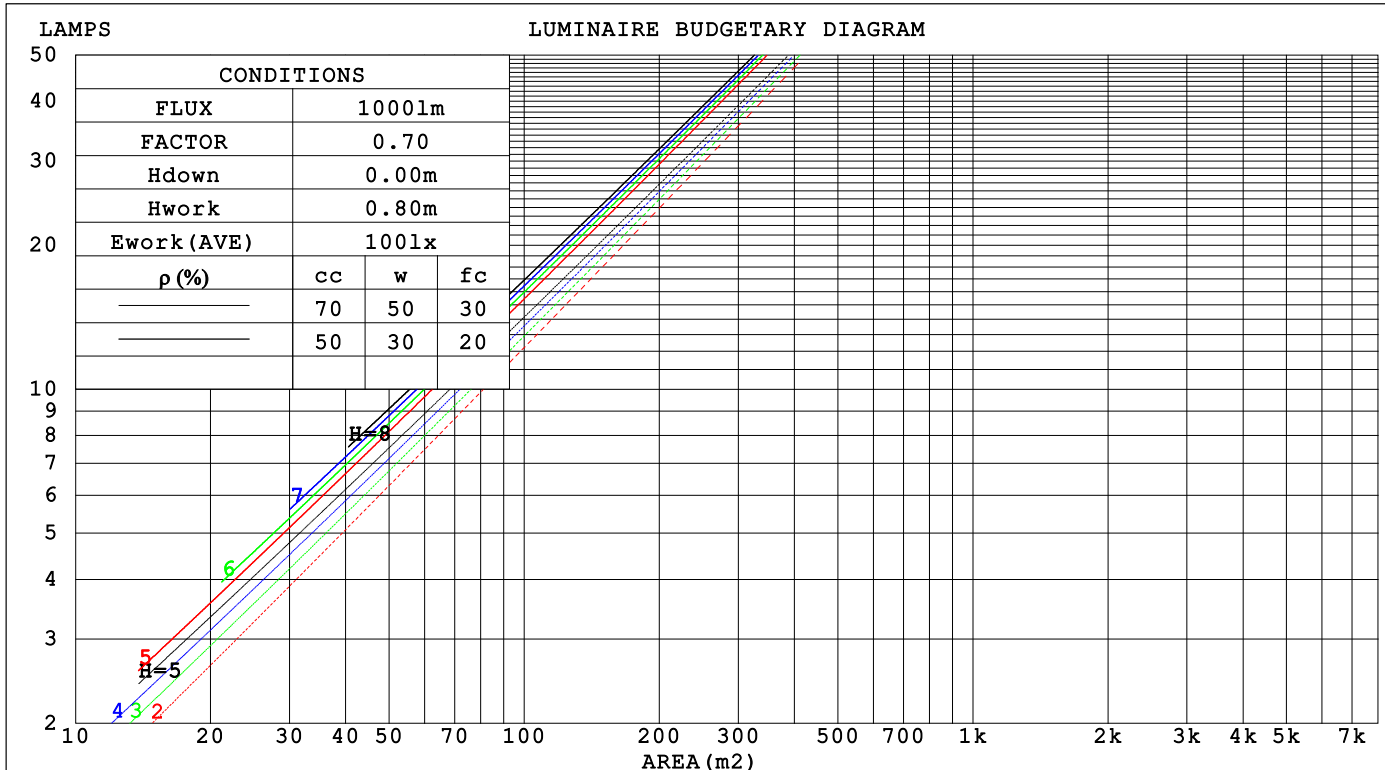

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)										
0.0																	
1.0	.134	.076	.024	.127	.072	.023	.115	.066	.021	.103	.060	.019	.093	.054	.017		
2.0	.123	.068	.021	.118	.065	.020	.108	.060	.019	.098	.055	.017	.090	.051	.016		
3.0	.115	.061	.018	.110	.059	.018	.102	.055	.017	.094	.051	.016	.087	.048	.015		
4.0	.107	.056	.016	.103	.054	.016	.096	.051	.015	.089	.048	.014	.083	.045	.014		
5.0	.100	.051	.015	.097	.050	.015	.091	.047	.014	.085	.045	.013	.080	.043	.013		
6.0	.094	.047	.014	.092	.046	.013	.086	.044	.013	.082	.042	.012	.077	.041	.012		
7.0	.089	.044	.013	.087	.043	.012	.082	.042	.012	.078	.040	.012	.074	.039	.011		
8.0	.085	.041	.012	.083	.041	.012	.079	.039	.011	.075	.038	.011	.072	.037	.011		
9.0	.081	.039	.011	.079	.038	.011	.075	.037	.011	.072	.036	.010	.069	.035	.010		
10.0	.077	.037	.010	.075	.036	.010	.072	.035	.010	.070	.035	.010	.067	.034	.010		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.168	.158	.148	.144	.135	.128	.098	.093	.088	.057	.054	.051	.018	.017	.017		
2.0	.150	.133	.118	.128	.114	.102	.088	.079	.071	.051	.046	.042	.016	.015	.014		
3.0	.135	.113	.096	.115	.098	.083	.079	.068	.059	.046	.040	.035	.015	.013	.011		
4.0	.122	.098	.080	.104	.085	.069	.072	.059	.049	.042	.035	.029	.013	.011	.009		
5.0	.111	.085	.067	.095	.074	.058	.066	.052	.041	.038	.030	.024	.012	.010	.008		
6.0	.102	.075	.056	.088	.065	.049	.060	.046	.035	.035	.027	.021	.011	.009	.007		
7.0	.094	.067	.048	.081	.058	.042	.056	.041	.030	.032	.024	.018	.010	.008	.006		
8.0	.087	.060	.042	.075	.052	.036	.052	.037	.026	.030	.022	.015	.010	.007	.005		
9.0	.082	.054	.036	.070	.047	.032	.049	.033	.022	.028	.020	.013	.009	.006	.004		
10.0	.076	.050	.032	.066	.043	.028	.046	.030	.020	.027	.018	.012	.009	.006	.004		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm										
NAME: MD10-06-XX-04 3000K RA90 24D					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: Norming Lighting					SUR.: 41mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	11.5	12.1	11.7	12.3	12.4	11.6	12.2	11.8	12.3	12.5
3H	11.6	12.2	11.8	12.3	12.5	11.7	12.2	11.9	12.4	12.6
4H	11.6	12.1	11.8	12.4	12.6	11.7	12.2	11.9	12.4	12.6
6H	11.6	12.1	11.9	12.3	12.6	11.7	12.2	12.0	12.4	12.7
8H	11.6	12.1	11.9	12.3	12.6	11.6	12.2	11.9	12.4	12.6
12H	11.5	12.0	11.8	12.3	12.5	11.6	12.1	11.9	12.3	12.6
4H 2H	11.5	12.0	11.7	12.2	12.4	11.5	12.1	11.8	12.3	12.5
3H	11.6	12.1	11.9	12.3	12.6	11.7	12.1	12.0	12.4	12.7
4H	11.6	12.1	12.0	12.4	12.7	11.7	12.2	12.1	12.5	12.8
6H	11.6	12.0	12.0	12.4	12.7	11.7	12.1	12.1	12.5	12.8
8H	11.6	12.0	12.0	12.3	12.7	11.7	12.1	12.1	12.4	12.8
12H	11.6	11.9	12.0	12.3	12.7	11.7	12.0	12.1	12.4	12.7
8H 4H	11.6	11.9	11.9	12.3	12.6	11.6	12.0	12.0	12.4	12.7
6H	11.6	11.9	12.0	12.3	12.7	11.7	12.0	12.1	12.4	12.8
8H	11.6	11.9	12.0	12.3	12.7	11.7	11.9	12.1	12.3	12.8
12H	11.6	11.8	12.0	12.2	12.7	11.6	11.8	12.1	12.3	12.7
12H 4H	11.5	11.8	11.9	12.2	12.6	11.6	11.9	12.0	12.3	12.7
6H	11.5	11.8	12.0	12.2	12.7	11.6	11.9	12.1	12.3	12.8
8H	11.5	11.8	12.0	12.2	12.7	11.6	11.8	12.1	12.3	12.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.6 / - 2.7					+ 1.6 / - 2.6				
1.5H	+ 2.0 / - 2.1					+ 2.0 / - 2.0				
2.0H	+ 3.2 / - 3.3					+ 3.2 / - 3.3				

CIE Pub.117, 525.0 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -2.2)
Area: 0.0013 m2

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	89	83	80	89	83	80	88	83	80	76
0.80	97	91	88	96	91	88	95	90	87	84
1.00	101	95	92	100	95	92	98	95	91	88
1.25	104	100	96	103	99	96	101	98	95	91
1.50	107	102	99	106	102	99	104	100	98	94
2.00	109	105	102	108	104	102	105	102	100	95
2.50	111	107	104	109	106	104	106	104	102	96
3.00	112	109	107	111	108	105	107	105	103	97
4.00	114	112	110	112	110	108	109	107	105	98
5.00	115	113	112	113	112	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

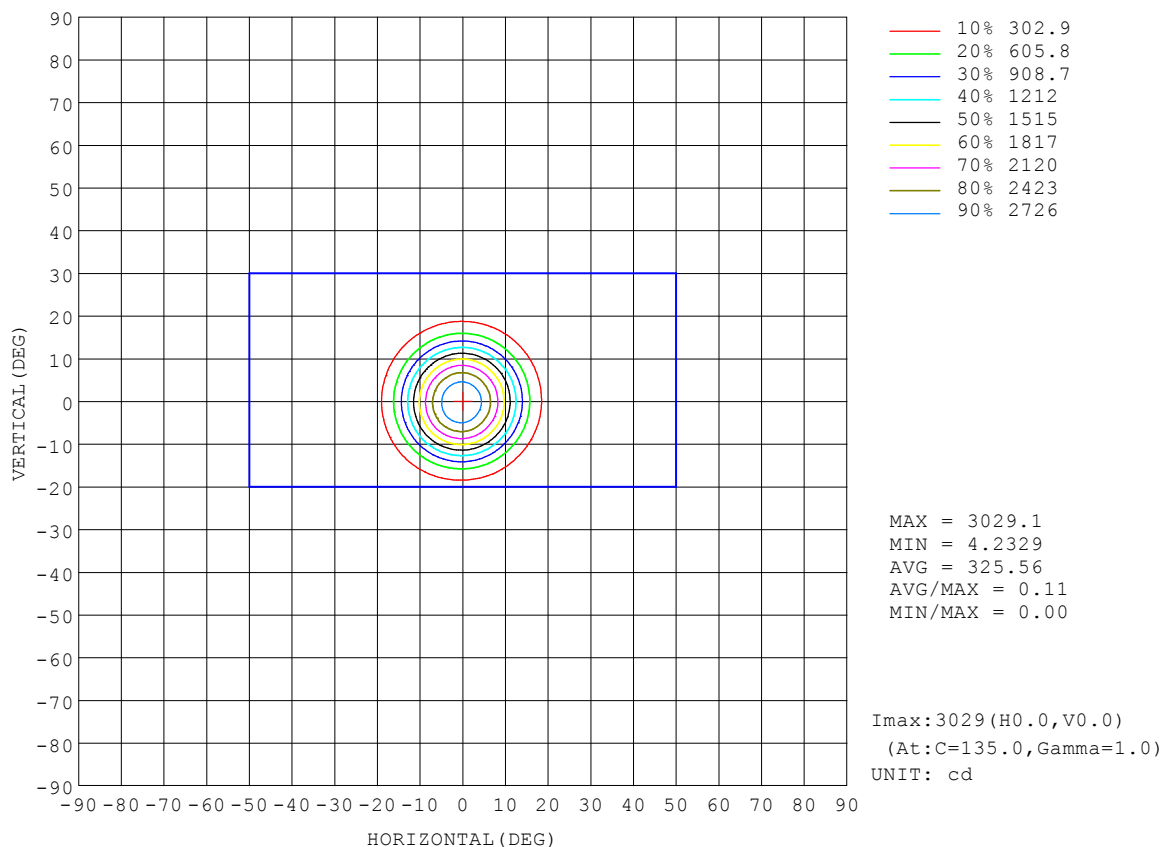


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

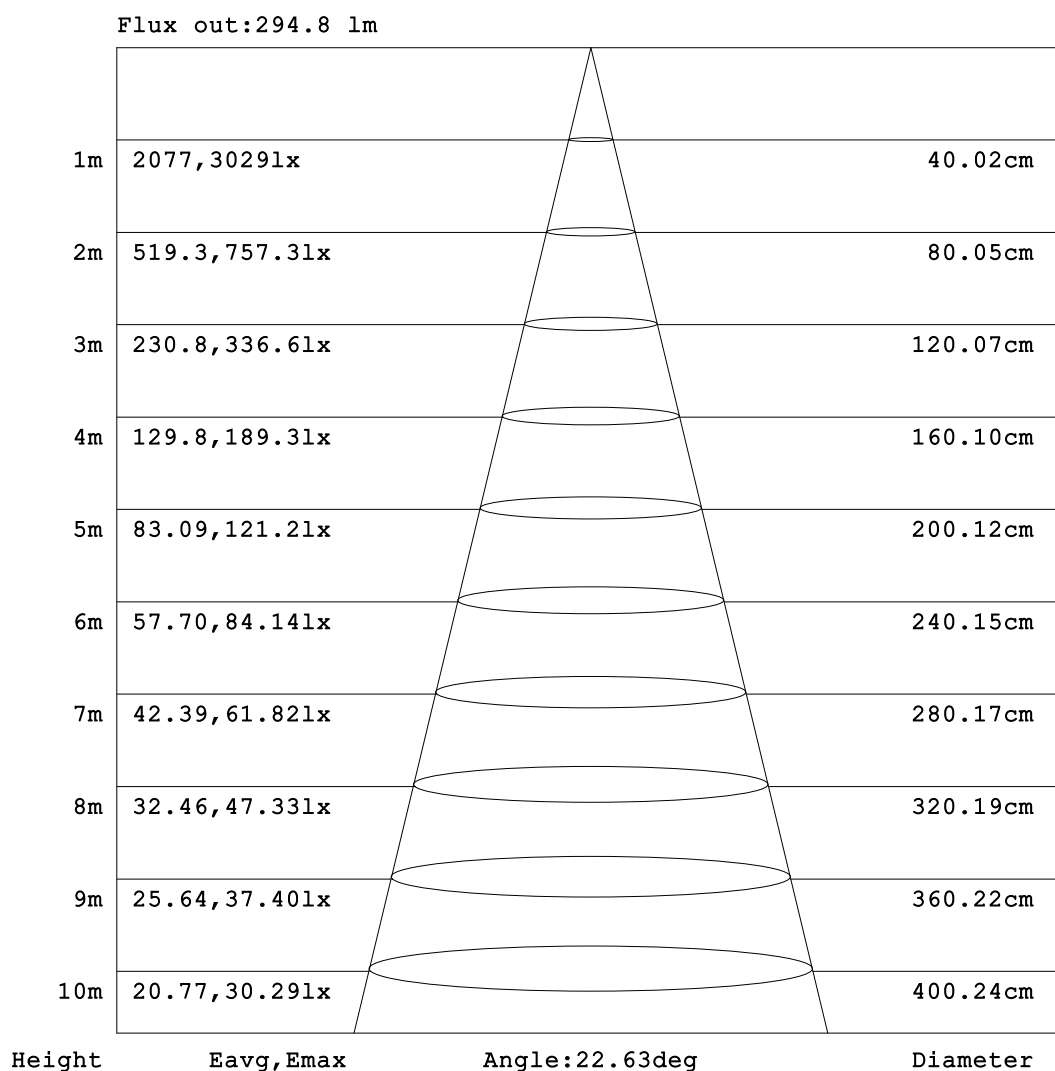


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz		
UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

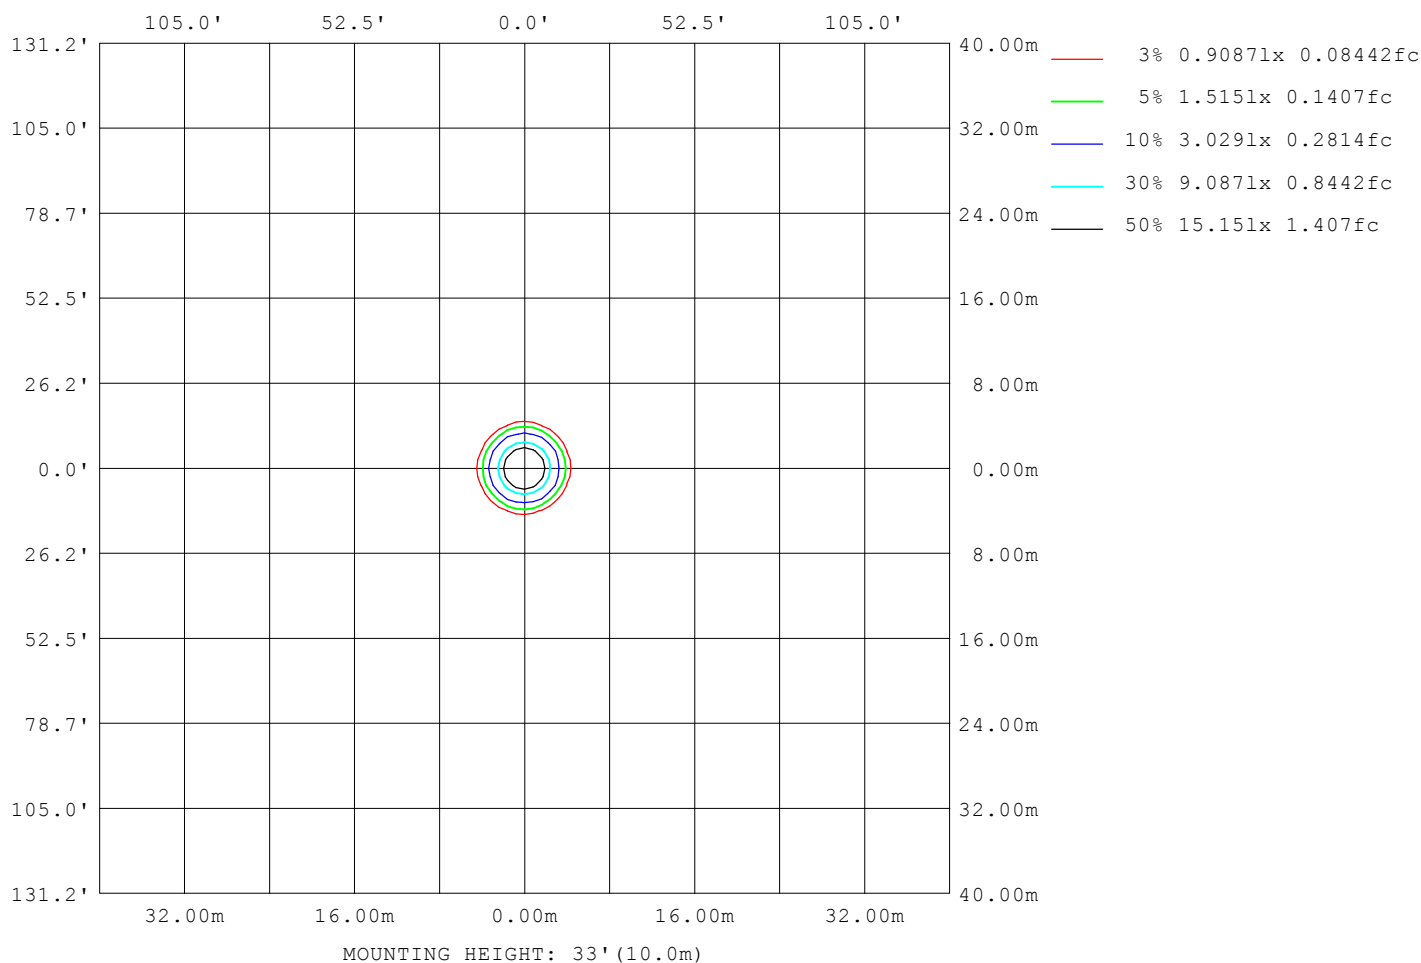

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.3V I:0.0266A P:5.6W PF:0.8681 Freq:49.99Hz UTHDi:0.18% ITHDi:24.64% KDisp:0.8947 Lamp Flux:525.04x1 lm		
NAME: MD10-06-XX-04 3000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	3026
L_0~180 (75) av	2160
L_0~180 (85) av	1329
L_90~270 (65) av	3136
L_90~270 (75) av	2217
L_90~270 (85) av	170
L_45 (65) av	3063
L_45 (75) av	2196
L_45 (85) av	108

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

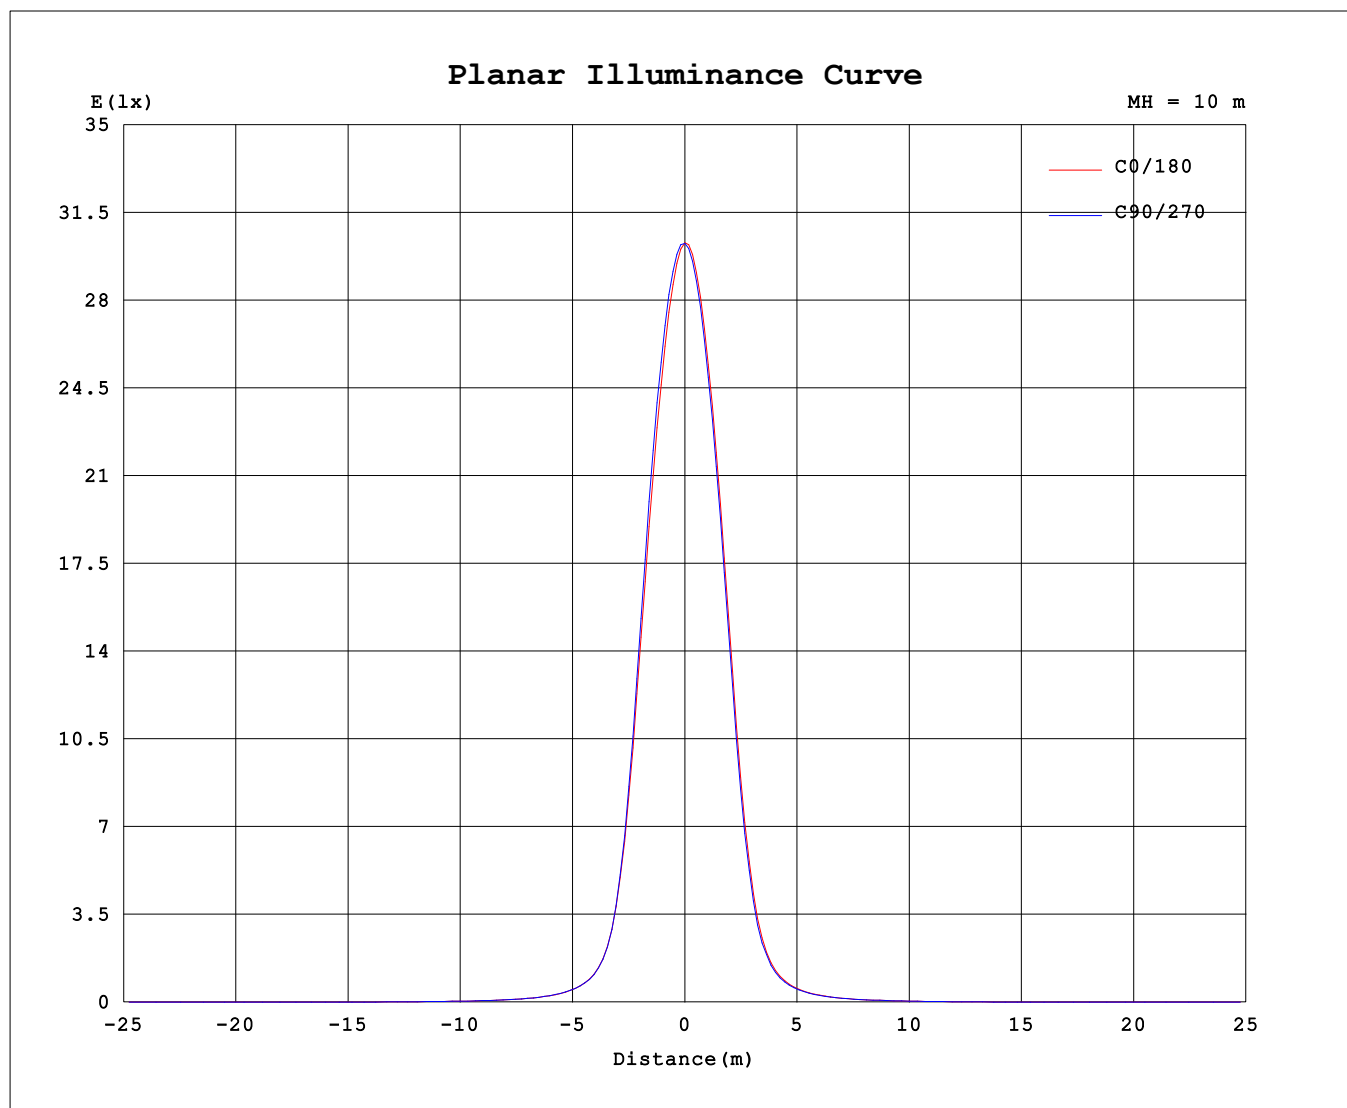

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-12-20

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	3028	3028	3028	3028	3028	3028	3028	3028
3.0	2873	2893	2929	2946	2922	2904	2891	2870
6.0	2503	2528	2596	2619	2584	2551	2535	2500
9.0	1968	1995	2072	2101	2064	2018	2007	1967
12.0	1314	1321	1379	1421	1408	1361	1349	1311
15.0	713.5	696.4	738.3	783.9	794.7	759.1	748.0	717.4
18.0	337.5	318.7	338.3	373.4	388.6	369.2	359.0	342.2
21.0	170.0	159.3	168.2	187.4	194.4	183.7	180.8	173.9
24.0	101.2	96.23	100.6	110.1	112.6	107.2	106.5	103.5
27.0	67.05	64.53	67.54	72.02	72.58	70.35	69.54	68.83
30.0	46.93	45.26	47.23	50.00	50.30	48.69	48.21	48.20
33.0	34.13	32.76	34.20	35.76	36.42	35.04	35.16	34.98
36.0	25.74	24.86	25.91	26.50	27.34	26.36	26.87	26.18
39.0	19.99	19.65	20.27	20.56	21.15	20.67	21.17	20.36
42.0	15.81	15.63	15.97	16.29	16.63	16.56	16.89	16.19
45.0	12.60	12.50	12.66	12.94	13.15	13.37	13.51	12.98
48.0	9.944	9.869	10.01	10.22	10.36	10.69	10.70	10.25
51.0	7.568	7.550	7.662	7.830	7.924	8.258	8.208	7.799
54.0	5.481	5.478	5.608	5.725	5.770	6.014	6.037	5.664
57.0	3.695	3.696	3.840	3.940	3.913	4.077	4.161	3.838
60.0	2.469	2.468	2.609	2.681	2.626	2.687	2.771	2.561
63.0	1.852	1.843	1.981	2.077	2.028	2.017	2.060	1.915
66.0	1.466	1.464	1.574	1.661	1.614	1.587	1.613	1.522
69.0	1.170	1.170	1.258	1.321	1.295	1.265	1.267	1.208
72.0	0.9109	0.9115	0.9881	1.044	1.021	0.9951	0.9793	0.9453
75.0	0.6765	0.6803	0.7509	0.8054	0.7768	0.7544	0.7413	0.7157
78.0	0.4998	0.4924	0.5290	0.6023	0.5799	0.5509	0.5115	0.5349
81.0	0.3417	0.2978	0.2923	0.3849	0.4079	0.3294	0.2858	0.3326
84.0	0.1903	0.0810	0.0220	0.1425	0.2312	0.0904	0.0202	0.0980
87.0	0.0251	0.0087	0.0209	0.0096	0.0193	0.0064	0.0177	0.0080
90.0	0.0161	0.0071	0.0202	0.0106	0.0112	0.0074	0.0135	0.0058

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-12-20

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks: