


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948 Lamp Flux:338.868x1 lm		
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 60.98 lm/W
MODEL		Imax (cd)	1394	S/MH(C0/180)	0.44	
NOMINAL POWER(W)	6	LOR(%)	100.0	S/MH(C90/270)	0.39	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	338.87	η UP,DN(C0-180)	0.0,53.7	
NOMINAL FLUX(lm)	338.868	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,46.3	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	240.2	η down (%)	100.0	CIBSE SHR MAX	0.30	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

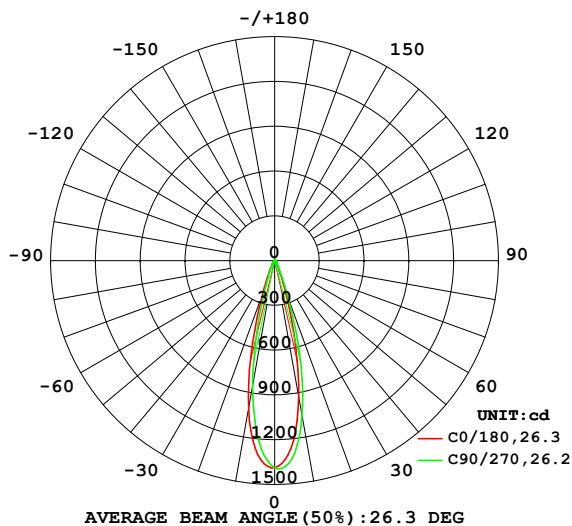

PLANAR ISOLUX DIAGRAM(UNIT:lx)

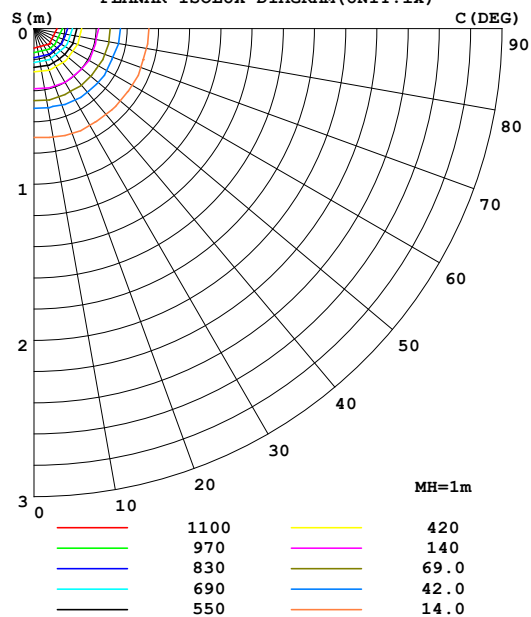

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	930.1	990.6	1061	1077	1011	906.4	852.5	844.1	0- 10	111.7	111.7	33,33
20	194.3	234.0	274.8	270.0	233.1	185.7	162.1	155.6	10- 20	143.9	255.6	75.4,75.4
30	39.88	46.85	50.60	47.63	44.58	40.46	37.34	34.83	20- 30	44.07	299.7	88.4,88.4
40	18.37	19.76	20.26	19.20	18.97	18.19	17.58	17.36	30- 40	17.03	316.7	93.5,93.5
50	9.593	10.61	11.38	10.98	10.52	9.712	9.213	9.244	40- 50	10.97	327.7	96.7,96.7
60	4.137	4.590	4.977	4.888	4.732	4.197	3.956	4.078	50- 60	6.172	333.8	98.5,98.5
70	1.948	2.126	2.320	2.277	2.244	1.969	1.889	1.989	60- 70	3.057	336.9	99.4,99.4
80	0.8699	0.9856	1.124	1.081	1.063	0.9084	0.8628	0.8788	70- 80	1.568	338.5	99.9,99.9
90	0.0099	0.0013	0.0093	0.0006	0.0054	0.0026	0.0087	0.0042	80- 90	0.4134	338.9	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 322.75 lm

%lum = 95.2%

%lamp = 95.2%

Conical surface Flux(120deg): 333.83 lm

%lum = 98.5%


%lamp = 98.5%

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2024-03-16

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948 Lamp Flux:338.868x1 lm		
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:

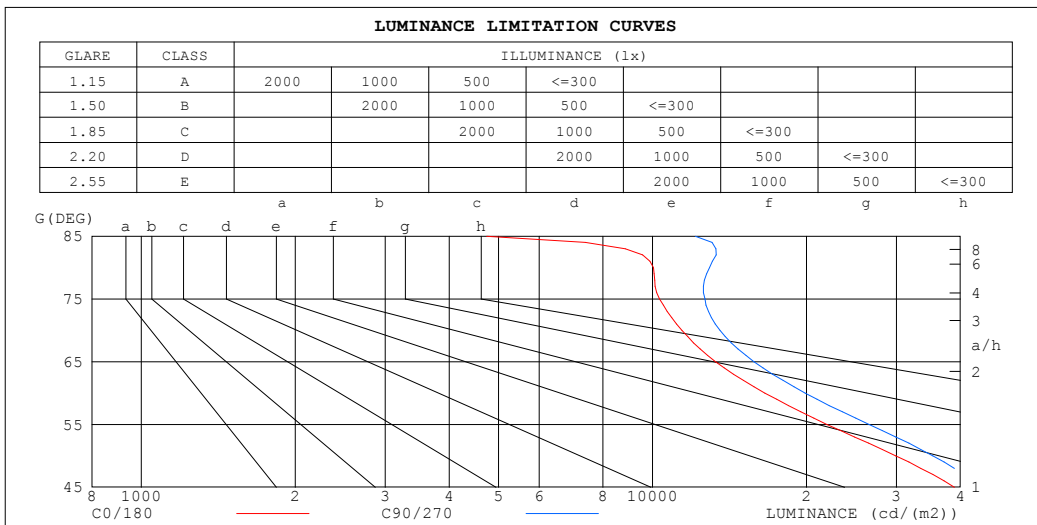

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	4735	12133
80	10042	12931
75	10324	12663
70	11416	13549
65	13291	15786
60	16586	19881
55	21954	26530
50	29917	35357
45	38957	43825


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-03-16

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948		
Lamp Flux:338.868x1 lm		
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00														
1.0	1.12	1.10	1.08	1.10	1.08	1.07	1.06	1.05	1.03	1.02	1.01	1.00	.99	.98	.97	.96														
2.0	1.06	1.03	1.00	1.05	1.02	.99	1.01	.99	.97	.99	.97	.95	.96	.94	.93	.91														
3.0	1.01	.97	.94	.90	.96	.93	.97	.94	.92	.95	.93	.90	.93	.91	.89	.88														
4.0	.97	.92	.89	.96	.92	.89	.94	.90	.88	.92	.89	.87	.90	.88	.86	.84														
5.0	.93	.88	.85	.92	.88	.85	.90	.87	.84	.89	.86	.83	.87	.85	.82	.81														
6.0	.89	.85	.81	.89	.84	.81	.87	.83	.81	.86	.83	.80	.85	.82	.80	.79														
7.0	.86	.82	.78	.85	.81	.78	.84	.81	.78	.83	.80	.77	.82	.79	.77	.76														
8.0	.83	.79	.76	.83	.78	.76	.82	.78	.75	.81	.77	.75	.80	.77	.75	.74														
9.0	.81	.76	.73	.80	.76	.73	.79	.76	.73	.79	.75	.73	.78	.75	.72	.71														
10.0	.78	.74	.71	.78	.74	.71	.77	.73	.71	.76	.73	.71	.76	.73	.70	.69														

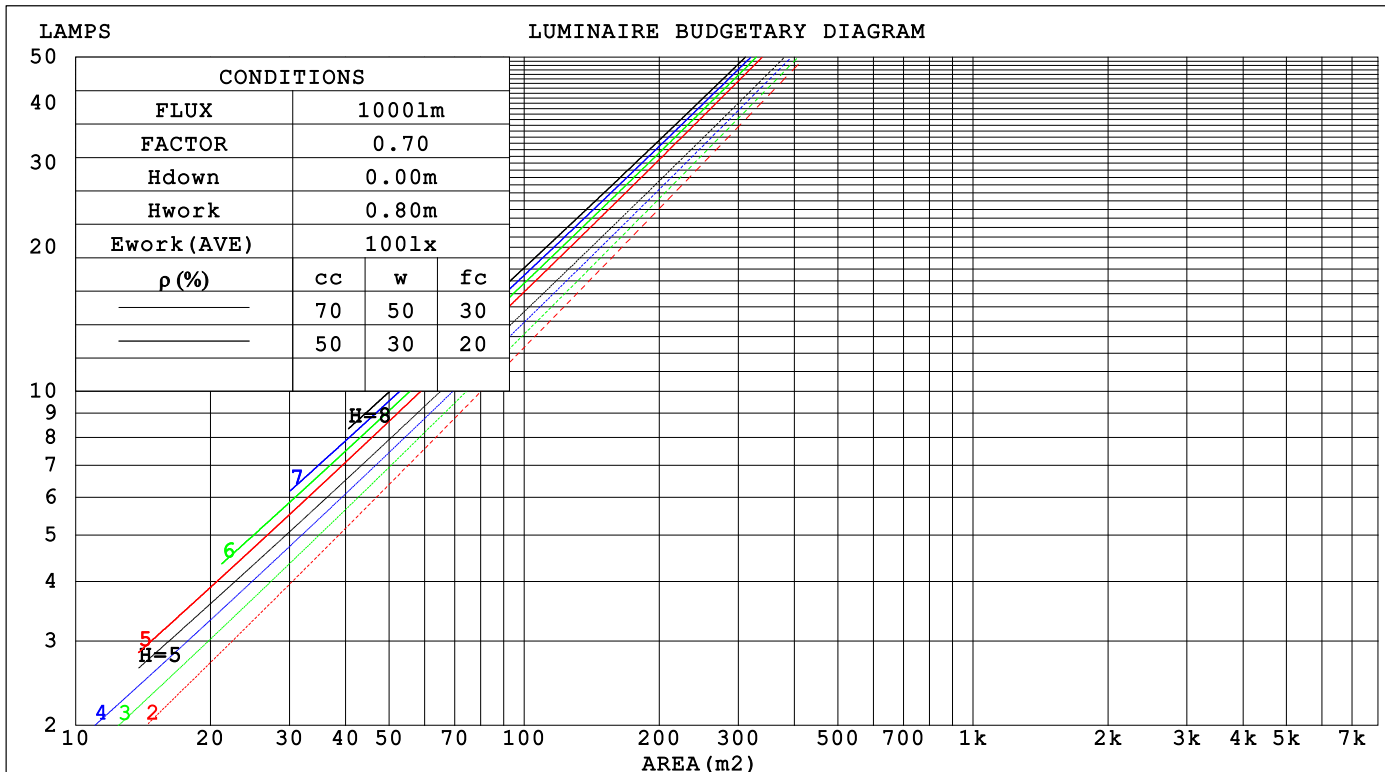

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDI:0.17% ITHDI:24.58% KDisp:0.8948		Lamp Flux:338.868x1 lm
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.150	.085	.027	.143	.082	.026	.131	.075	.024	.119	.069	.022	.109	.063	.020		
2.0	.139	.076	.023	.134	.074	.023	.124	.069	.021	.114	.064	.020	.105	.060	.019		
3.0	.130	.069	.021	.126	.067	.020	.117	.063	.019	.109	.060	.018	.101	.056	.017		
4.0	.122	.063	.019	.118	.062	.018	.111	.059	.018	.104	.056	.017	.097	.053	.016		
5.0	.115	.058	.017	.111	.057	.017	.105	.055	.016	.099	.052	.016	.094	.050	.015		
6.0	.108	.054	.016	.105	.053	.015	.100	.051	.015	.095	.049	.014	.090	.047	.014		
7.0	.102	.051	.014	.100	.050	.014	.095	.048	.014	.091	.046	.014	.087	.045	.013		
8.0	.097	.048	.013	.095	.047	.013	.091	.045	.013	.087	.044	.013	.083	.043	.012		
9.0	.093	.045	.013	.091	.044	.012	.087	.043	.012	.084	.042	.012	.080	.041	.012		
10.0	.089	.042	.012	.087	.042	.012	.084	.041	.012	.080	.040	.011	.078	.039	.011		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.169	.158	.147	.145	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.016		
2.0	.152	.133	.116	.130	.114	.101	.089	.079	.070	.051	.046	.041	.016	.015	.013		
3.0	.138	.113	.094	.118	.098	.082	.081	.068	.057	.047	.040	.034	.015	.013	.011		
4.0	.125	.098	.077	.108	.085	.067	.074	.059	.047	.043	.035	.028	.014	.011	.009		
5.0	.115	.086	.064	.099	.074	.056	.068	.052	.040	.039	.031	.023	.013	.010	.008		
6.0	.106	.076	.054	.092	.066	.047	.063	.046	.033	.037	.027	.020	.012	.009	.007		
7.0	.099	.068	.046	.085	.059	.040	.059	.041	.029	.034	.024	.017	.011	.008	.006		
8.0	.092	.061	.040	.080	.053	.035	.055	.037	.025	.032	.022	.015	.010	.007	.005		
9.0	.087	.056	.035	.075	.048	.030	.052	.034	.022	.030	.020	.013	.010	.007	.004		
10.0	.082	.051	.031	.071	.044	.027	.049	.031	.019	.029	.018	.011	.009	.006	.004		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz UTHDi:0.17% ITHDi:24.58% KDisp:0.8948Lamp Flux:338.868x1 lm											
NAME: MD10-06-XX-16 3000K RA90 18D						TYPE:		WEIGHT:			
SPEC.:						DIM.:		SERIAL No.:			
MFR.: Norming Lighting						SUR.: 26mm		Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
x = 2H y = 2H	2H	17.4	18.2	17.6	18.3	18.5	18.1	18.8	18.3	18.9	19.1
	3H	17.8	18.5	18.0	18.7	18.8	18.5	19.1	18.7	19.3	19.5
	4H	17.9	18.6	18.2	18.8	19.0	18.6	19.3	18.9	19.5	19.7
	6H	18.1	18.7	18.4	18.9	19.2	18.8	19.4	19.1	19.6	19.9
	8H	18.1	18.7	18.4	19.0	19.2	18.9	19.5	19.2	19.7	20.0
	12H	18.1	18.7	18.4	18.9	19.2	19.0	19.5	19.3	19.8	20.0
4H	2H	17.6	18.2	17.9	18.5	18.7	18.2	18.8	18.4	19.0	19.2
	3H	18.1	18.7	18.4	18.9	19.2	18.7	19.2	19.0	19.5	19.8
	4H	18.3	18.8	18.7	19.1	19.4	18.9	19.5	19.3	19.8	20.1
	6H	18.5	19.0	18.9	19.3	19.7	19.2	19.7	19.6	20.0	20.4
	8H	18.6	19.1	19.0	19.4	19.8	19.4	19.8	19.8	20.1	20.5
	12H	18.6	19.0	19.0	19.4	19.8	19.5	19.8	19.9	20.2	20.6
8H	4H	18.4	18.8	18.8	19.2	19.5	19.0	19.4	19.4	19.7	20.1
	6H	18.7	19.1	19.1	19.5	19.9	19.4	19.7	19.8	20.1	20.5
	8H	18.9	19.2	19.3	19.6	20.0	19.6	19.9	20.0	20.3	20.7
	12H	18.9	19.2	19.4	19.6	20.1	19.7	20.0	20.2	20.4	20.9
12H	4H	18.4	18.8	18.8	19.1	19.5	18.9	19.3	19.4	19.7	20.1
	6H	18.7	19.0	19.2	19.5	19.9	19.4	19.7	19.8	20.1	20.5
	8H	18.9	19.2	19.4	19.6	20.1	19.6	19.9	20.1	20.3	20.8
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H	+ 0.8 / - 1.1					+ 0.7 / - 0.9					
1.5H	+ 0.7 / - 0.7					+ 0.7 / - 0.7					
2.0H	+ 1.8 / - 1.4					+ 1.7 / - 1.4					

CIE Pub.117, 338.9 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -3.8)
Area: 0.0005 m2

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948 Lamp Flux:338.868x1 lm		
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	81	77	87	81	77	86	81	77	74
0.80	95	89	85	94	89	85	93	88	85	81
1.00	99	94	90	98	93	90	97	93	89	85
1.25	103	98	94	102	97	94	100	96	93	89
1.50	106	101	98	105	100	97	102	99	96	92
2.00	108	104	101	107	103	100	104	101	99	94
2.50	110	106	103	109	105	102	105	103	101	95
3.00	112	108	106	110	107	104	107	104	102	96
4.00	114	111	109	112	109	107	108	106	105	98
5.00	115	113	111	113	111	109	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948 Lamp Flux:338.868x1 lm		
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:

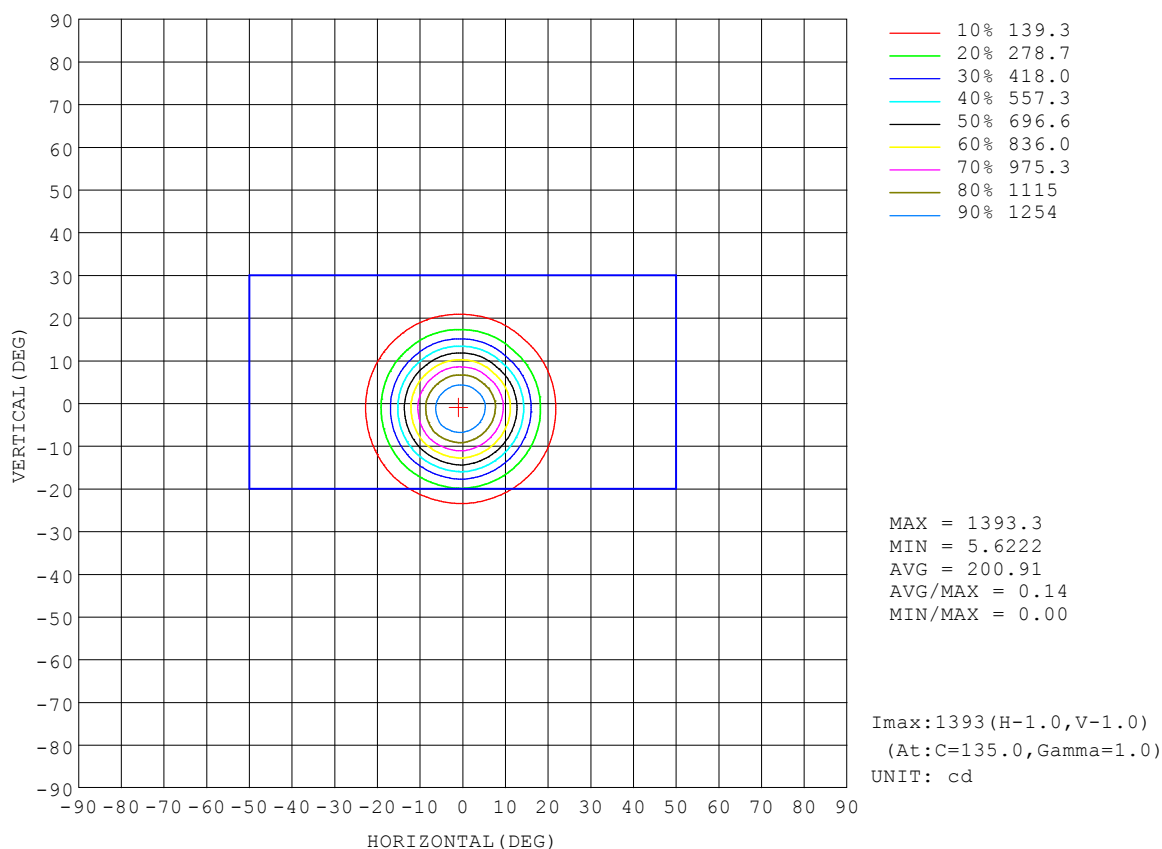


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948		Lamp Flux:338.868x1 lm
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:

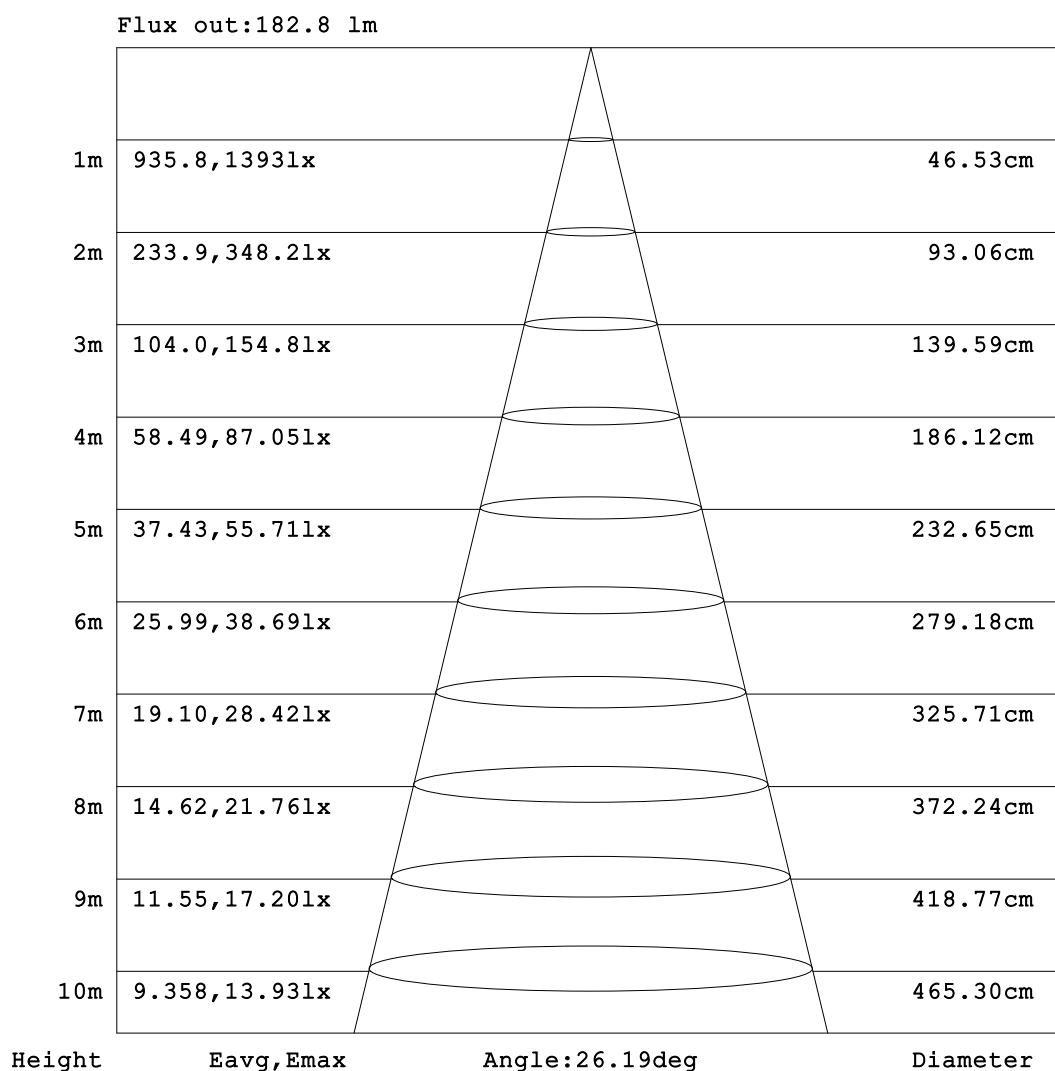


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948 Lamp Flux:338.868x1 lm		
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:

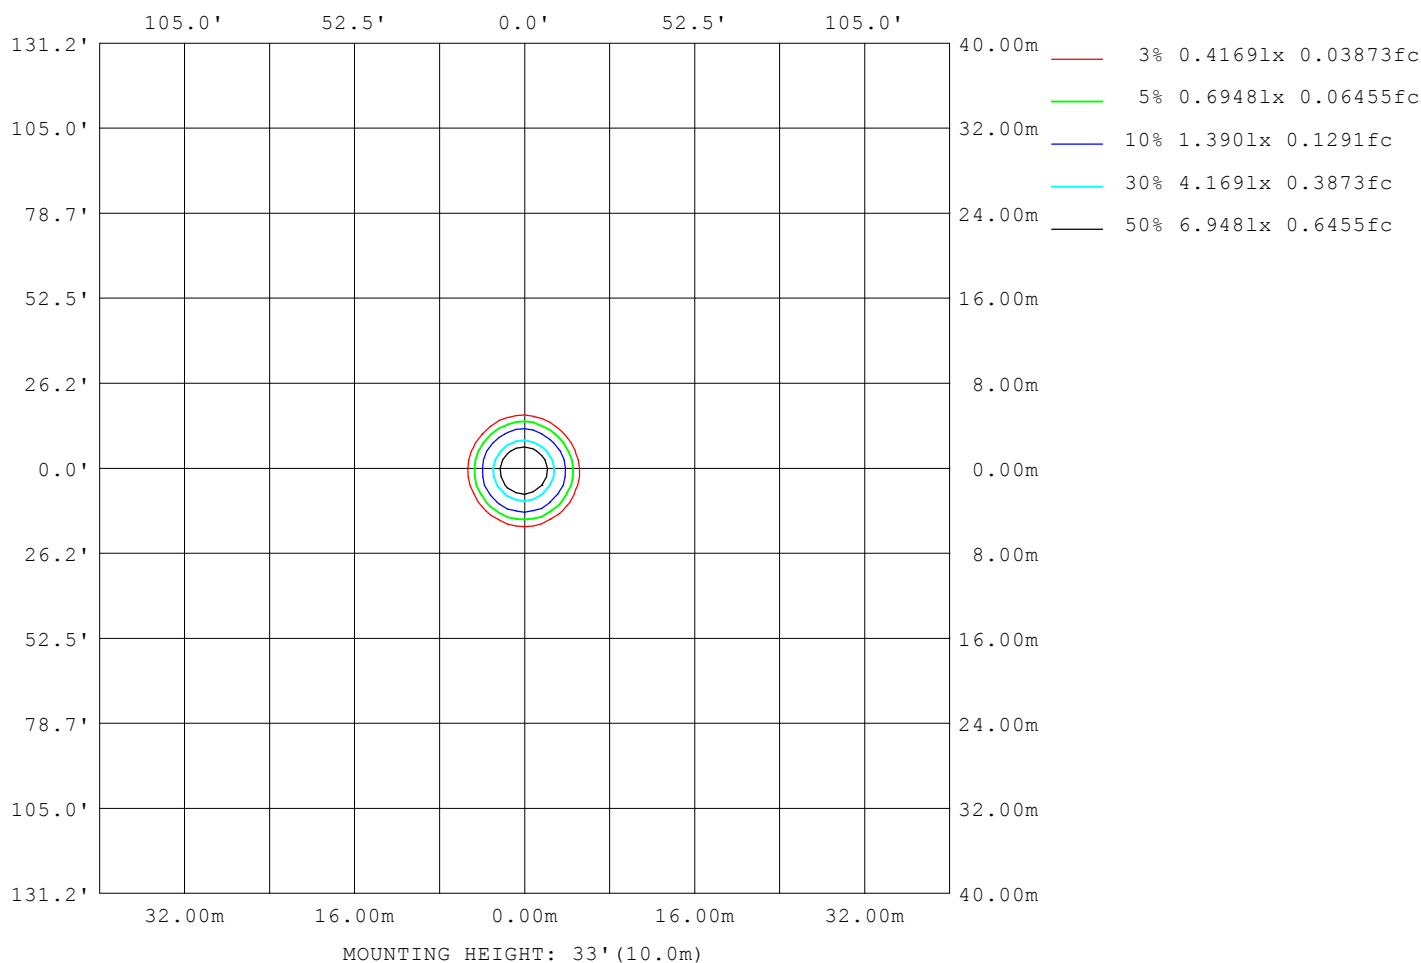

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2024-03-16

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

LED Avg.L Report

Test:U:240.3V I:0.0266A P:5.6W PF:0.8680 Freq:49.99Hz		
UTHDi:0.17% ITHDi:24.58% KDisp:0.8948 Lamp Flux:338.868x1 lm		
NAME: MD10-06-XX-16 3000K RA90 18D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 26mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	14224
L_0~180 (75) av	11280
L_0~180 (85) av	7417
L_90~270 (65) av	14260
L_90~270 (75) av	11459
L_90~270 (85) av	7449
L_45 (65) av	14214
L_45 (75) av	11221
L_45 (85) av	7002

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

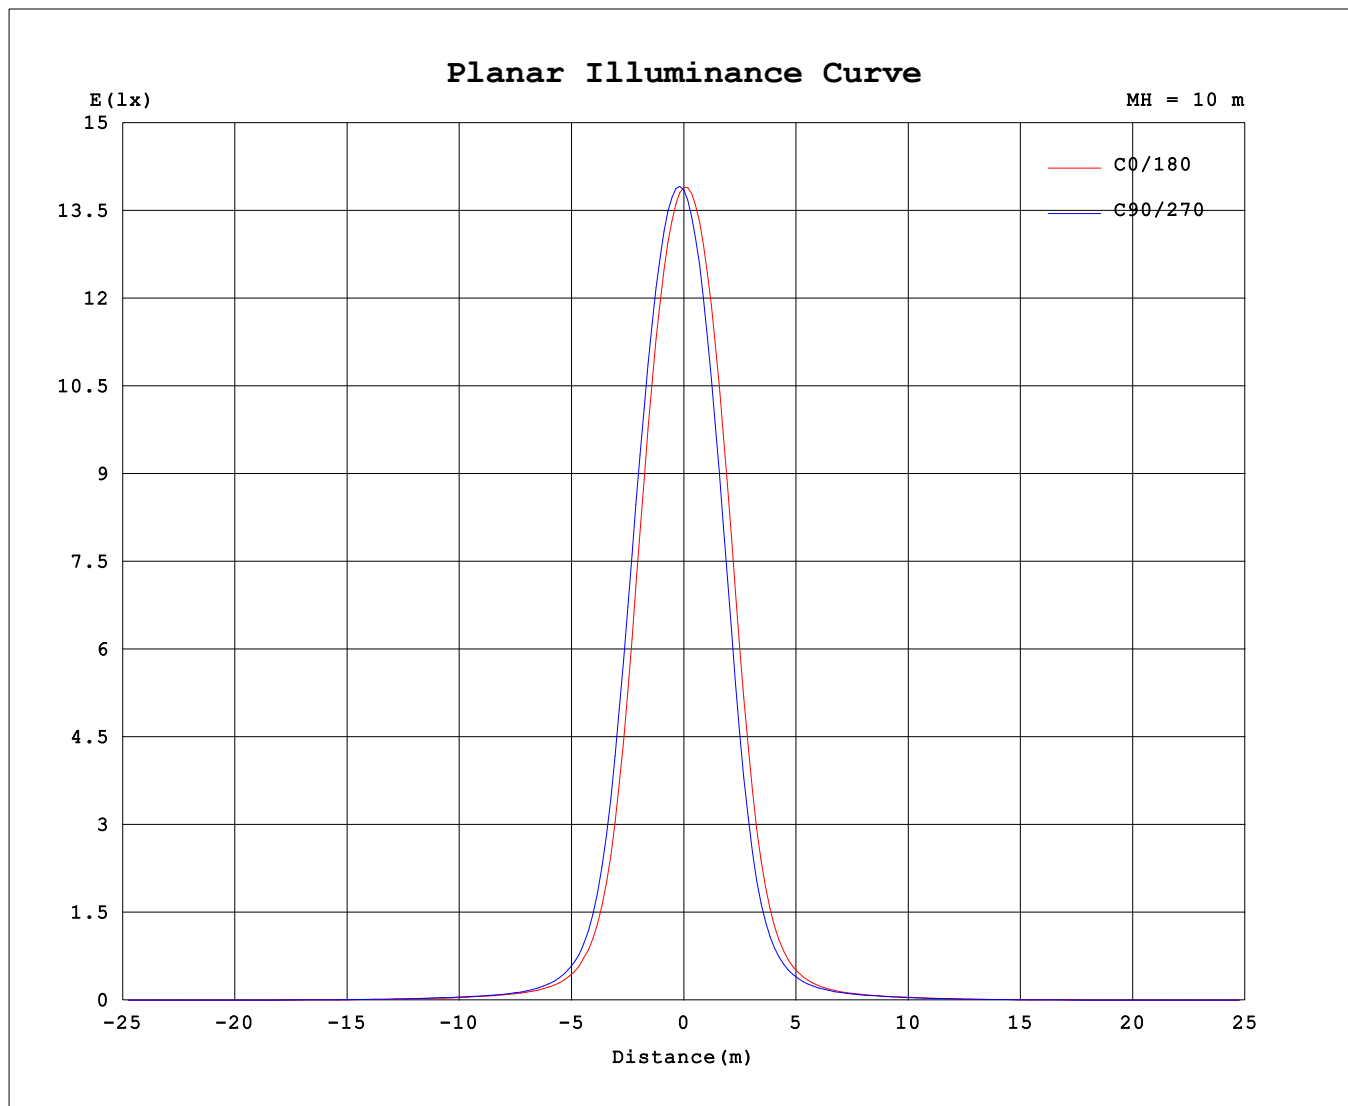

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: MEDIUM
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2024-03-16

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	1386	1386	1386	1386	1386	1386	1386	1386
3.0	1335	1361	1380	1384	1362	1331	1311	1311
6.0	1211	1253	1293	1307	1262	1196	1155	1158
9.0	1012	1067	1130	1148	1086	988.2	936.1	931.6
12.0	755.4	823.9	907.3	914.9	842.4	730.9	675.3	661.0
15.0	492.5	562.3	648.1	642.6	572.1	472.6	422.6	409.6
18.0	287.1	340.9	401.8	394.1	342.0	273.5	239.2	231.0
21.0	160.0	194.0	225.5	222.6	192.4	153.7	134.4	128.6
24.0	94.55	112.0	126.5	124.9	110.2	92.88	80.90	76.65
27.0	58.36	69.66	76.98	74.27	67.32	58.76	53.11	49.54
30.0	39.88	46.85	50.60	47.63	44.58	40.46	37.34	34.83
33.0	29.53	33.68	35.59	33.13	31.90	29.76	28.00	26.53
36.0	23.40	25.87	26.83	25.00	24.53	23.34	22.32	21.60
39.0	19.41	20.95	21.52	20.24	20.07	19.21	18.56	18.25
42.0	16.47	17.65	18.16	17.28	17.08	16.33	15.78	15.67
45.0	13.74	14.88	15.51	14.87	14.56	13.80	13.22	13.24
48.0	11.18	12.29	13.05	12.54	12.09	11.29	10.77	10.77
51.0	8.839	9.806	10.55	10.21	9.766	8.961	8.494	8.517
54.0	6.849	7.636	8.287	8.038	7.703	6.975	6.588	6.632
57.0	5.297	5.895	6.406	6.257	6.032	5.396	5.078	5.180
60.0	4.137	4.590	4.977	4.888	4.732	4.197	3.956	4.078
63.0	3.263	3.595	3.905	3.850	3.740	3.292	3.121	3.246
66.0	2.600	2.852	3.100	3.060	2.980	2.621	2.500	2.620
69.0	2.093	2.287	2.489	2.452	2.403	2.113	2.023	2.131
72.0	1.680	1.845	2.017	1.973	1.958	1.708	1.643	1.728
75.0	1.333	1.481	1.641	1.587	1.586	1.368	1.325	1.373
78.0	1.048	1.170	1.314	1.268	1.256	1.090	1.053	1.077
81.0	0.7709	0.8894	1.025	0.9818	0.9630	0.8059	0.7494	0.7584
84.0	0.3853	0.5451	0.6838	0.6332	0.5943	0.3962	0.2776	0.2802
87.0	0.0122	0.0910	0.2031	0.1621	0.1115	0.0133	0.0106	0.0062
90.0	0.0099	0.0013	0.0093	0.0006	0.0054	0.0026	0.0087	0.0042

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: MEDIUM
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-03-16

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks: