


## LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419 Lamp Flux:793.483x1 lm		
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 85.55 lm/W
MODEL		Imax (cd)	1058	S/MH(C0/180)	0.77	
NOMINAL POWER(W)	9	LOR(%)	100.0	S/MH(C90/270)	0.80	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	793.48	$\eta$ UP,DN(C0-180)	0.0,49.7	
NOMINAL FLUX(lm)	793.483	CIE CLASS	DIRECT	$\eta$ UP,DN(C180-360)	0.0,50.3	
LAMPS INSIDE	1	$\eta$ up (%)	0.0	CIBSE SHR NOM	0.75	
TEST VOLTAGE(V)	240.19	$\eta$ down (%)	100.0	CIBSE SHR MAX	0.80	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

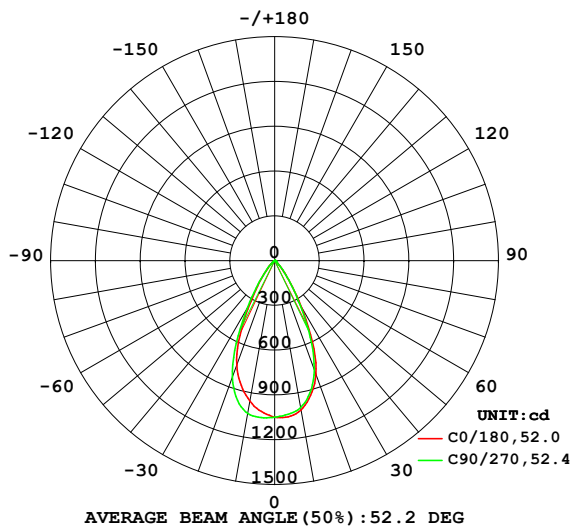

PLANAR ISOLUX DIAGRAM(UNIT:lx)

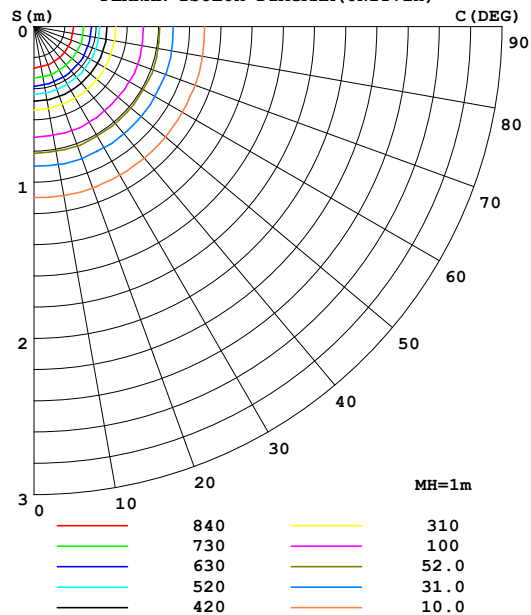

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ZONAL FLUX DIAGRAM

## ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	1016	1006	1001	964.7	956.4	990.6	1040	1035	0- 10	98.00	98.00	12.4,12.4
20	810.3	788.3	777.5	743.4	744.1	771.0	829.8	827.0	10- 20	254.7	352.7	44.5,44.5
30	357.6	350.7	340.6	334.1	332.4	347.4	367.4	365.1	20- 30	260.1	612.8	77.2,77.2
40	95.99	96.29	94.91	95.08	93.15	96.04	99.18	97.37	30- 40	122.2	735.0	92.6,92.6
50	22.97	23.30	22.67	22.83	22.42	22.66	23.06	22.78	40- 50	38.81	773.8	97.5,97.5
60	8.104	8.114	8.196	8.285	8.218	8.270	8.266	8.176	50- 60	12.38	786.2	99.1,99.1
70	3.026	3.055	3.151	3.167	3.180	3.225	3.217	3.074	60- 70	5.231	791.4	99.7,99.7
80	0.6577	0.6588	0.6292	0.7231	0.7635	0.7135	0.6040	0.6298	70- 80	1.887	793.3	100,100
90	0.0253	0.0231	0.0289	0.0212	0.0212	0.0193	0.0264	0.0225	80- 90	0.1790	793.5	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 760.33 lm

%lum = 95.8%

%lamp = 95.8%

Conical surface Flux(120deg): 786.19 lm

%lum = 99.1%


%lamp = 99.1%

C Range: 0 - 360DEG  
 C Interval: 45.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:DAMIN  
 Test Date:2023-12-21

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
 Humidity:65.0%  
 Test Distance:3.090m [K=1.0000]  
 Remarks:

## LUMINANCE LIMITATION CURVES

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419 Lamp Flux:793.483x1 lm		
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

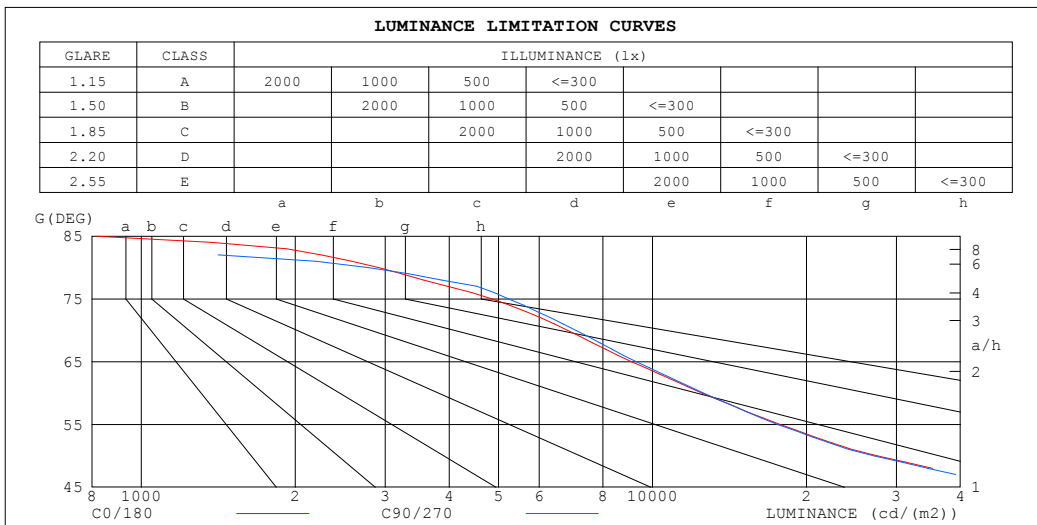


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2023-12-21

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419		Lamp Flux:793.483x1 lm
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

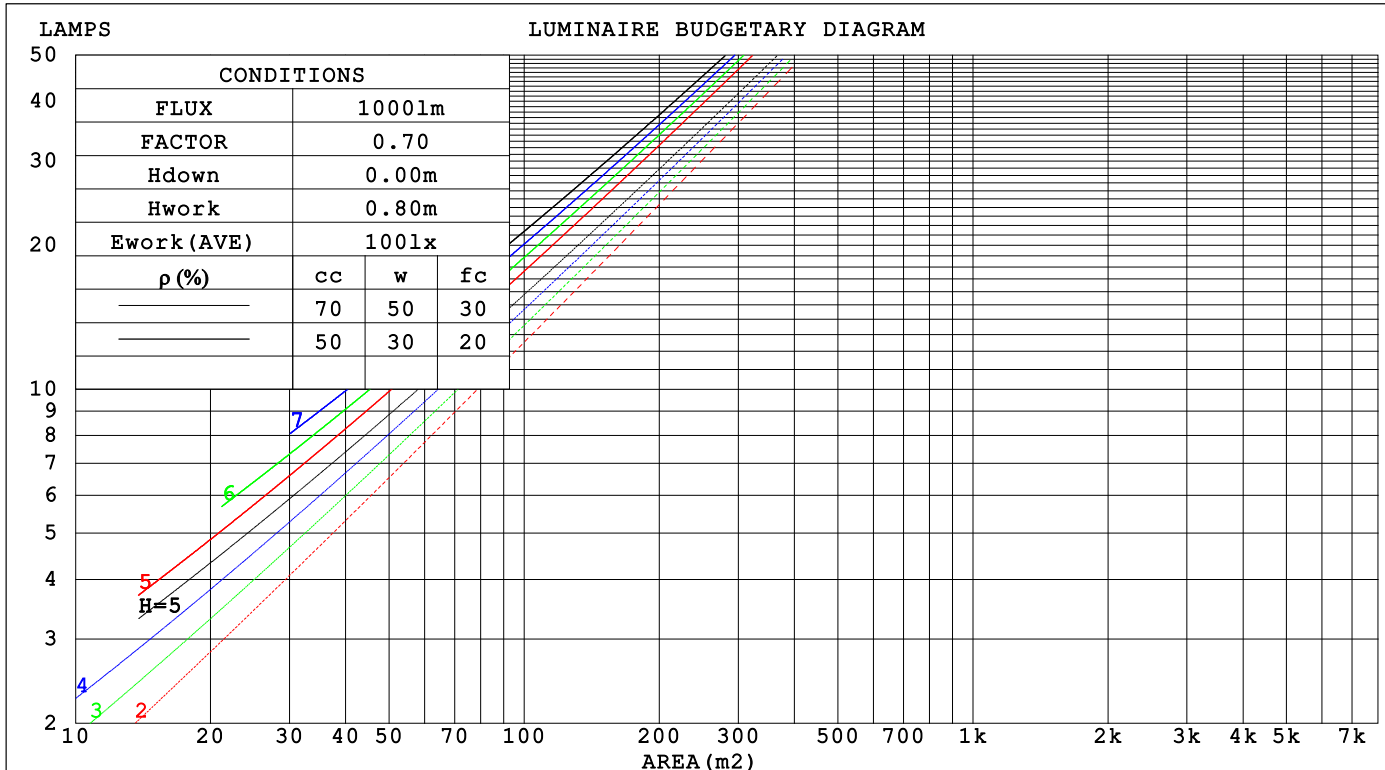

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### WEC AND CCEC

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz			UTHDi:0.18% ITHDi:17.97% KDisp:0.9419			Lamp Flux:793.483x1 lm		
NAME: MD10-09-XX-04 3000K RA90 50D			TYPE:			WEIGHT:		
SPEC.:			DIM.:			SERIAL No.:		
MFR.: Norming Lighting			SUR.: 41mm			Shielding Angle:		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.174	.099	.031	.167	.095	.030	.155	.089	.028	.143	.082	.026	.132	.077	.025		
2.0	.166	.091	.028	.160	.088	.027	.150	.083	.026	.140	.079	.025	.131	.074	.023		
3.0	.158	.084	.025	.153	.082	.025	.144	.078	.024	.136	.074	.023	.128	.071	.022		
4.0	.150	.078	.023	.146	.076	.023	.138	.073	.022	.131	.070	.021	.124	.068	.021		
5.0	.143	.073	.021	.139	.071	.021	.132	.069	.020	.126	.067	.020	.120	.064	.019		
6.0	.136	.068	.020	.133	.067	.019	.127	.065	.019	.122	.063	.019	.116	.061	.018		
7.0	.130	.064	.018	.127	.063	.018	.122	.062	.018	.117	.060	.017	.113	.058	.017		
8.0	.124	.061	.017	.122	.060	.017	.117	.059	.017	.113	.057	.016	.109	.056	.016		
9.0	.119	.058	.016	.117	.057	.016	.113	.056	.016	.109	.055	.016	.105	.053	.015		
10.0	.114	.055	.015	.112	.054	.015	.109	.053	.015	.105	.052	.015	.102	.051	.015		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.171	.157	.145	.146	.135	.125	.100	.093	.086	.058	.054	.050	.018	.017	.016		
2.0	.155	.133	.113	.133	.114	.098	.091	.079	.068	.053	.046	.040	.017	.015	.013		
3.0	.143	.114	.090	.122	.098	.078	.084	.068	.055	.049	.040	.032	.016	.013	.011		
4.0	.132	.099	.073	.114	.085	.063	.078	.059	.045	.045	.035	.026	.015	.011	.009		
5.0	.124	.087	.060	.106	.075	.052	.073	.053	.037	.042	.031	.022	.014	.010	.007		
6.0	.116	.078	.050	.100	.067	.044	.069	.047	.031	.040	.028	.018	.013	.009	.006		
7.0	.109	.070	.043	.094	.061	.037	.065	.043	.026	.038	.025	.016	.012	.008	.005		
8.0	.104	.064	.037	.089	.055	.032	.062	.039	.023	.036	.023	.013	.012	.008	.004		
9.0	.099	.059	.032	.085	.051	.028	.059	.036	.020	.034	.021	.012	.011	.007	.004		
10.0	.094	.054	.028	.081	.047	.024	.056	.033	.017	.033	.020	.010	.011	.006	.003		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### UGR(Unified Glare Rating) Table

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz UTHDi:0.18% ITHDi:17.97% KDisp:0.9419Lamp Flux:793.483x1 lm										
NAME: MD10-09-XX-04 3000K RA90 50D						TYPE:		WEIGHT:		
SPEC.:						DIM.:		SERIAL No.:		
MFR.: Norming Lighting						SUR.: 41mm		Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	21.2	22.1	21.4	22.3	22.4	21.0	22.0	21.3	22.1	22.3
3H	21.1	21.9	21.3	22.1	22.3	21.0	21.8	21.2	22.0	22.2
4H	21.0	21.8	21.3	22.0	22.3	20.9	21.7	21.2	21.9	22.1
6H	21.0	21.7	21.2	21.9	22.2	20.8	21.6	21.1	21.8	22.1
8H	20.9	21.6	21.2	21.9	22.1	20.8	21.5	21.1	21.8	22.0
12H	20.9	21.6	21.2	21.8	22.1	20.7	21.4	21.1	21.7	22.0
4H 2H	21.0	21.8	21.3	22.0	22.2	20.9	21.7	21.1	21.9	22.1
3H	20.9	21.6	21.2	21.9	22.2	20.8	21.5	21.1	21.8	22.0
4H	20.9	21.5	21.2	21.8	22.1	20.7	21.4	21.1	21.7	22.0
6H	20.8	21.3	21.2	21.7	22.0	20.7	21.2	21.0	21.6	21.9
8H	20.7	21.2	21.1	21.6	22.0	20.6	21.1	21.0	21.5	21.8
12H	20.7	21.2	21.1	21.5	21.9	20.6	21.0	21.0	21.4	21.8
8H 4H	20.7	21.2	21.1	21.6	22.0	20.6	21.1	21.0	21.5	21.8
6H	20.7	21.1	21.1	21.5	21.9	20.5	21.0	21.0	21.4	21.8
8H	20.6	21.0	21.1	21.4	21.8	20.5	20.9	20.9	21.3	21.7
12H	20.6	20.9	21.0	21.3	21.8	20.4	20.8	20.9	21.2	21.7
12H 4H	20.7	21.2	21.1	21.5	21.9	20.6	21.0	21.0	21.4	21.8
6H	20.6	21.0	21.1	21.4	21.8	20.5	20.9	20.9	21.3	21.7
8H	20.6	20.9	21.0	21.3	21.8	20.4	20.8	20.9	21.2	21.7
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.8 / - 6.1					+ 2.8 / - 5.9				
1.5H	+ 4.7 / - 4.9					+ 4.6 / - 4.8				
2.0H	+ 4.7 / - 3.6					+ 4.5 / - 3.5				

CIE Pub.117, 793.5 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -0.8)  
Area: 0.0013 m2

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### UTILIZATION FACTORS TABLE

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419 Lamp Flux:793.483x1 lm		
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	80	77	86	80	77	86	80	76	73
0.80	94	89	85	94	88	85	93	88	84	81
1.00	99	93	90	98	93	89	97	93	89	85
1.25	103	98	94	102	97	94	100	96	93	89
1.50	106	101	98	105	100	97	102	99	96	92
2.00	108	104	101	107	103	100	104	101	99	94
2.50	110	106	103	109	105	102	105	103	101	95
3.00	112	108	106	110	107	104	107	104	102	96
4.00	114	111	109	112	109	107	108	106	105	98
5.00	115	113	111	113	111	109	109	107	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
 C Interval: 45.0DEG  
 Test Speed: HIGH  
 Temperature: 25.3DEG  
 Operators: DAMIN  
 Test Date: 2023-12-21

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
 Humidity: 65.0%  
 Test Distance: 3.090m [K=1.0000]  
 Remarks:

# ISOCANDELA DIAGRAM

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419 Lamp Flux:793.483x1 lm		
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

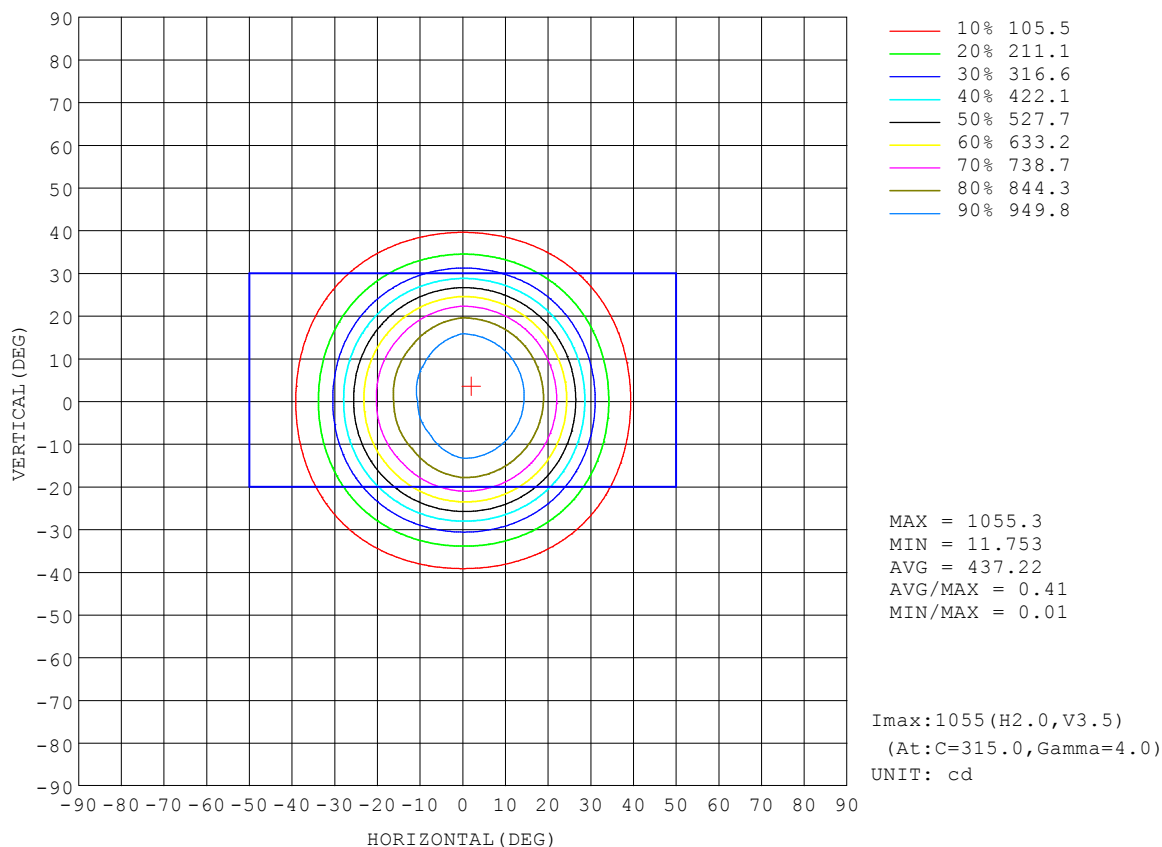


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:



AAI Figure

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419		Lamp Flux:793.483x1 lm
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

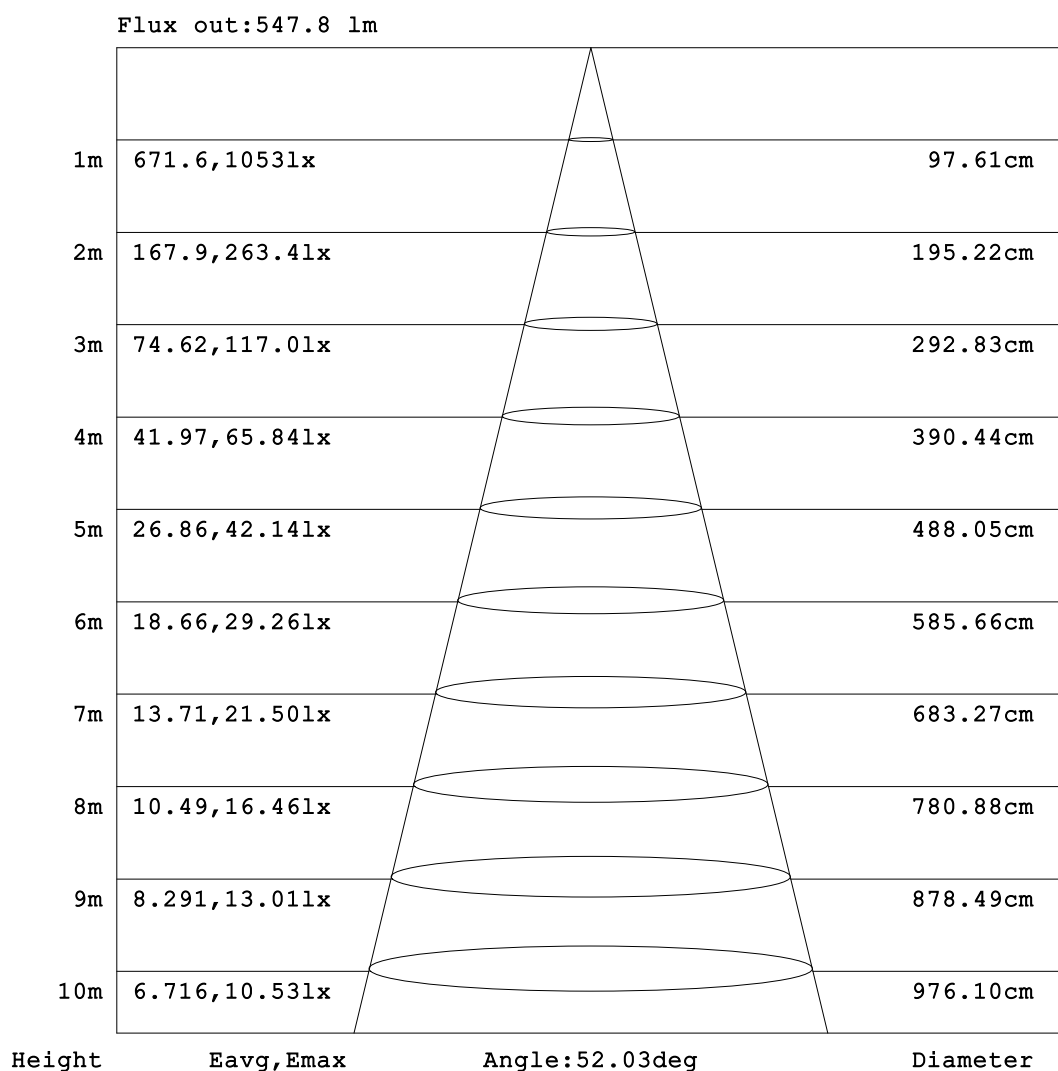


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

ISOLUX DIAGRAM

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419 Lamp Flux:793.483x1 lm		
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:

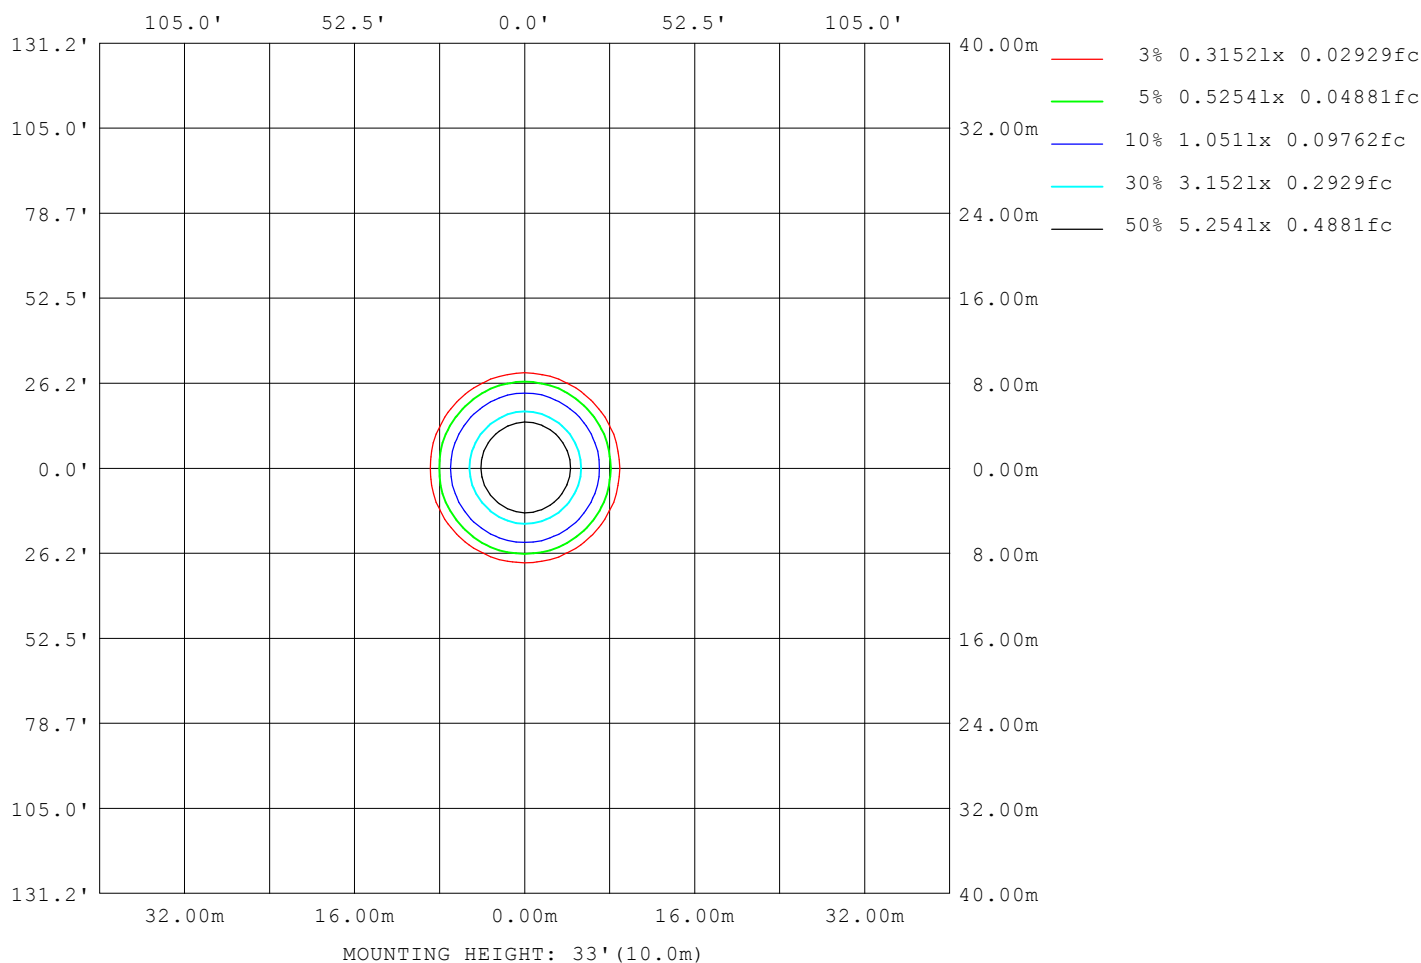

C Range: 0 - 360DEG  
 C Interval: 45.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:DAMIN  
 Test Date:2023-12-21

γ Range: 0 - 90DEG  
 γ Interval: 1.0DEG  
 Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
 Humidity:65.0%  
 Test Distance:3.090m [K=1.0000]  
 Remarks:

### LED Avg.L Report

Test:U:240.3V I:0.0417A P:9.3W PF:0.9264 Freq:49.99Hz		
UTHDi:0.18% ITHDi:17.97% KDisp:0.9419 Lamp Flux:793.483x1 lm		
NAME: MD10-09-XX-04 3000K RA90 50D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.: 41mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	9228
L_0~180 (75) av	5115
L_0~180 (85) av	919
L_90~270 (65) av	9391
L_90~270 (75) av	5314
L_90~270 (85) av	251
L_45 (65) av	9293
L_45 (75) av	5167
L_45 (85) av	185

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

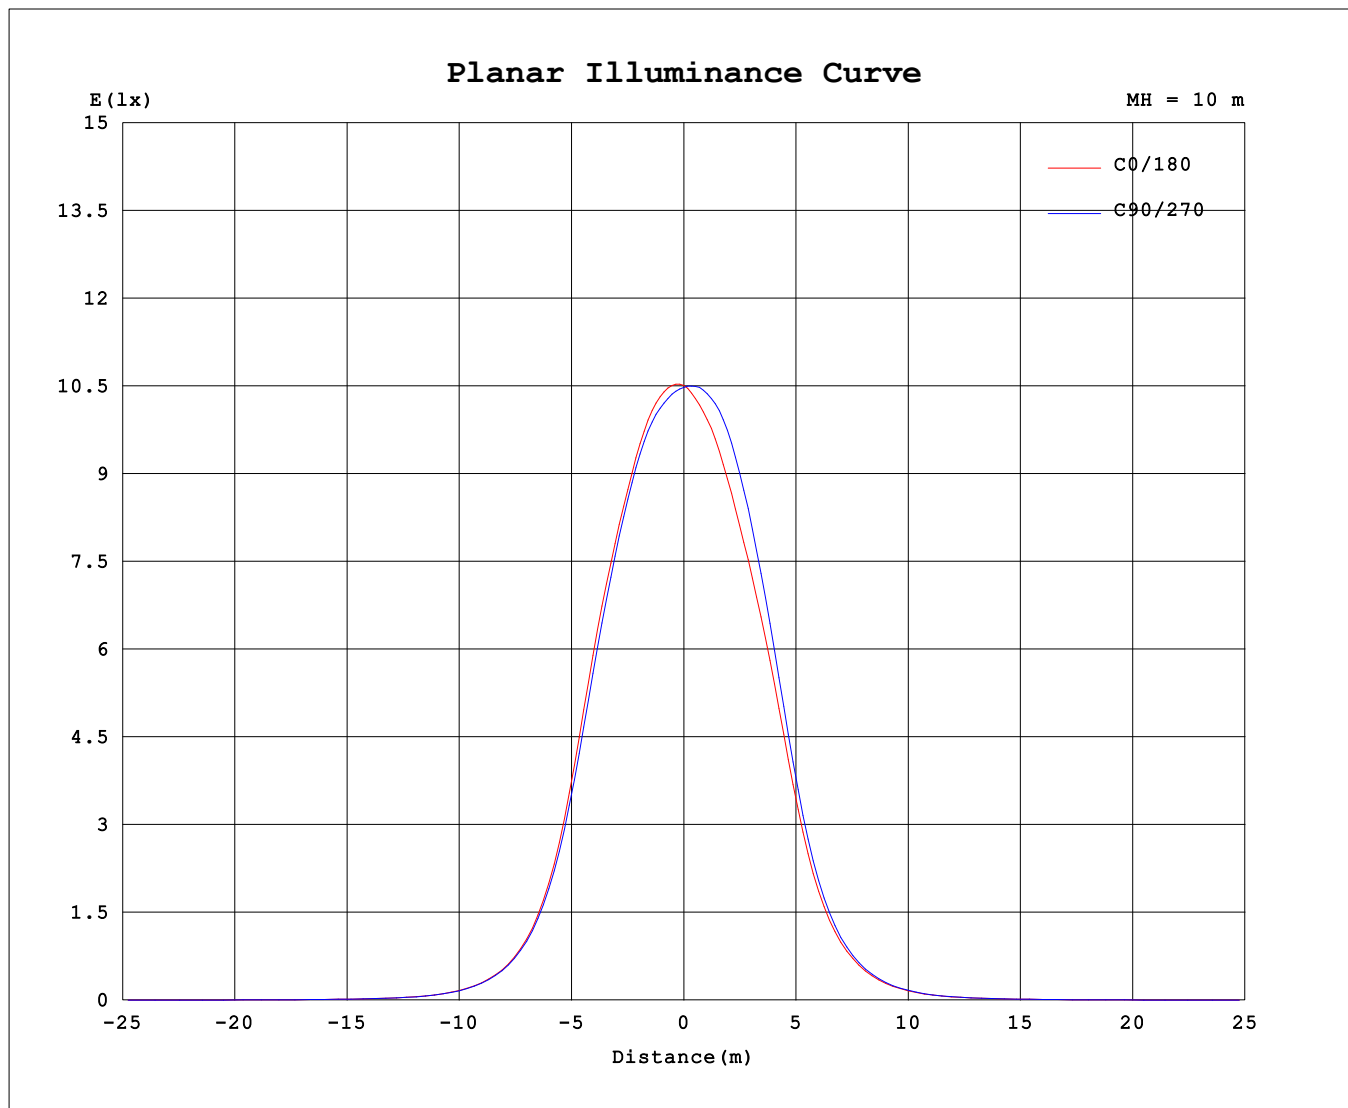

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2023-12-21

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

### Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	1048	1048	1048	1048	1048	1048	1048	1048
3.0	1053	1048	1041	1032	1030	1042	1054	1057
6.0	1047	1039	1029	1010	1007	1028	1054	1056
9.0	1027	1017	1011	978.4	971.5	1004	1047	1042
12.0	988.7	976.7	973.3	933.0	923.6	960.6	1019	1011
15.0	934.9	921.6	917.6	874.3	866.8	903.7	968.2	958.4
18.0	866.9	848.6	841.2	800.6	799.2	830.1	893.8	887.5
21.0	776.7	753.8	741.3	710.2	712.0	737.0	792.3	790.1
24.0	649.6	629.8	613.3	591.9	595.5	617.5	660.0	657.9
27.0	500.0	486.3	471.5	459.2	460.4	480.0	509.6	508.1
30.0	357.6	350.7	340.6	334.1	332.4	347.4	367.4	365.1
33.0	246.3	242.8	237.1	234.9	231.0	240.9	253.5	251.8
36.0	166.1	164.9	161.3	162.0	158.6	163.1	171.9	169.9
39.0	110.3	110.3	107.9	109.1	106.9	109.0	114.3	112.2
42.0	72.56	72.99	71.10	71.41	70.44	72.25	74.41	73.17
45.0	47.25	47.97	46.26	46.08	45.74	47.15	48.03	46.79
48.0	30.66	31.15	30.11	30.11	29.73	30.40	30.93	30.29
51.0	20.07	20.72	19.84	20.47	20.09	19.79	20.53	19.94
54.0	14.64	14.69	14.53	14.82	14.55	14.47	14.68	14.67
57.0	10.80	10.82	10.80	11.02	10.86	10.85	10.94	10.89
60.0	8.104	8.114	8.196	8.285	8.218	8.270	8.266	8.176
63.0	6.086	6.108	6.193	6.233	6.225	6.303	6.285	6.134
66.0	4.514	4.547	4.641	4.663	4.673	4.741	4.723	4.568
69.0	3.357	3.389	3.490	3.504	3.515	3.567	3.555	3.402
72.0	2.418	2.448	2.537	2.554	2.571	2.599	2.592	2.465
75.0	1.632	1.666	1.763	1.788	1.810	1.817	1.813	1.682
78.0	0.9625	0.9978	1.049	1.129	1.141	1.126	1.007	0.9873
81.0	0.5239	0.5028	0.4467	0.5447	0.6108	0.5470	0.4137	0.4692
84.0	0.1864	0.0746	0.0340	0.0815	0.2505	0.0741	0.0273	0.0530
87.0	0.0343	0.0215	0.0318	0.0177	0.0291	0.0206	0.0296	0.0171
90.0	0.0253	0.0231	0.0289	0.0212	0.0212	0.0193	0.0264	0.0225

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2023-12-21

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks: