


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 97.72 lm/W
MODEL		I _{max} (cd)	5134	S/MH(C0/180)	0.36	
NOMINAL POWER(W)	10	LOR(%)	100.0	S/MH(C90/270)	0.36	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	973.67	η UP,DN(C0-180)	0.0,50.0	
NOMINAL FLUX(lm)	973.675	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.0	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	240.27	η down (%)	100.0	CIBSE SHR MAX	0.30	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

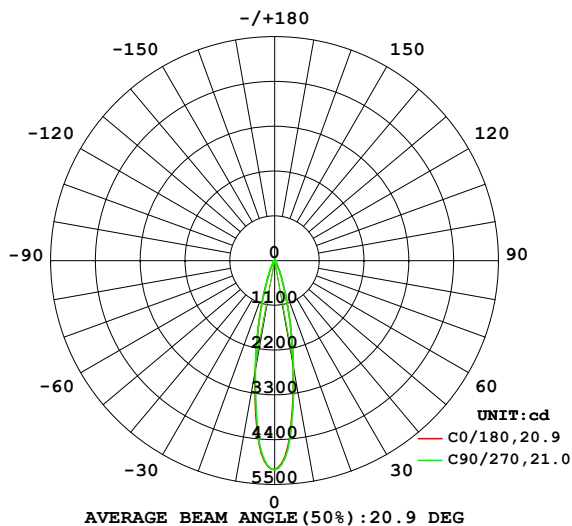

PLANAR ISOLUX DIAGRAM(UNIT:lx)

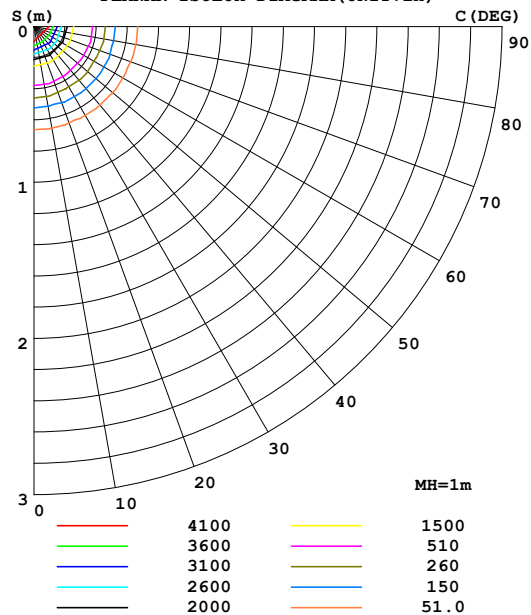

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	2651	2649	2692	2756	2768	2751	2732	2665	0- 10	361.3	361.3	37.1,37.1
20	633.8	634.1	630.2	650.6	639.4	624.5	633.8	627.6	10- 20	393.4	754.7	77.5,77.5
30	139.7	143.7	141.8	139.1	135.6	133.4	135.9	134.3	20- 30	143.4	898.1	92.2,92.2
40	31.04	32.39	32.28	30.39	28.42	30.02	30.78	30.51	30- 40	43.04	941.2	96.7,96.7
50	12.25	13.16	12.28	11.51	10.87	11.48	11.94	12.53	40- 50	14.29	955.4	98.1,98.1
60	8.825	9.093	8.743	8.551	8.039	8.160	8.467	9.002	50- 60	8.967	964.4	99,99
70	5.068	5.002	4.896	4.972	5.019	4.838	4.886	4.953	60- 70	6.804	971.2	99.7,99.7
80	0.3382	0.3036	0.3246	0.3028	0.3360	0.2900	0.2546	0.2803	70- 80	2.349	973.6	100,100
90	0.0173	0.0007	0.0232	0.0019	0.0035	0.0019	0.0090	0.0026	80- 90	0.1118	973.7	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 949.67 lm

%lum = 97.5%

%lamp = 97.5%

Conical surface Flux(130deg): 968.21 lm

%lum = 99.4%


%lamp = 99.4%

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

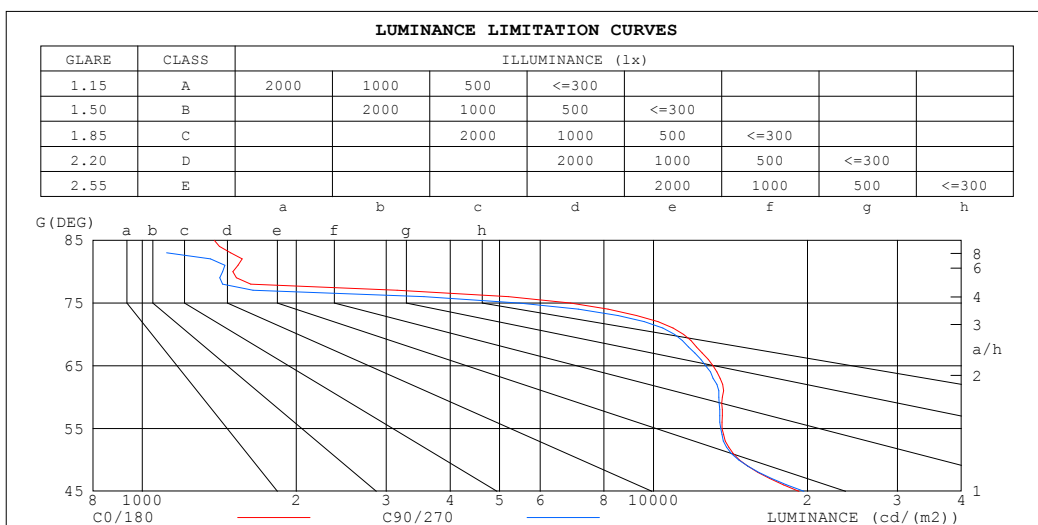

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	1382	212
80	1504	1435
75	6883	5457
70	11443	10989
65	13082	12645
60	13630	13424
55	13618	13530
50	14714	14664
45	19242	19687


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

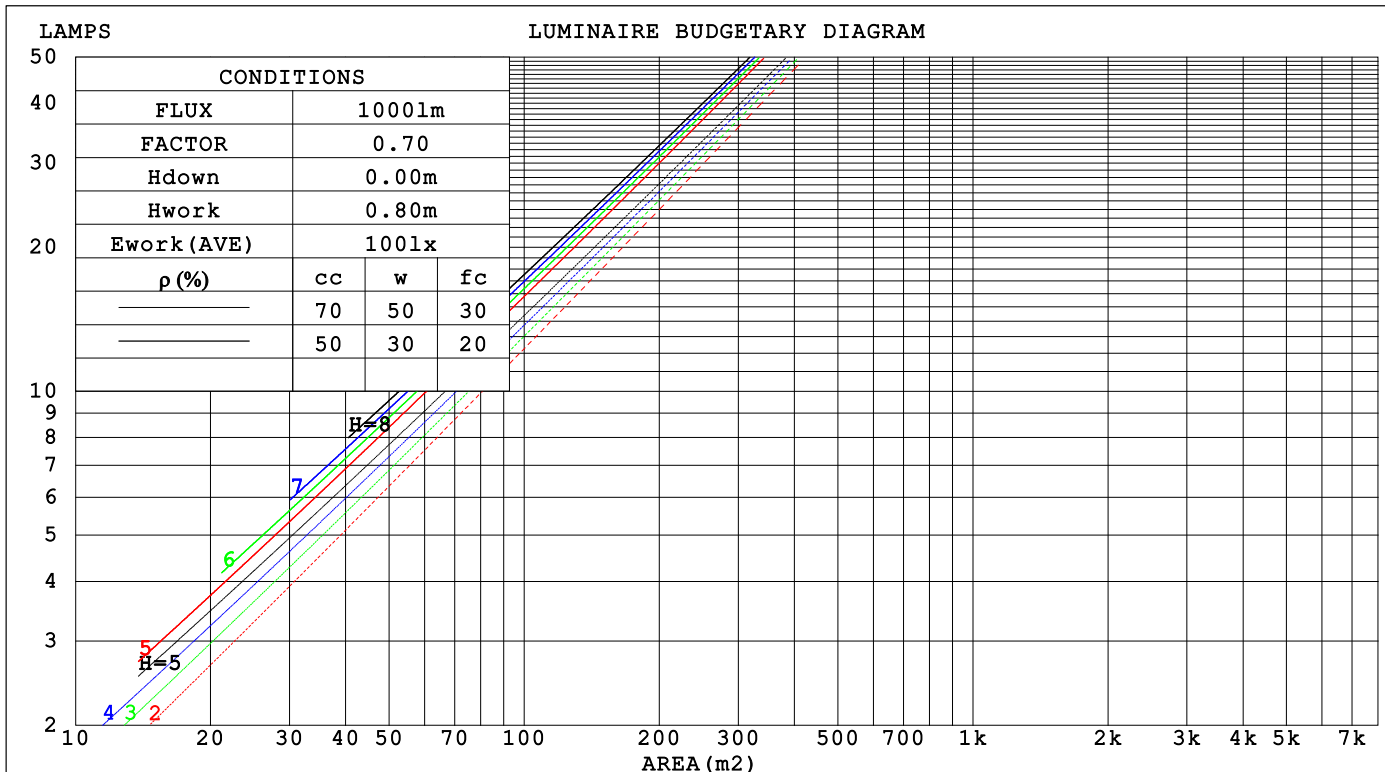

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz			UTHDi:0.15% ITHDi:20.57% KDisp:0.9485			Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D			TYPE:			WEIGHT:		
SPEC.:			DIM.:			SERIAL No.:		
MFR.: Norming Lighting			SUR.:			Shielding Angle:		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.141	.080	.025	.134	.077	.024	.122	.070	.022	.110	.064	.020	.100	.058	.019		
2.0	.131	.072	.022	.126	.069	.021	.115	.064	.020	.106	.059	.019	.097	.055	.017		
3.0	.122	.065	.019	.118	.063	.019	.109	.059	.018	.101	.055	.017	.094	.052	.016		
4.0	.114	.059	.017	.110	.058	.017	.103	.055	.016	.096	.052	.016	.090	.049	.015		
5.0	.107	.055	.016	.104	.053	.016	.098	.051	.015	.092	.049	.014	.087	.046	.014		
6.0	.101	.051	.015	.099	.050	.014	.093	.048	.014	.088	.046	.013	.084	.044	.013		
7.0	.096	.048	.013	.094	.047	.013	.089	.045	.013	.085	.043	.013	.081	.042	.012		
8.0	.091	.045	.013	.089	.044	.012	.085	.043	.012	.081	.041	.012	.078	.040	.012		
9.0	.087	.042	.012	.085	.042	.012	.082	.040	.011	.078	.039	.011	.075	.038	.011		
10.0	.083	.040	.011	.082	.039	.011	.079	.038	.011	.076	.038	.011	.073	.037	.010		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.169	.158	.148	.144	.135	.127	.099	.093	.088	.057	.054	.051	.018	.017	.017		
2.0	.151	.133	.117	.129	.114	.102	.089	.079	.071	.051	.046	.042	.016	.015	.014		
3.0	.136	.113	.095	.117	.098	.083	.080	.068	.058	.046	.040	.034	.015	.013	.011		
4.0	.124	.098	.078	.106	.085	.068	.073	.059	.048	.042	.035	.028	.014	.011	.009		
5.0	.113	.086	.065	.097	.074	.057	.067	.052	.040	.039	.030	.024	.012	.010	.008		
6.0	.104	.076	.055	.090	.066	.048	.062	.046	.034	.036	.027	.020	.012	.009	.007		
7.0	.097	.068	.047	.083	.059	.041	.057	.041	.029	.033	.024	.017	.011	.008	.006		
8.0	.090	.061	.041	.078	.053	.036	.054	.037	.025	.031	.022	.015	.010	.007	.005		
9.0	.084	.055	.035	.073	.048	.031	.050	.034	.022	.029	.020	.013	.010	.007	.004		
10.0	.079	.050	.031	.068	.044	.027	.047	.031	.019	.028	.018	.012	.009	.006	.004		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz UTHDi:0.15% ITHDi:20.57% KDisp:0.9485Lamp Flux:973.675x1 lm										
NAME: MD10-10-XX-01 4000K RA90 24D						TYPE:		WEIGHT:		
SPEC.:						DIM.:		SERIAL No.:		
MFR.: Norming Lighting						SUR.:		Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	14.9	15.5	15.1	15.7	15.8	14.9	15.5	15.1	15.7	15.8
3H	15.6	16.2	15.8	16.4	16.6	15.6	16.2	15.8	16.4	16.6
4H	15.7	16.3	16.0	16.5	16.7	15.7	16.3	15.9	16.5	16.7
6H	15.7	16.2	15.9	16.5	16.7	15.6	16.2	15.9	16.4	16.6
8H	15.6	16.2	15.9	16.4	16.7	15.5	16.1	15.8	16.3	16.6
12H	15.6	16.1	15.9	16.4	16.6	15.5	16.0	15.8	16.3	16.6
4H 2H	15.1	15.7	15.4	15.9	16.1	15.1	15.7	15.4	15.9	16.1
3H	16.0	16.5	16.3	16.8	17.0	16.0	16.5	16.3	16.7	17.0
4H	16.2	16.6	16.5	16.9	17.2	16.1	16.6	16.4	16.9	17.2
6H	16.1	16.5	16.4	16.8	17.2	16.0	16.4	16.4	16.7	17.1
8H	16.0	16.4	16.4	16.8	17.1	15.9	16.3	16.3	16.7	17.1
12H	16.0	16.3	16.4	16.7	17.1	15.9	16.3	16.3	16.6	17.0
8H 4H	16.1	16.5	16.5	16.9	17.2	16.0	16.4	16.4	16.8	17.1
6H	16.0	16.4	16.4	16.7	17.2	15.9	16.3	16.4	16.7	17.1
8H	16.0	16.3	16.4	16.7	17.1	15.9	16.2	16.3	16.6	17.0
12H	15.9	16.2	16.4	16.6	17.1	15.8	16.1	16.3	16.5	17.0
12H 4H	16.1	16.4	16.5	16.8	17.2	16.0	16.4	16.4	16.7	17.1
6H	16.0	16.3	16.4	16.7	17.1	15.9	16.2	16.3	16.6	17.0
8H	15.9	16.2	16.4	16.6	17.1	15.8	16.1	16.3	16.5	17.0
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 1.1 / - 1.2					+ 1.2 / - 1.3				
1.5H	+ 2.2 / - 1.1					+ 2.4 / - 1.1				
2.0H	+ 0.8 / - 0.5					+ 0.9 / - 0.6				

CIE Pub.117, 973.7 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = -0.1)
Area: 0.0013 m2

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	90	84	80	89	83	80	88	83	80	76
0.80	97	91	88	96	91	88	95	90	87	84
1.00	101	95	92	100	95	92	98	95	91	87
1.25	104	99	96	103	99	96	101	98	95	91
1.50	107	102	99	106	102	99	103	100	98	93
2.00	109	105	102	108	104	101	105	102	100	95
2.50	111	107	104	109	106	103	106	104	102	96
3.00	112	109	106	110	108	105	107	105	103	97
4.00	114	112	110	112	110	108	109	107	105	98
5.00	115	113	112	113	112	110	109	108	107	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

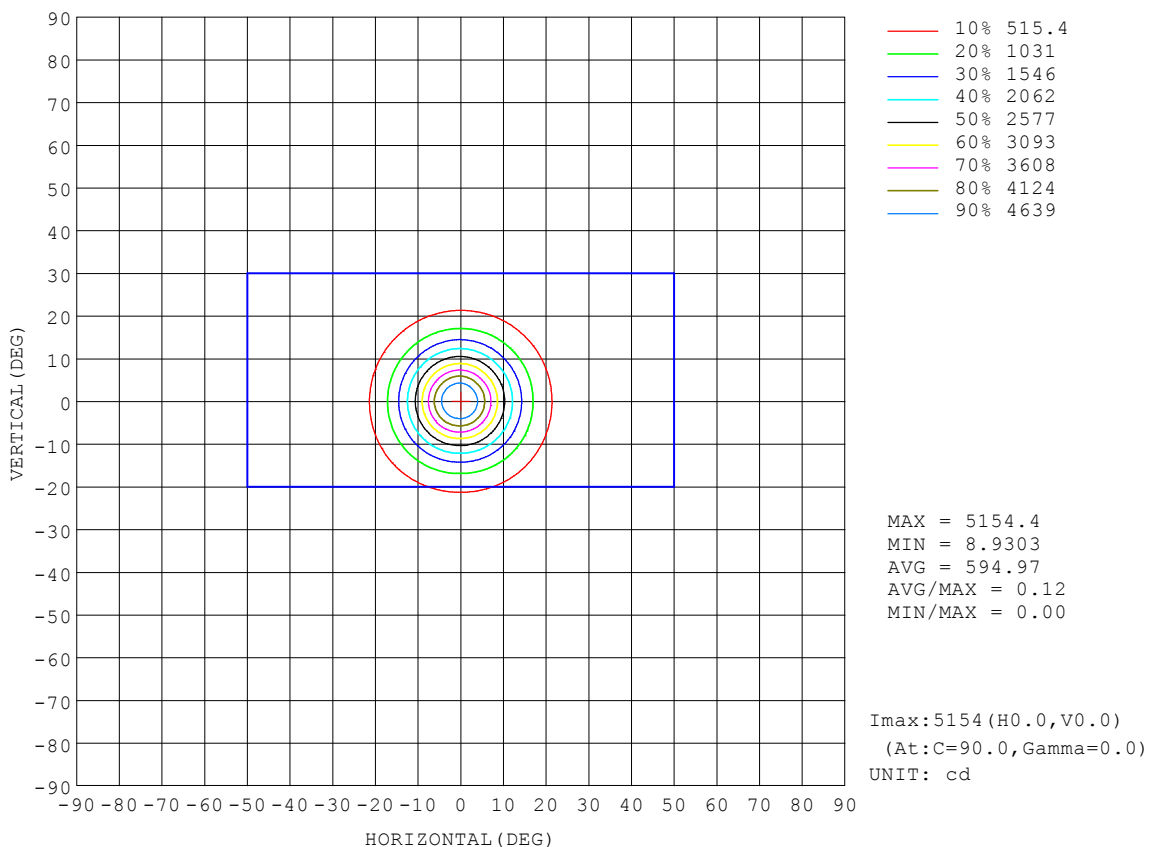


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

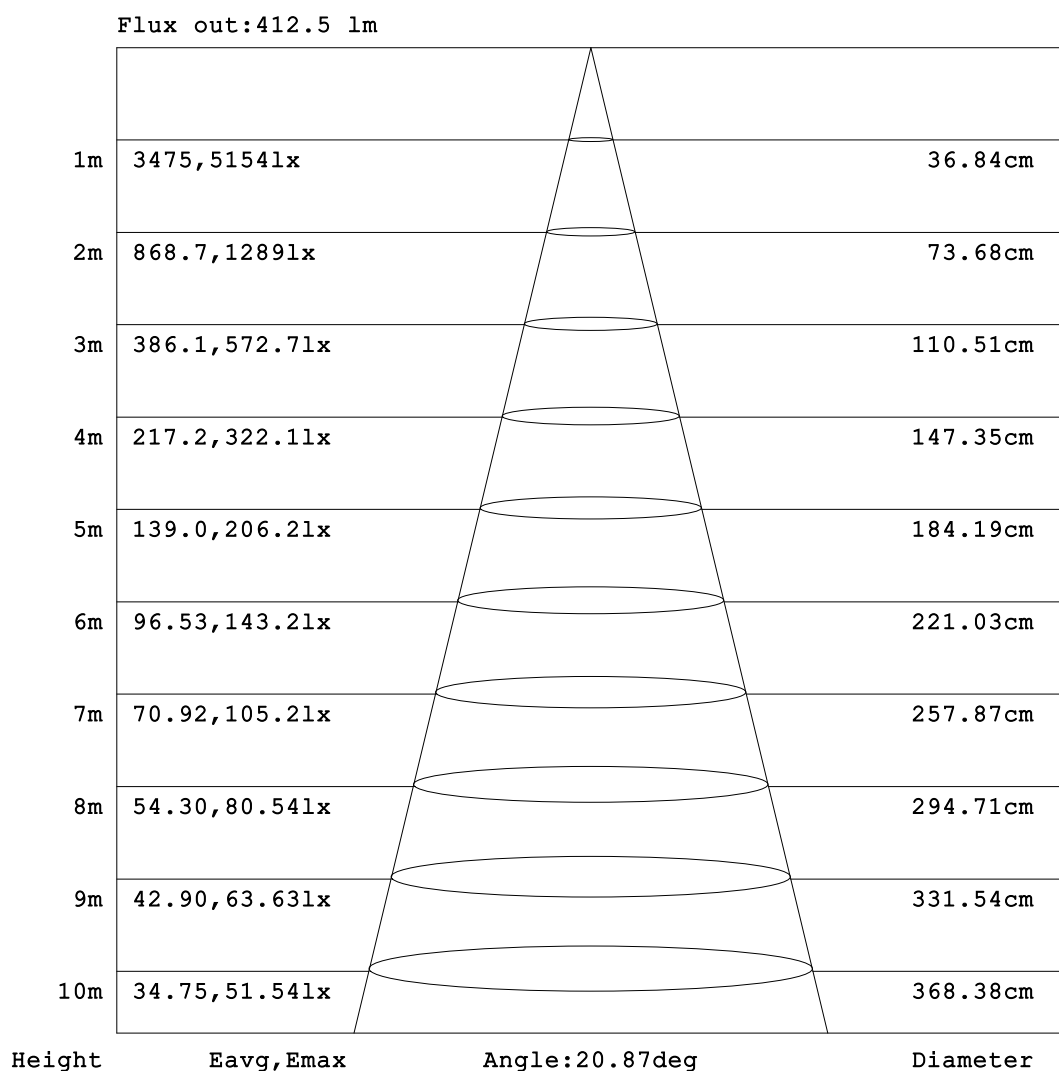


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

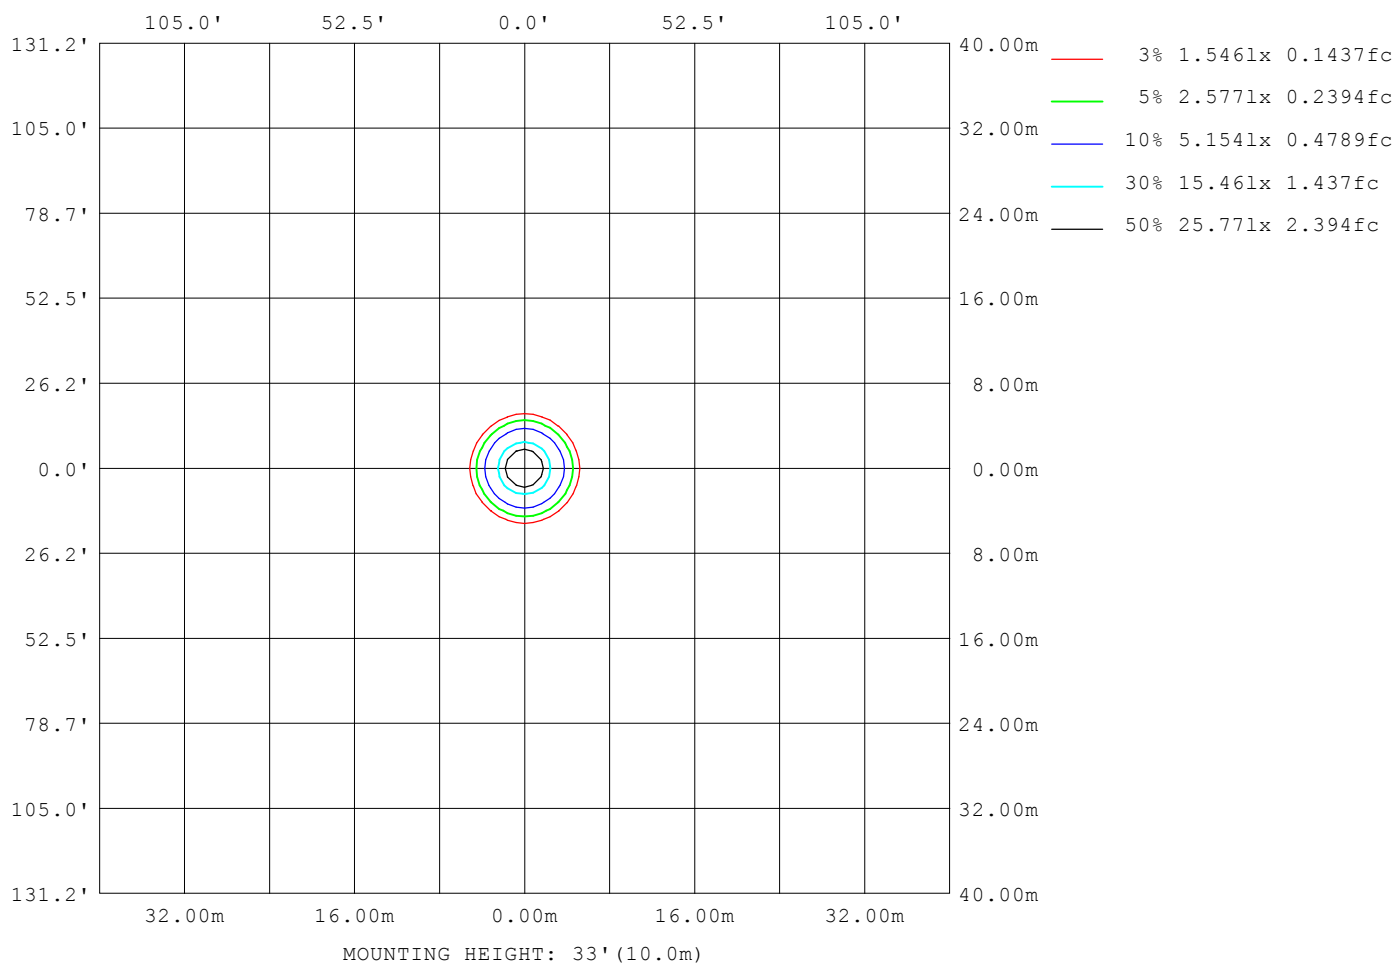

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.4V I:0.0445A P:10.0W PF:0.9306 Freq:49.99Hz		
UTHDi:0.15% ITHDi:20.57% KDisp:0.9485 Lamp Flux:973.675x1 lm		
NAME: MD10-10-XX-01 4000K RA90 24D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	12652
L_0~180 (75) av	6973
L_0~180 (85) av	1432
L_90~270 (65) av	12587
L_90~270 (75) av	5042
L_90~270 (85) av	164
L_45 (65) av	12601
L_45 (75) av	6512
L_45 (85) av	172

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

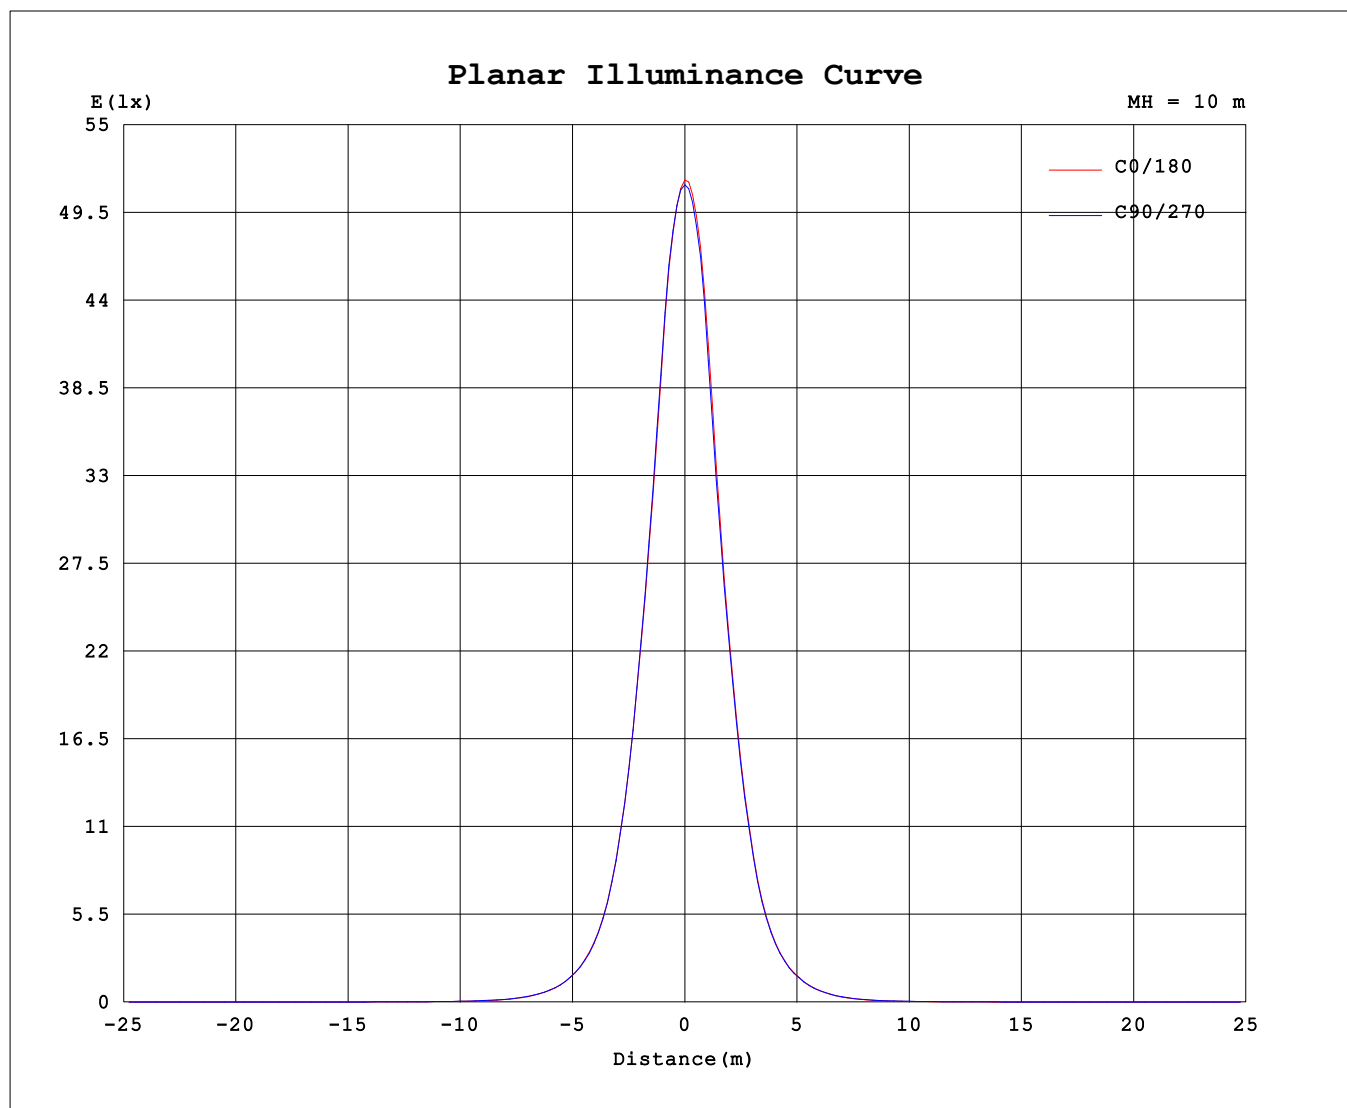

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```