


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 91.44 lm/W
MODEL		I _{max} (cd)	933.8	S/MH(C0/180)	0.88	
NOMINAL POWER(W)	10	LOR(%)	100.0	S/MH(C90/270)	0.90	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	913.37	η UP,DN(C0-180)	0.0,49.6	
NOMINAL FLUX(lm)	913.374	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,50.4	
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM	0.75	
TEST VOLTAGE(V)	240.44	η down(%)	100.0	CIBSE SHR MAX	0.90	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

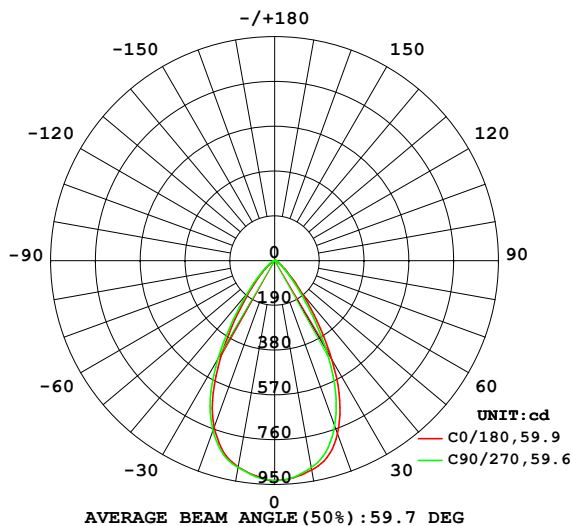

PLANAR ISOLUX DIAGRAM(UNIT:lx)

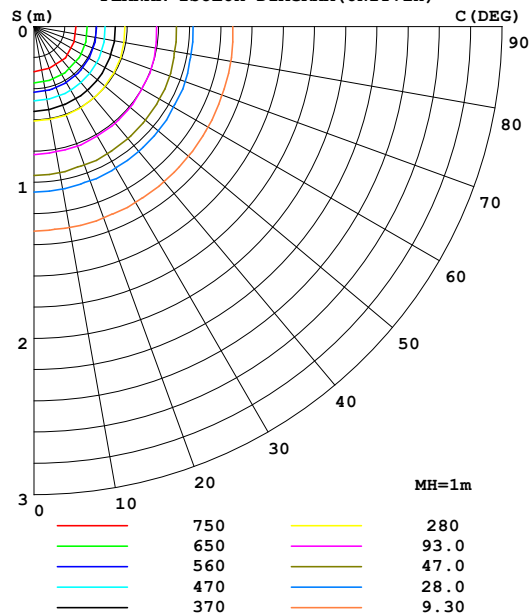

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	901.3	900.1	891.6	888.7	888.9	886.7	891.5	897.3	0- 10	86.99	86.99	9.52,9.52
20	780.6	767.8	745.7	745.3	751.3	754.3	765.9	778.0	10- 20	236.4	323.4	35.4,35.4
30	488.0	469.6	437.7	428.7	439.8	461.4	480.9	487.9	20- 30	285.0	608.3	66.6,66.6
40	183.3	171.2	152.7	150.5	154.0	165.3	181.2	186.8	30- 40	184.6	792.9	86.8,86.8
50	56.78	52.98	48.03	46.61	47.78	52.22	57.83	58.68	40- 50	76.15	869.1	95.1,95.1
60	18.61	17.96	16.20	15.50	15.54	17.06	18.93	19.05	50- 60	27.70	896.8	98.2,98.2
70	7.765	7.523	6.974	6.736	6.681	7.280	7.849	7.955	60- 70	11.42	908.2	99.4,99.4
80	2.195	2.148	1.977	2.143	2.149	1.579	0.9553	1.373	70- 80	4.772	913.0	100,100
90	0.0103	0.0045	0.0109	0.0071	0.0099	0.0064	0.0103	0.0061	80- 90	0.4170	913.4	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 840.17 lm

%lum = 92.0%

%lamp = 92.0%

Conical surface Flux(130deg): 903.55 lm

%lum = 98.9%


%lamp = 98.9%

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

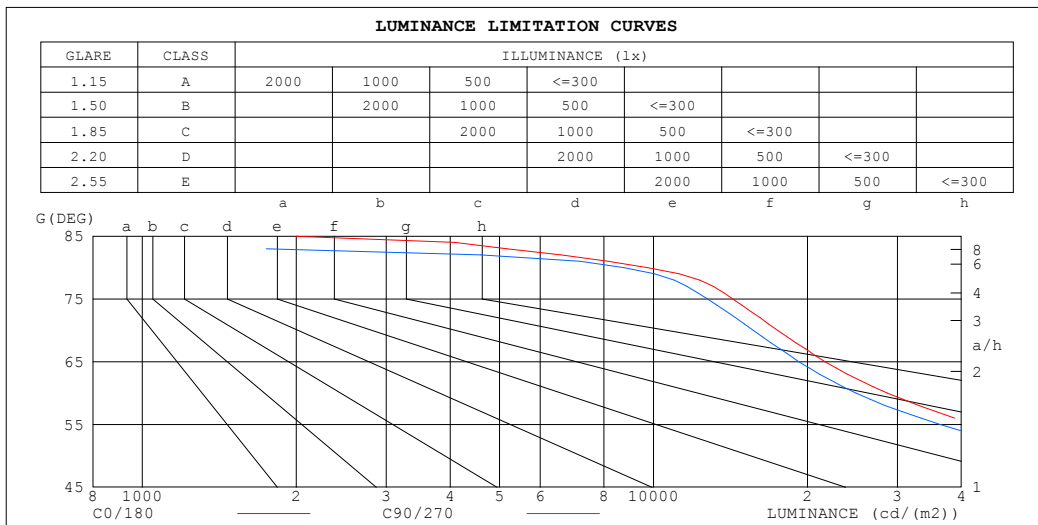


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505		Lamp Flux:913.374x1 lm
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
p _w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
p _{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio Coefficients of Utilization(CU)															
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.10	1.08	1.05	1.08	1.06	1.04	1.04	1.02	1.00	1.00	.99	.97	.97	.96	.95	.93
2.0	1.02	.98	.94	1.00	.96	.93	.97	.94	.91	.94	.91	.89	.91	.89	.87	.85
3.0	.94	.89	.85	.93	.88	.84	.90	.86	.83	.88	.85	.82	.86	.83	.80	.79
4.0	.88	.82	.78	.87	.81	.77	.84	.80	.76	.82	.78	.75	.81	.77	.74	.73
5.0	.82	.76	.71	.81	.75	.71	.79	.74	.70	.77	.73	.70	.76	.72	.69	.67
6.0	.77	.70	.66	.76	.70	.66	.74	.69	.65	.73	.68	.65	.71	.67	.64	.63
7.0	.72	.65	.61	.71	.65	.61	.70	.64	.60	.68	.64	.60	.67	.63	.60	.58
8.0	.67	.61	.57	.67	.61	.57	.66	.60	.56	.65	.60	.56	.64	.59	.56	.54
9.0	.63	.57	.53	.63	.57	.53	.62	.57	.53	.61	.56	.53	.60	.56	.52	.51
10.0	.60	.54	.50	.59	.54	.50	.59	.53	.50	.58	.53	.49	.57	.53	.49	.48

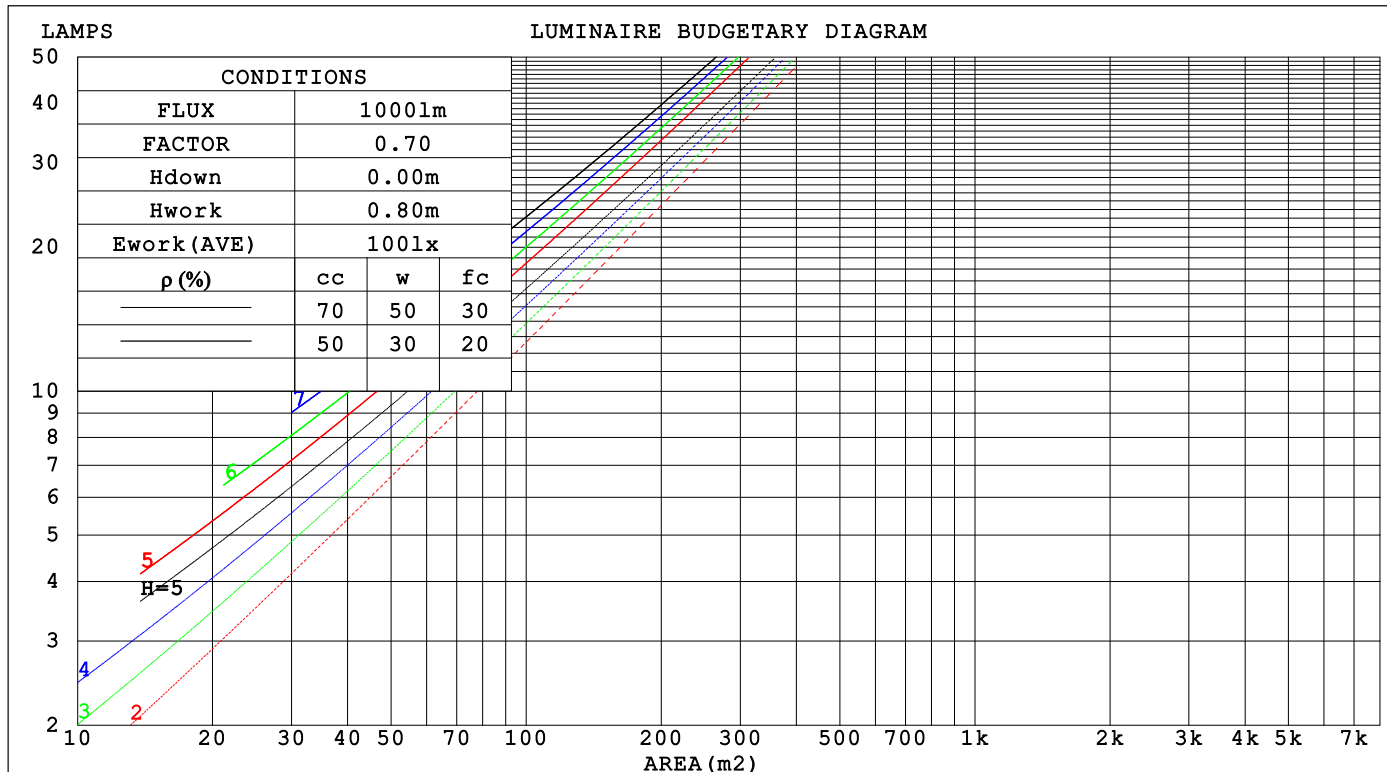

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.189	.107	.034	.182	.104	.033	.169	.097	.031	.158	.091	.029	.147	.085	.027		
2.0	.181	.099	.031	.176	.097	.030	.165	.092	.029	.155	.087	.027	.146	.083	.026		
3.0	.173	.092	.028	.168	.090	.027	.159	.086	.026	.150	.082	.025	.143	.079	.024		
4.0	.165	.086	.025	.160	.084	.025	.152	.081	.024	.145	.078	.023	.138	.075	.023		
5.0	.157	.080	.023	.153	.078	.023	.146	.076	.022	.139	.074	.022	.133	.071	.021		
6.0	.149	.075	.021	.146	.074	.021	.140	.072	.021	.134	.070	.020	.129	.068	.020		
7.0	.142	.070	.020	.139	.069	.020	.134	.068	.019	.129	.066	.019	.124	.064	.019		
8.0	.136	.066	.019	.133	.066	.019	.128	.064	.018	.124	.063	.018	.119	.061	.018		
9.0	.130	.063	.018	.127	.062	.017	.123	.061	.017	.119	.060	.017	.115	.058	.017		
10.0	.124	.060	.017	.122	.059	.016	.118	.058	.016	.114	.057	.016	.111	.056	.016		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.172	.157	.144	.147	.135	.124	.101	.093	.086	.058	.054	.050	.019	.017	.016		
2.0	.158	.132	.111	.135	.114	.096	.092	.079	.067	.053	.046	.039	.017	.015	.013		
3.0	.146	.114	.088	.125	.098	.076	.086	.068	.054	.050	.040	.032	.016	.013	.010		
4.0	.136	.099	.071	.117	.086	.062	.080	.060	.043	.046	.035	.026	.015	.011	.008		
5.0	.128	.088	.058	.110	.076	.051	.075	.053	.036	.044	.031	.021	.014	.010	.007		
6.0	.120	.078	.048	.103	.068	.042	.071	.048	.030	.041	.028	.018	.013	.009	.006		
7.0	.114	.071	.041	.098	.062	.036	.068	.043	.025	.039	.025	.015	.013	.008	.005		
8.0	.108	.065	.035	.093	.056	.031	.065	.040	.022	.038	.023	.013	.012	.008	.004		
9.0	.103	.060	.030	.089	.052	.027	.062	.036	.019	.036	.022	.011	.012	.007	.004		
10.0	.099	.055	.027	.085	.048	.023	.059	.034	.017	.034	.020	.010	.011	.007	.003		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz UTHDi:0.17% ITHDi:19.86% KDisp:0.9505Lamp Flux:913.374x1 lm											
NAME: MD10-10-XX-03 3000K RA90 60D						TYPE:		WEIGHT:			
SPEC.:						DIM.:		SERIAL No.:			
MFR.: Norming Lighting						SUR.:		Shielding Angle:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	24.7	25.7	24.9	25.9	26.0	24.1	25.1	24.3	25.3	25.4
	3H	24.6	25.6	24.9	25.8	26.0	24.0	25.0	24.3	25.2	25.4
	4H	24.6	25.5	24.9	25.7	25.9	24.0	24.9	24.3	25.1	25.3
	6H	24.6	25.4	24.9	25.6	25.9	24.0	24.8	24.3	25.0	25.3
	8H	24.5	25.3	24.8	25.6	25.8	23.9	24.7	24.2	25.0	25.2
	12H	24.5	25.2	24.8	25.5	25.8	23.9	24.6	24.2	24.9	25.2
4H	2H	24.5	25.4	24.8	25.6	25.8	23.9	24.8	24.2	25.0	25.3
	3H	24.5	25.3	24.9	25.6	25.8	24.0	24.7	24.3	25.0	25.3
	4H	24.5	25.2	24.9	25.5	25.8	24.0	24.6	24.3	24.9	25.3
	6H	24.5	25.1	24.9	25.4	25.8	23.9	24.5	24.3	24.9	25.2
	8H	24.5	25.0	24.9	25.4	25.7	23.9	24.4	24.3	24.8	25.2
	12H	24.4	24.9	24.8	25.3	25.7	23.8	24.3	24.2	24.7	25.1
8H	4H	24.4	25.0	24.8	25.3	25.7	23.9	24.4	24.3	24.8	25.1
	6H	24.4	24.9	24.8	25.3	25.7	23.9	24.3	24.3	24.7	25.1
	8H	24.4	24.8	24.8	25.2	25.6	23.8	24.2	24.3	24.6	25.1
	12H	24.3	24.7	24.8	25.1	25.6	23.8	24.1	24.2	24.5	25.0
12H	4H	24.4	24.9	24.8	25.3	25.7	23.8	24.3	24.2	24.7	25.1
	6H	24.4	24.8	24.8	25.2	25.6	23.8	24.2	24.3	24.6	25.1
	8H	24.3	24.7	24.8	25.1	25.6	23.8	24.1	24.2	24.6	25.0
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H		+ 2.4 / - 4.3					+ 2.0 / - 4.3				
1.5H		+ 3.8 / - 3.7					+ 3.3 / - 3.3				
2.0H		+ 4.2 / - 3.3					+ 3.7 / - 2.9				

CIE Pub.117, 913.4 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -0.3$)
Area: 0.0013 m²

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	83	76	72	83	76	72	82	76	72	68
0.80	91	85	80	91	84	80	89	84	80	76
1.00	96	90	86	96	90	86	94	90	85	81
1.25	101	95	91	100	95	91	98	93	90	86
1.50	104	99	95	103	98	95	100	96	93	89
2.00	107	103	99	106	102	98	103	100	97	91
2.50	109	105	102	107	104	101	104	101	99	93
3.00	111	107	104	109	106	103	106	103	101	94
4.00	113	110	108	111	108	106	107	105	103	96
5.00	114	112	110	112	110	108	108	107	105	97
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

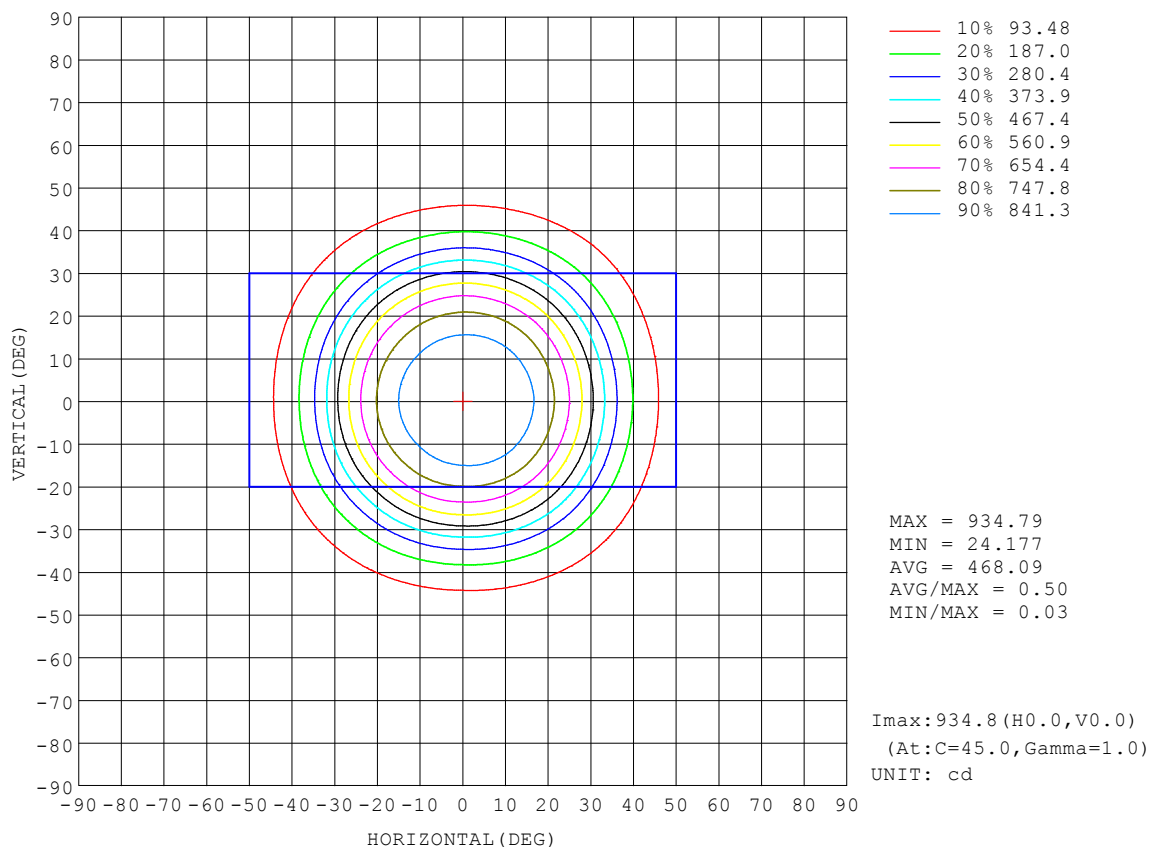


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

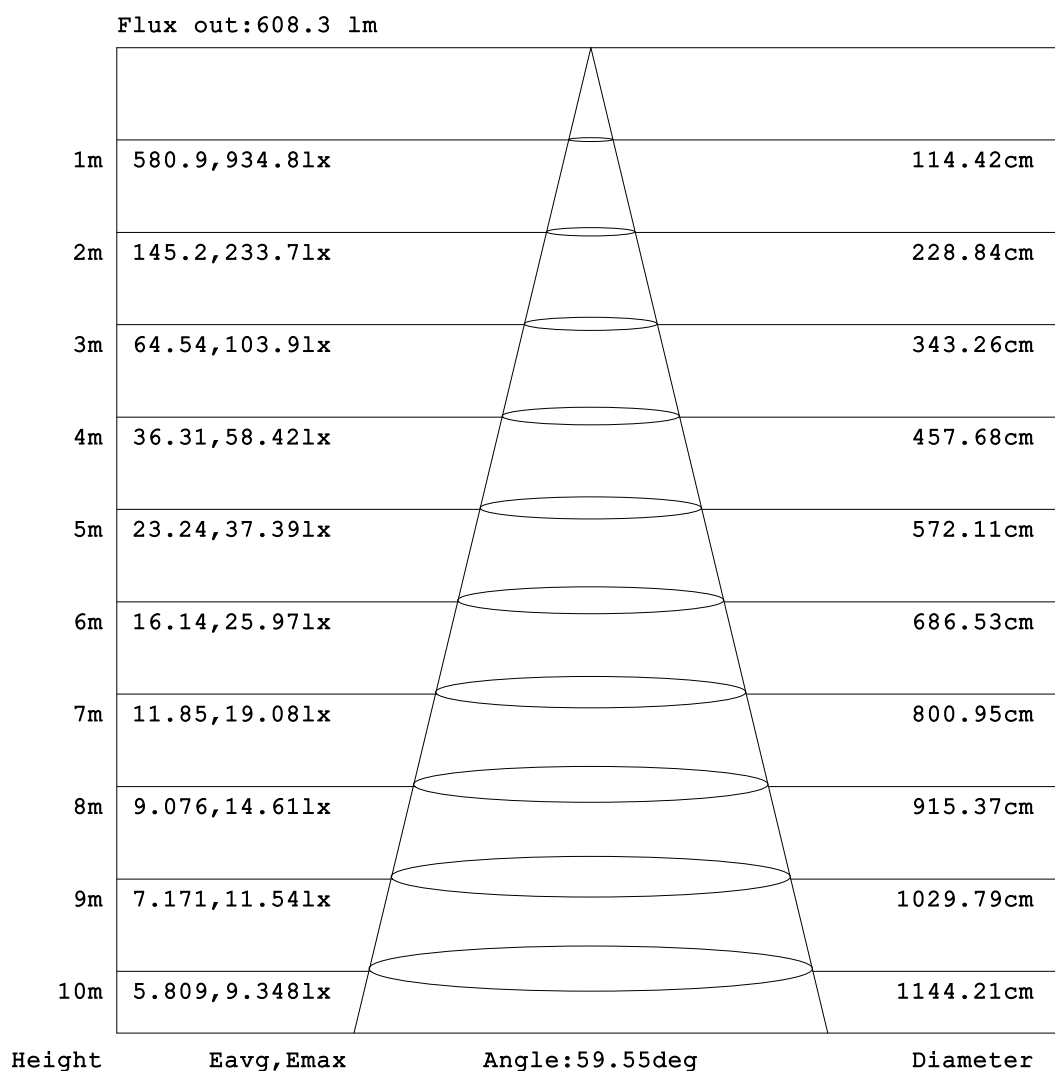


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:

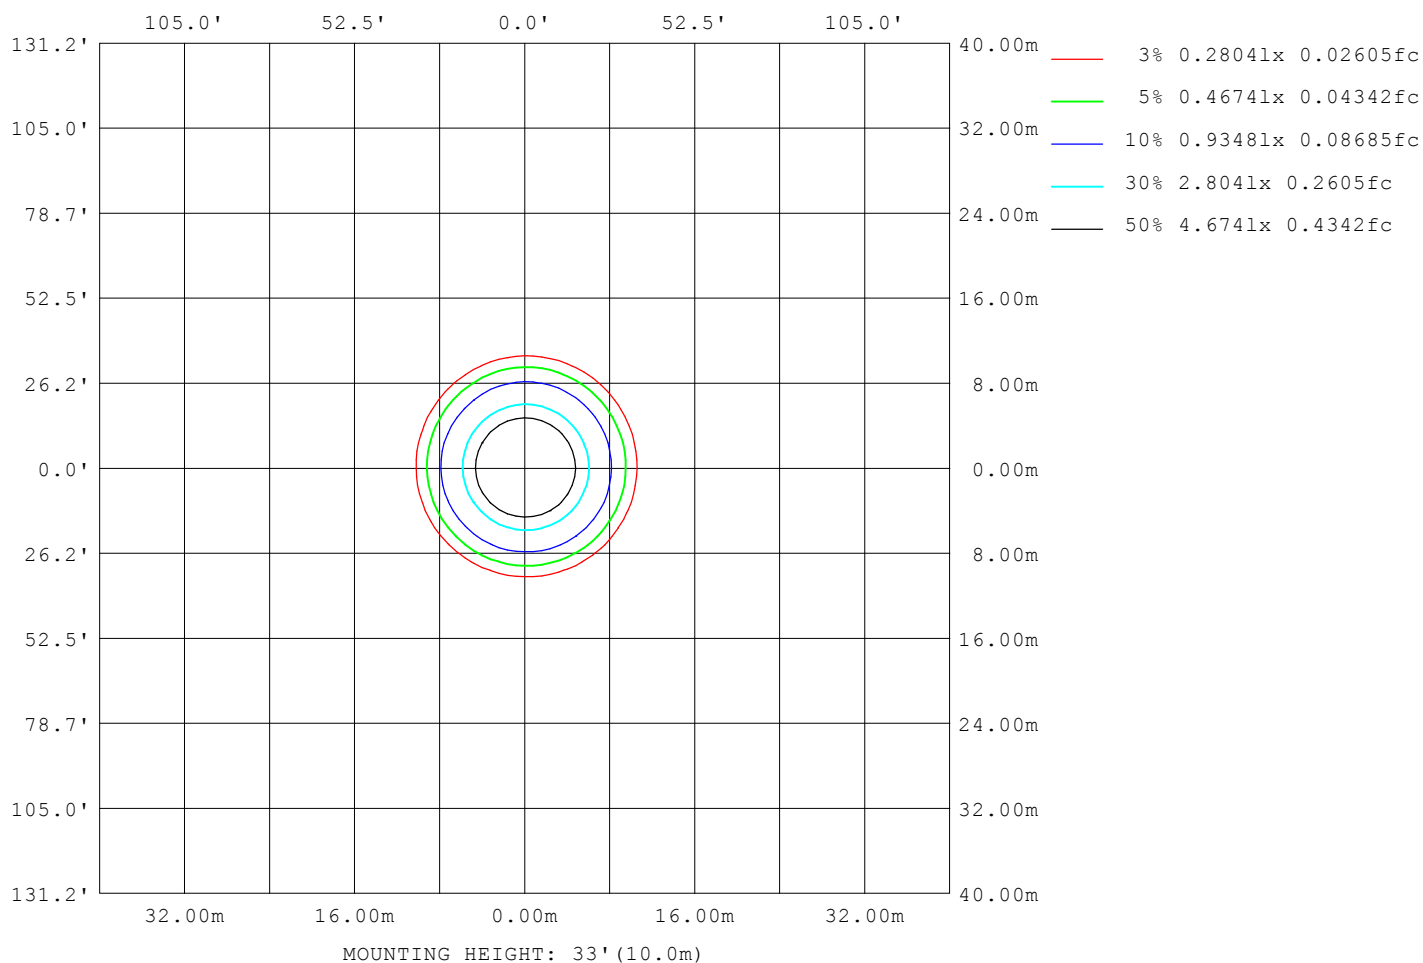

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2023-09-14

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.5V I:0.0446A P:10.0W PF:0.9305 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.86% KDisp:0.9505 Lamp Flux:913.374x1 lm		
NAME: MD10-10-XX-03 3000K RA90 60D	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming Lighting	SUR.:	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	20034
L_0~180 (75) av	13282
L_0~180 (85) av	2499
L_90~270 (65) av	20556
L_90~270 (75) av	13477
L_90~270 (85) av	111
L_45 (65) av	20429
L_45 (75) av	13525
L_45 (85) av	250

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature:25.3DEG
 Operators:DAMIN
 Test Date:2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity:65.0%
 Test Distance:3.090m [K=1.0000]
 Remarks:

Planar Illuminance Curve

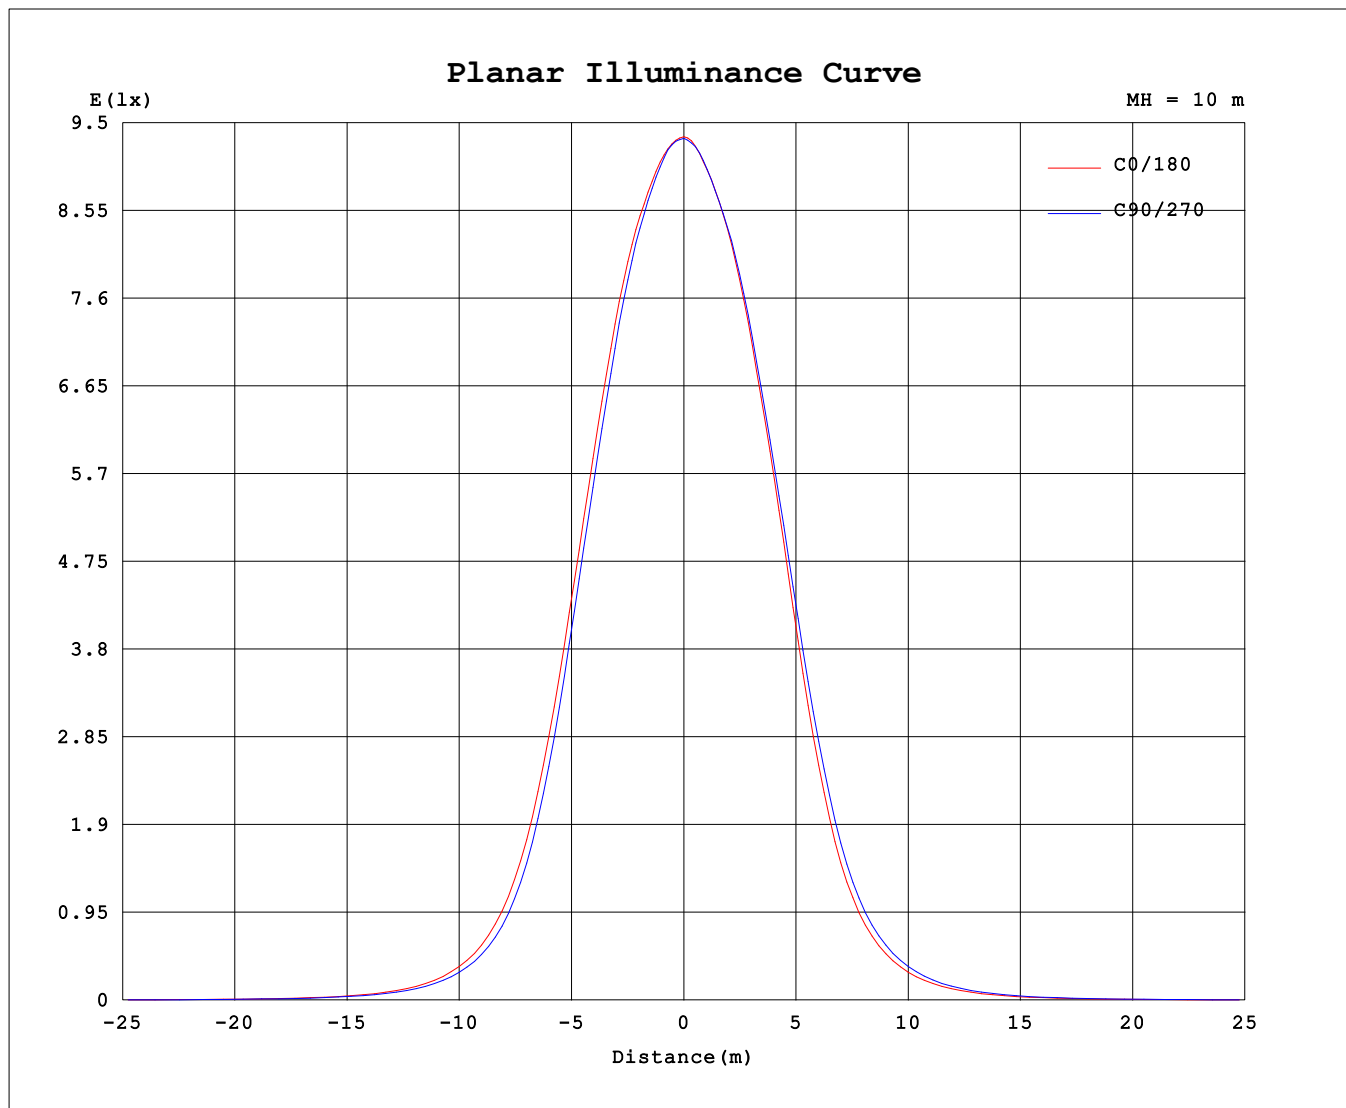

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2023-09-14

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```