


LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 88.76 lm/W
MODEL		Imax (cd)	1158	S/MH(C0/180)	0.52	
NOMINAL POWER(W)	6	LOR(%)	100.0	S/MH(C90/270)	0.59	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	508.53	η UP,DN(C0-180)	0.0,51.1	
NOMINAL FLUX(lm)	508.53	CIE CLASS	DIRECT	η UP,DN(C180-360)	0.0,48.9	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	0.50	
TEST VOLTAGE(V)	240.31	η down (%)	100.0	CIBSE SHR MAX	0.60	

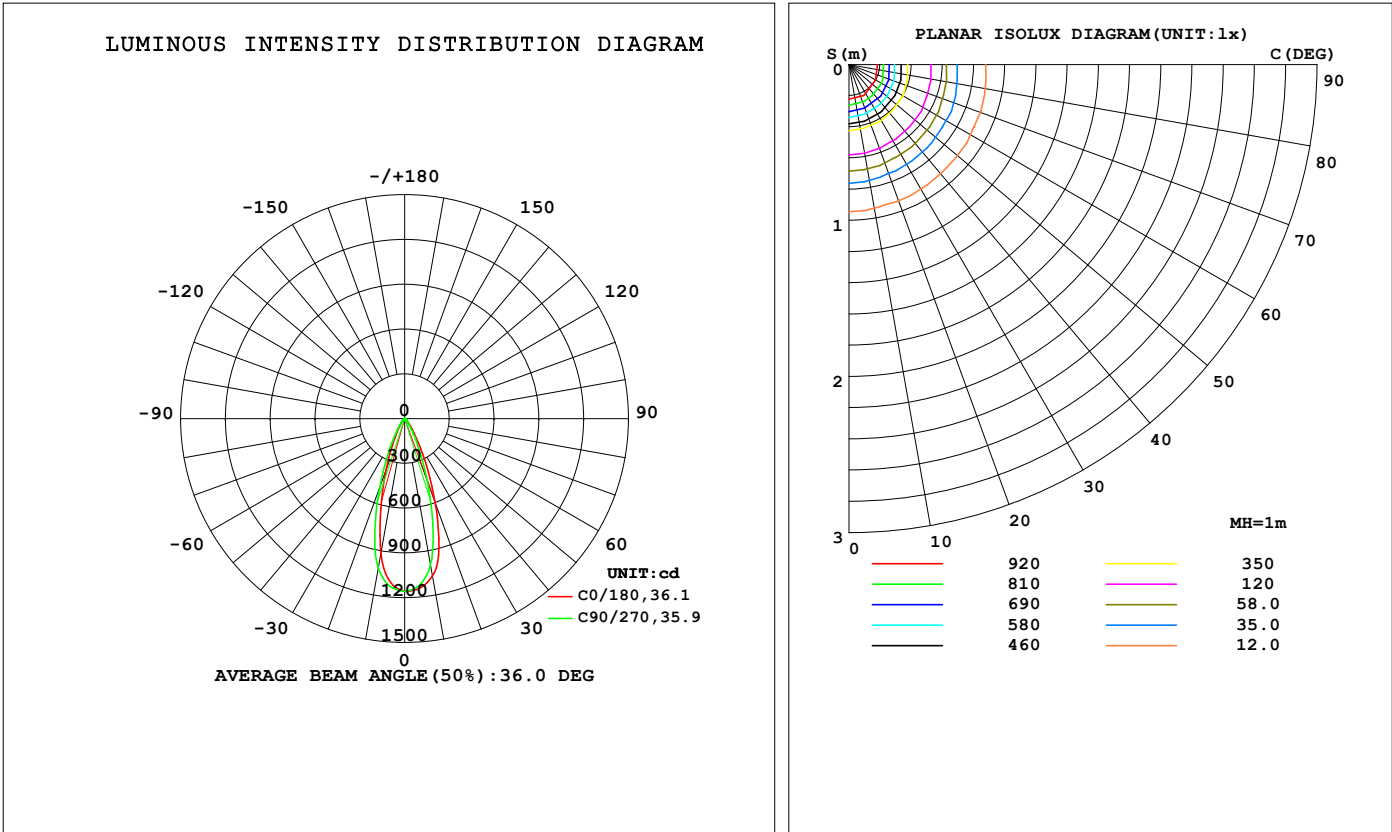

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1072	1049	996.1	943.4	919.3	954.2	1016	1059	0- 10	103.4	103.4	20.3,20.3
20	599.7	546.1	445.4	380.5	364.9	403.7	487.8	567.9	10- 20	203.8	307.3	60.4,60.4
30	179.3	156.5	119.9	99.92	101.2	115.1	141.6	167.5	20- 30	123.5	430.8	84.7,84.7
40	45.07	39.27	31.77	29.21	31.42	34.85	38.80	42.86	30- 40	45.49	476.2	93.7,93.7
50	15.39	13.95	12.38	12.36	13.52	14.22	14.79	15.09	40- 50	17.47	493.7	97.1,97.1
60	7.606	6.893	6.352	5.845	6.213	6.567	7.156	7.312	50- 60	8.800	502.5	98.8,98.8
70	3.439	3.014	2.610	1.934	1.954	2.239	2.954	3.156	60- 70	4.503	507.0	99.7,99.7
80	0.5106	0.3910	0.3210	0.2550	0.2561	0.2968	0.3762	0.4326	70- 80	1.329	508.3	100,100
90	0.0944	0.0443	0.0090	0.0016	0.0058	0.0032	0.0019	0.0611	80- 90	0.1885	508.5	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 486.69 lm

%lum = 95.7%

%lamp = 95.7%

Conical surface Flux(120deg): 502.51 lm

%lum = 98.8%


%lamp = 98.8%

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

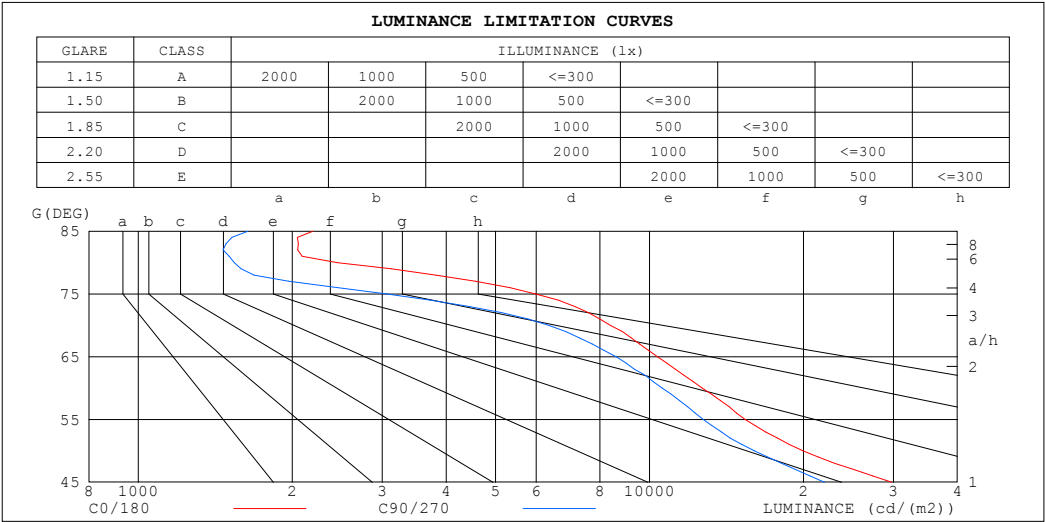

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	2194	1638
80	2453	1541
75	5996	3071
70	8386	6359
65	10369	8609
60	12689	10587
55	15380	12735
50	19970	16052
45	29778	21995


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999		
Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
ρw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.09	1.07	1.09	1.07	1.06	1.05	1.04	1.02	1.02	1.01	.99	.98	.97	.97	.95
2.0	1.05	1.01	.98	1.03	1.00	.97	1.00	.97	.95	.97	.95	.93	.94	.93	.91	.90
3.0	.99	.95	.91	.98	.94	.90	.95	.92	.89	.93	.90	.88	.91	.88	.86	.85
4.0	.94	.89	.85	.93	.88	.85	.91	.87	.84	.89	.85	.83	.87	.84	.82	.81
5.0	.89	.84	.80	.88	.83	.80	.87	.82	.79	.85	.81	.79	.83	.80	.78	.77
6.0	.85	.80	.76	.84	.79	.76	.83	.78	.75	.81	.78	.75	.80	.77	.74	.73
7.0	.81	.76	.72	.80	.76	.72	.79	.75	.72	.78	.74	.71	.77	.74	.71	.70
8.0	.78	.72	.69	.77	.72	.69	.76	.72	.68	.75	.71	.68	.74	.71	.68	.67
9.0	.74	.69	.66	.74	.69	.66	.73	.69	.66	.72	.68	.65	.71	.68	.65	.64
10.0	.71	.66	.63	.71	.66	.63	.70	.66	.63	.69	.66	.63	.69	.65	.63	.61

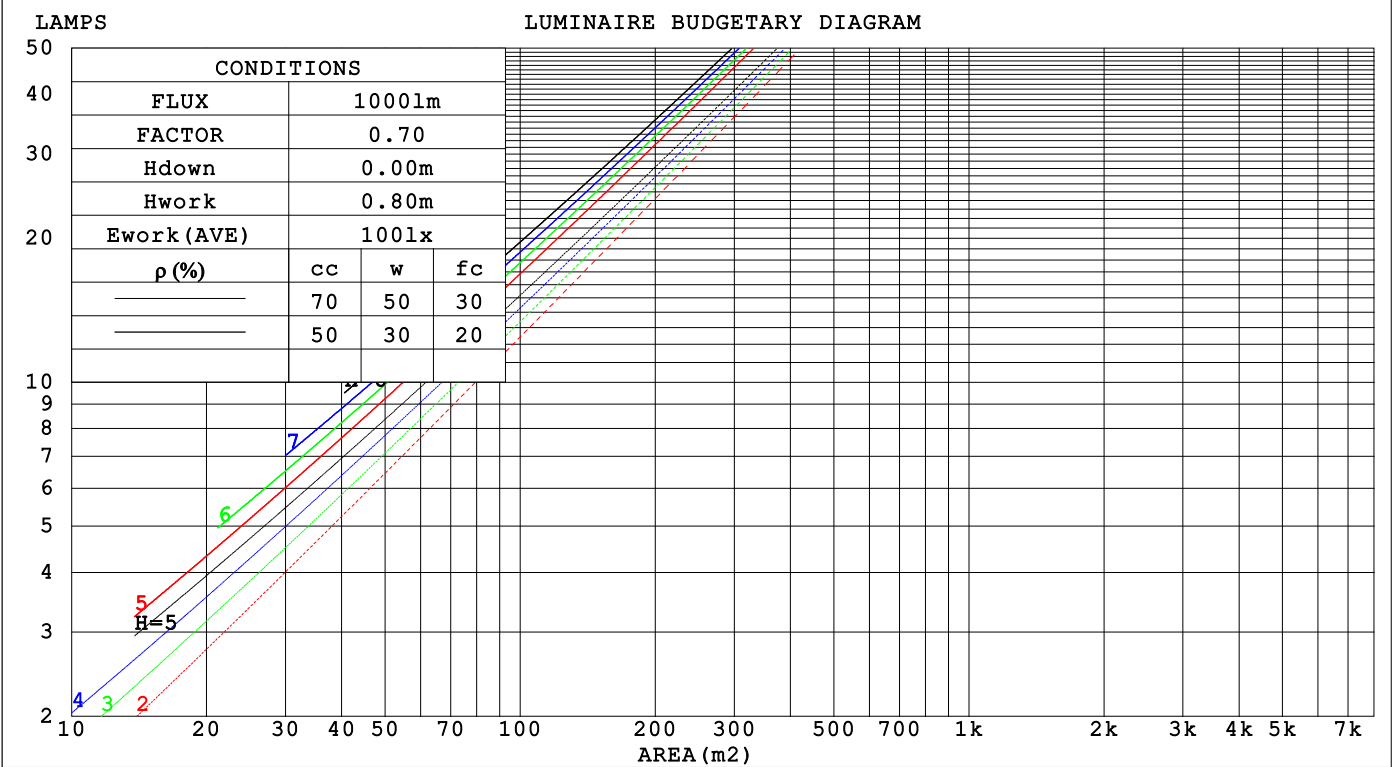

C Range: 0 - 360DEG

C Interval: 45.0DEG

Test Speed: HIGH

Temperature:25.3DEG

Operators:DAMIN

Test Date:2024-08-03

γ Range: 0 - 90DEG

γ Interval: 1.0DEG

Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453

Humidity:65.0%

Test Distance:3.090m [K=1.0000]

Remarks:

WEC AND CCEC

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.161	.092	.029	.155	.088	.028	.142	.082	.026	.131	.075	.024	.120	.070	.022															
2.0	.152	.084	.026	.147	.081	.025	.136	.076	.024	.127	.071	.022	.118	.067	.021															
3.0	.144	.077	.023	.139	.074	.022	.130	.071	.021	.122	.067	.021	.115	.063	.020															
4.0	.136	.071	.021	.132	.069	.020	.124	.066	.020	.117	.063	.019	.111	.060	.018															
5.0	.129	.066	.019	.125	.064	.019	.119	.062	.018	.113	.059	.018	.107	.057	.017															
6.0	.122	.061	.018	.119	.060	.017	.114	.058	.017	.108	.056	.017	.103	.054	.016															
7.0	.116	.058	.016	.114	.057	.016	.109	.055	.016	.104	.053	.016	.100	.052	.015															
8.0	.111	.054	.015	.109	.054	.015	.104	.052	.015	.100	.051	.015	.096	.049	.014															
9.0	.106	.051	.014	.104	.051	.014	.100	.050	.014	.097	.048	.014	.093	.047	.014															
10.0	.102	.049	.014	.100	.048	.013	.096	.047	.013	.093	.046	.013	.090	.045	.013															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.157	.146	.145	.135	.126	.100	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.154	.133	.115	.132	.114	.099	.090	.079	.069	.052	.046	.041	.017	.015	.013	
3.0	.140	.113	.092	.120	.098	.080	.082	.068	.056	.048	.040	.033	.015	.013	.011	
4.0	.129	.098	.075	.111	.085	.065	.076	.059	.046	.044	.035	.027	.014	.011	.009	
5.0	.119	.087	.062	.103	.075	.054	.071	.052	.038	.041	.031	.023	.013	.010	.007	
6.0	.111	.077	.052	.096	.067	.046	.066	.047	.032	.038	.027	.019	.012	.009	.006	
7.0	.104	.069	.044	.090	.060	.039	.062	.042	.027	.036	.025	.016	.012	.008	.005	
8.0	.098	.063	.038	.085	.054	.033	.058	.038	.024	.034	.023	.014	.011	.007	.005	
9.0	.093	.057	.033	.080	.050	.029	.055	.035	.021	.032	.021	.012	.010	.007	.004	
10.0	.088	.053	.029	.076	.046	.025	.053	.032	.018	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz											
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999						Lamp Flux:508.53x1 lm					
NAME: MD16-06-XX-01 2700K RA90 36D THU						TYPE:			WEIGHT:		
SPEC.:						DIM.:			SERIAL No.:		
MFR.: Norming lighting						SUR.: 40mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
x = 2H y = 2H	18.3	19.1	18.5	19.3	19.4	17.0	17.8	17.2	18.0	18.1	
	3H	18.5	19.2	18.7	19.4	19.6	17.2	17.9	17.4	18.1	18.3
	4H	18.5	19.2	18.8	19.4	19.6	17.1	17.9	17.4	18.1	18.3
	6H	18.4	19.1	18.7	19.4	19.6	17.1	17.7	17.4	18.0	18.2
	8H	18.4	19.1	18.7	19.3	19.6	17.0	17.7	17.3	17.9	18.2
	12H	18.4	19.0	18.7	19.3	19.5	17.0	17.6	17.3	17.9	18.1
4H 2H	18.2	19.0	18.5	19.2	19.4	17.0	17.7	17.3	18.0	18.2	
	3H	18.5	19.1	18.8	19.4	19.7	17.3	17.9	17.6	18.2	18.4
	4H	18.6	19.1	18.9	19.4	19.7	17.3	17.9	17.6	18.1	18.5
	6H	18.5	19.0	18.9	19.3	19.7	17.2	17.7	17.6	18.0	18.4
	8H	18.5	18.9	18.8	19.3	19.6	17.2	17.6	17.6	18.0	18.3
	12H	18.4	18.8	18.8	19.2	19.6	17.1	17.5	17.5	17.9	18.3
8H 4H	18.5	18.9	18.8	19.3	19.6	17.2	17.7	17.6	18.0	18.4	
	6H	18.4	18.8	18.8	19.2	19.6	17.1	17.5	17.6	17.9	18.3
	8H	18.4	18.7	18.8	19.1	19.6	17.1	17.4	17.5	17.9	18.3
	12H	18.3	18.6	18.8	19.0	19.5	17.0	17.3	17.5	17.8	18.3
12H 4H	18.4	18.8	18.8	19.2	19.6	17.2	17.6	17.6	18.0	18.4	
	6H	18.4	18.7	18.8	19.1	19.5	17.1	17.4	17.5	17.8	18.3
	8H	18.3	18.6	18.8	19.0	19.5	17.0	17.3	17.5	17.8	18.2
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H	+ 2.2 / - 2.6					+ 1.5 / - 2.4					
1.5H	+ 3.7 / - 2.1					+ 2.4 / - 1.8					
2.0H	+ 2.8 / - 1.7					+ 2.1 / - 1.5					

CIE Pub.117, 508.5 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -2.3$)
Area: 0.0012 m²

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	88	81	77	87	81	77	86	81	77	74
0.80	95	89	85	94	89	85	93	88	85	81
1.00	99	94	90	98	93	90	97	93	89	85
1.25	103	98	95	102	98	94	100	96	93	89
1.50	106	101	98	105	101	97	103	99	96	92
2.00	109	104	101	107	103	101	104	101	99	94
2.50	110	106	104	109	105	103	106	103	101	95
3.00	112	108	106	110	107	105	107	104	102	96
4.00	114	111	109	112	109	108	108	106	105	98
5.00	115	113	111	113	111	109	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 γ Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

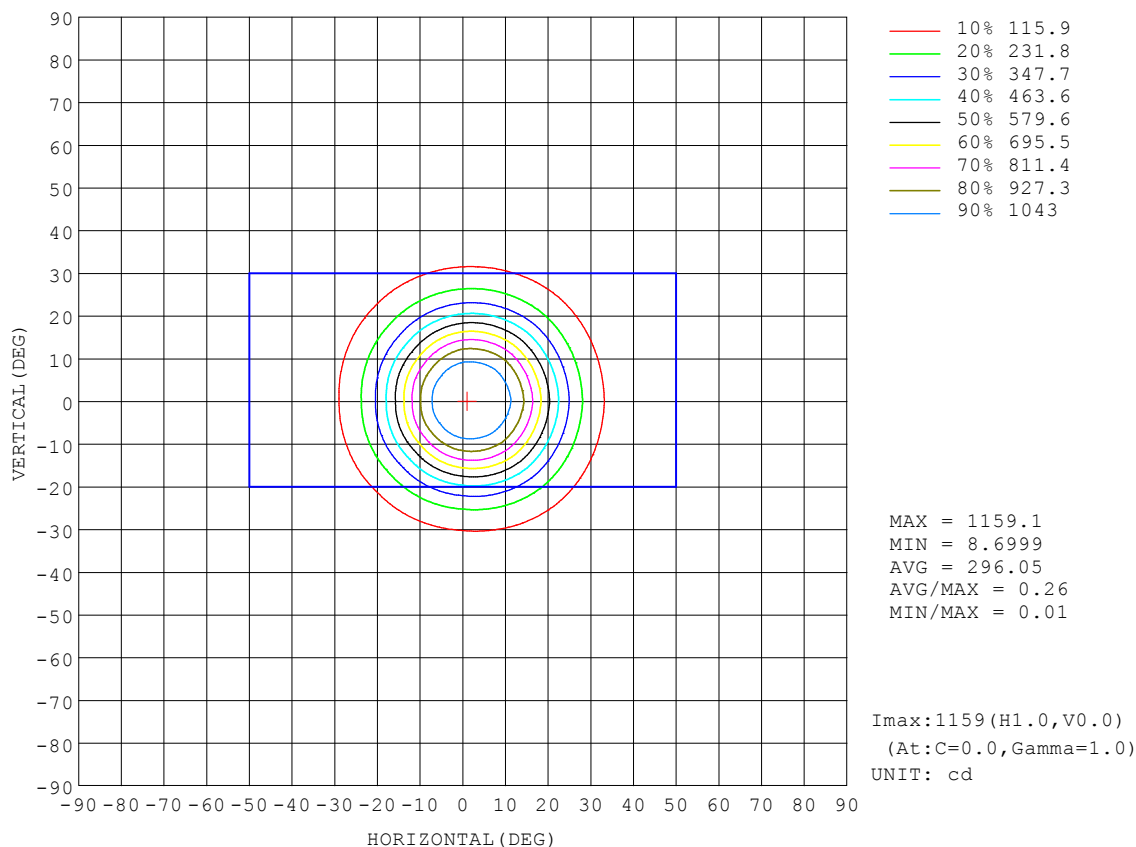


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

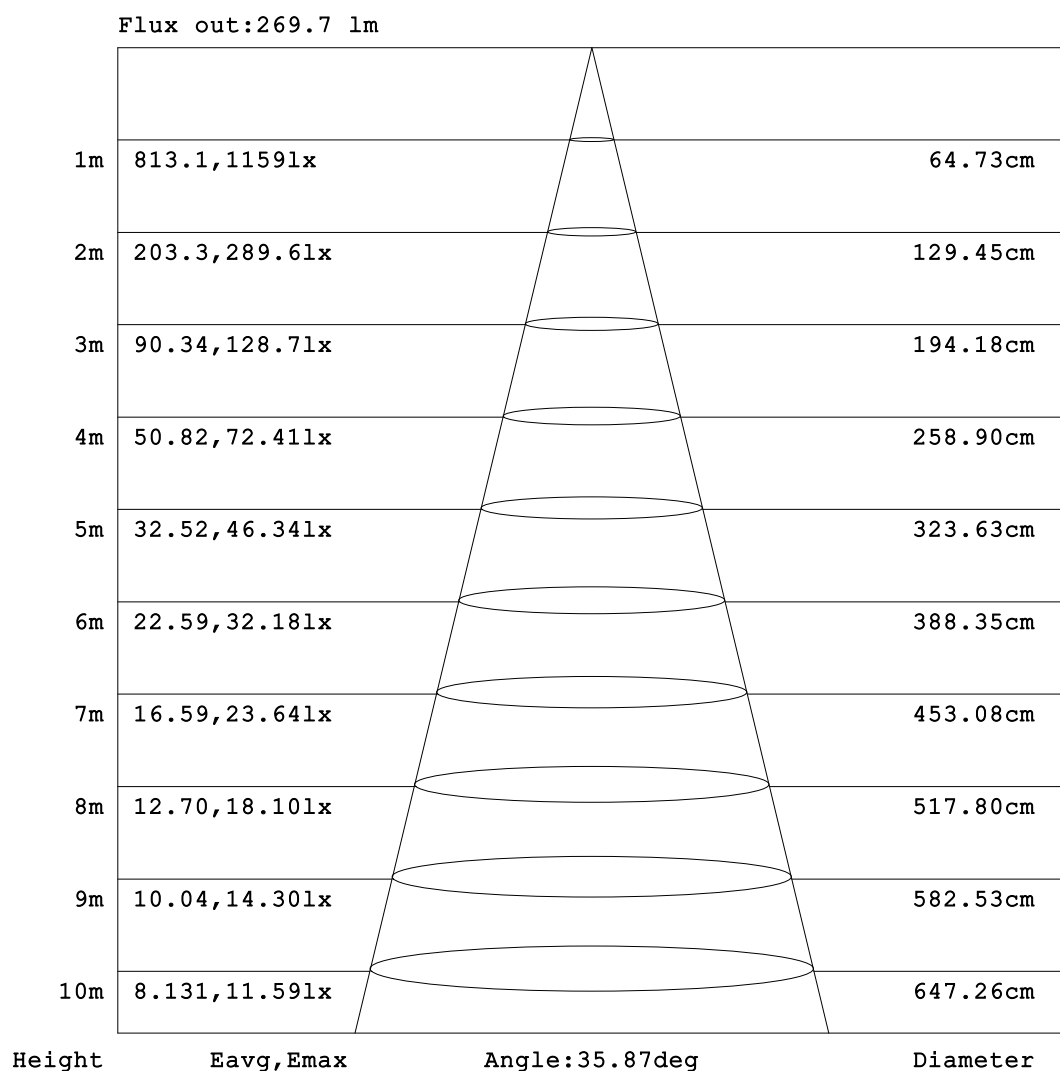


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

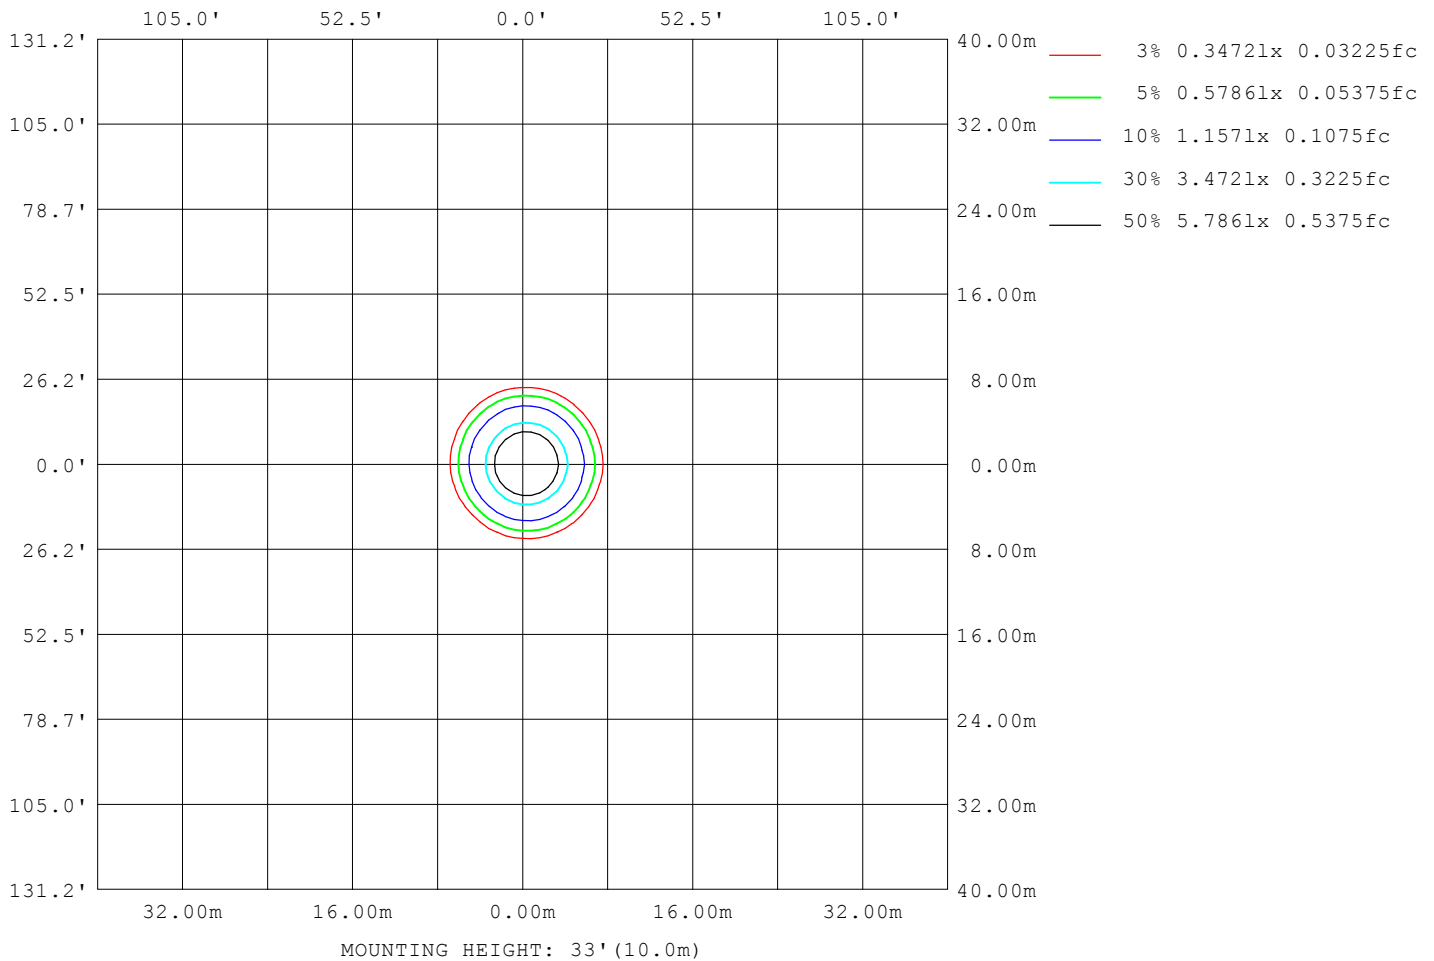

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.4V I:0.0273A P:5.7W PF:0.8744 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.89% KDisp:0.8999 Lamp Flux:508.53x1 lm		
NAME: MD16-06-XX-01 2700K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	8992
L_0~180 (75) av	3904
L_0~180 (85) av	1549
L_90~270 (65) av	9070
L_90~270 (75) av	3518
L_90~270 (85) av	1790
L_45 (65) av	8686
L_45 (75) av	3545
L_45 (85) av	1625

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

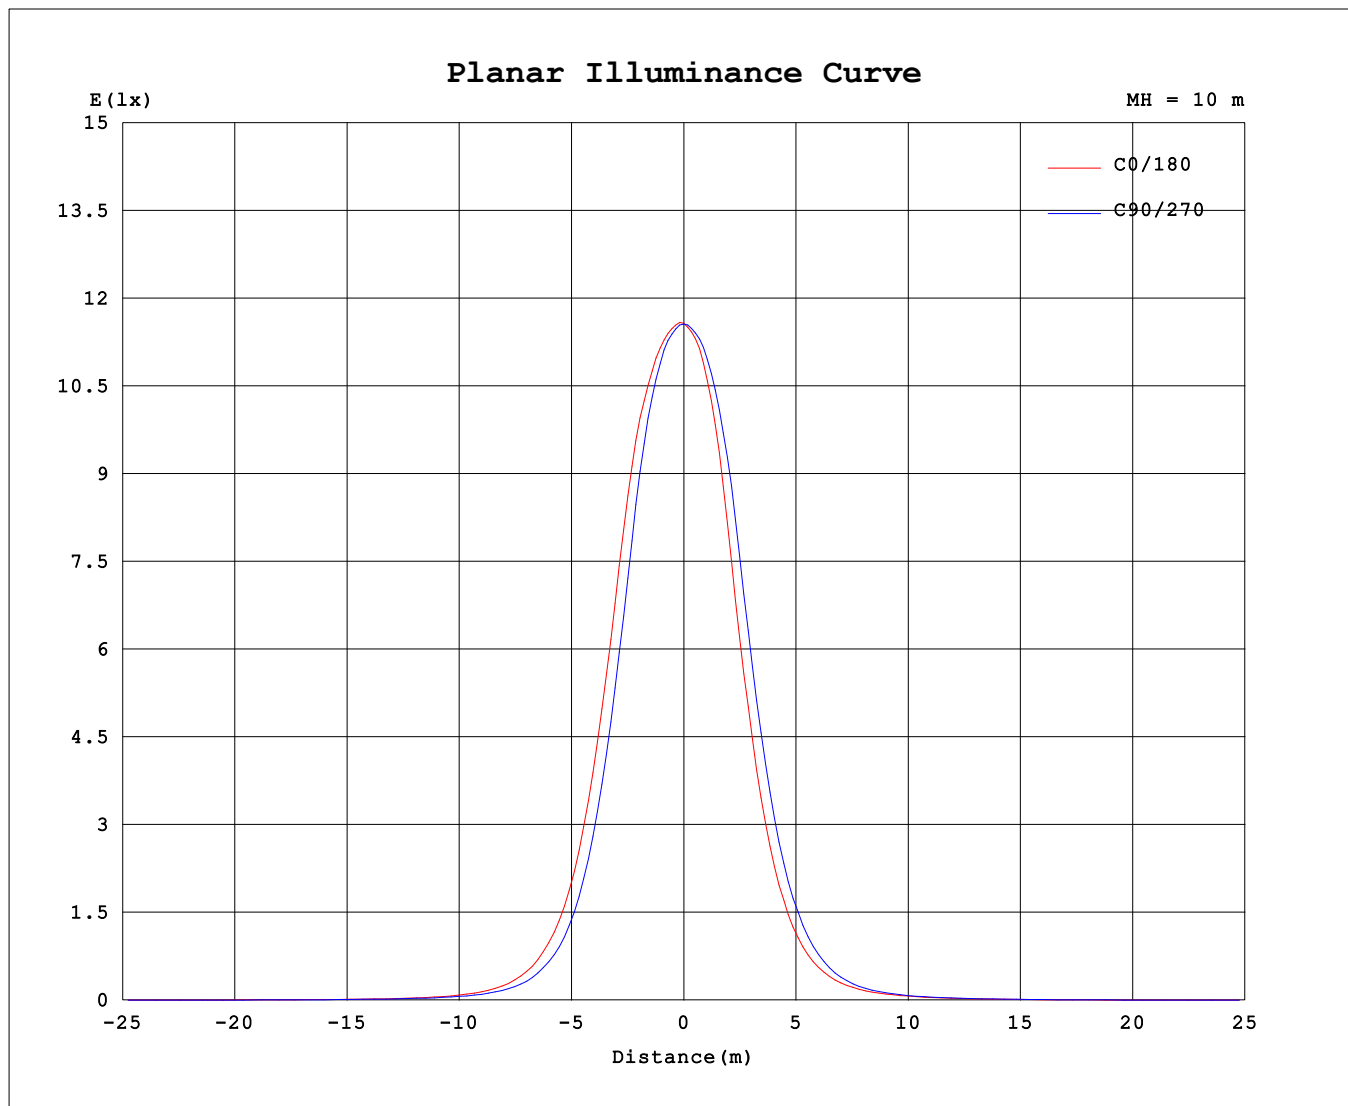

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	1156	1156	1156	1156	1156	1156	1156	1156
3.0	1152	1154	1144	1137	1135	1139	1145	1149
6.0	1132	1130	1106	1084	1076	1088	1114	1126
9.0	1090	1074	1033	989.7	969.9	997.8	1047	1080
12.0	1022	985.3	906.2	827.7	800.1	847.5	938.7	999.9
15.0	892.7	835.1	729.1	644.6	619.8	669.2	771.1	862.4
18.0	716.1	662.0	553.0	478.1	458.1	502.0	596.4	682.2
21.0	542.8	492.7	397.4	335.6	323.7	358.8	437.8	513.4
24.0	389.9	347.2	272.9	229.4	224.6	250.7	307.6	366.6
27.0	266.5	235.0	181.6	151.2	150.7	171.5	213.1	249.2
30.0	179.3	156.5	119.9	99.92	101.2	115.1	141.6	167.5
33.0	118.6	102.4	79.27	66.98	68.98	78.20	94.05	110.4
36.0	77.71	66.67	52.05	45.25	48.14	53.95	63.36	72.37
39.0	51.34	44.74	35.78	32.43	34.63	38.59	43.52	48.39
42.0	35.23	30.55	25.15	23.90	26.04	28.70	31.57	34.00
45.0	25.24	22.07	18.66	18.08	20.20	21.69	23.12	24.20
48.0	18.49	16.57	14.55	14.27	15.77	16.73	17.42	17.75
51.0	14.17	12.92	11.46	11.49	12.53	13.18	13.67	13.98
54.0	11.34	10.46	9.342	9.161	9.949	10.52	10.84	11.12
57.0	9.355	8.492	7.754	7.327	7.896	8.383	8.820	8.967
60.0	7.606	6.893	6.352	5.845	6.213	6.567	7.156	7.312
63.0	6.112	5.553	5.090	4.494	4.769	5.056	5.700	5.848
66.0	4.852	4.352	3.976	3.313	3.472	3.751	4.420	4.586
69.0	3.798	3.329	2.947	2.281	2.342	2.613	3.278	3.487
72.0	2.813	2.412	1.906	1.307	1.270	1.546	2.247	2.535
75.0	1.860	1.490	0.9537	0.6046	0.5645	0.7333	1.231	1.576
78.0	0.9532	0.6881	0.4206	0.3352	0.3388	0.3804	0.5398	0.7823
81.0	0.3922	0.3371	0.2826	0.2183	0.2236	0.2597	0.3280	0.3723
84.0	0.2566	0.2204	0.1910	0.1497	0.1475	0.1804	0.2284	0.2516
87.0	0.1796	0.1541	0.1041	0.0218	0.0045	0.0448	0.1499	0.1696
90.0	0.0944	0.0443	0.0090	0.0016	0.0058	0.0032	0.0019	0.0611

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks: