


LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019 Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 88.32 lm/W
MODEL		I _{max} (cd)	1171	S/MH(C0/180)		0.52
NOMINAL POWER(W)	6	LOR(%)	100.0	S/MH(C90/270)		0.59
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	514.21	η UP,DN(C0-180)		0.0,50.5
NOMINAL FLUX(lm)	514.206	CIE CLASS	DIRECT	η UP,DN(C180-360)		0.0,49.5
LAMPS INSIDE	1	η up(%)	0.0	CIBSE SHR NOM		0.50
TEST VOLTAGE(V)	240.33	η down(%)	100.0	CIBSE SHR MAX		0.60

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

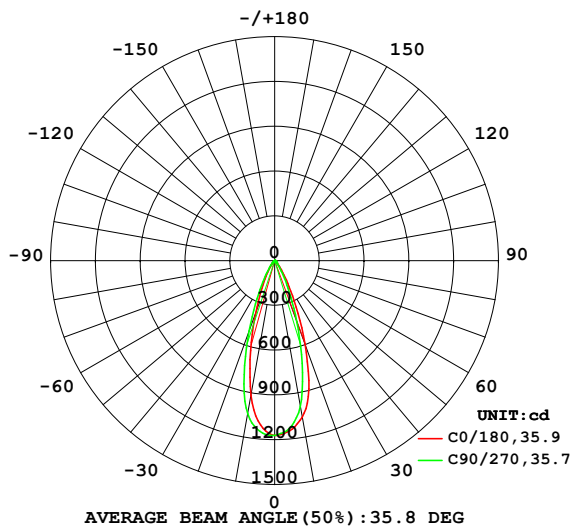

PLANAR ISOLUX DIAGRAM (UNIT: lx)

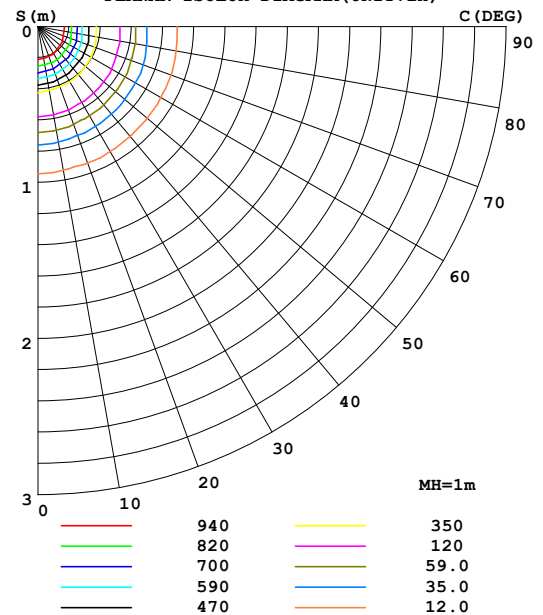

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1066	1042	991.8	931.8	916.1	971.4	1041	1072	0- 10	104.0	104.0	20.2,20.2
20	596.3	530.0	437.1	383.5	374.7	418.1	503.0	583.4	10- 20	204.5	308.5	60,60
30	177.4	154.3	122.1	108.2	107.6	118.1	145.4	173.1	20- 30	125.4	433.9	84.4,84.4
40	45.08	40.23	34.31	31.99	32.82	35.65	39.72	44.41	30- 40	46.79	480.7	93.5,93.5
50	15.50	14.75	13.83	13.17	13.80	14.60	15.52	15.47	40- 50	18.15	498.8	97,97
60	7.575	7.254	6.704	6.237	6.327	6.587	7.430	7.474	50- 60	9.117	508.0	98.8,98.8
70	3.575	3.164	2.596	2.024	1.862	2.208	3.008	3.562	60- 70	4.647	512.6	99.7,99.7
80	0.6096	0.4456	0.3270	0.2551	0.2504	0.2994	0.4001	0.5250	70- 80	1.399	514.0	100,100
90	0.1078	0.0434	0.0080	0.0055	0.0080	0.0039	0.0061	0.0862	80- 90	0.2055	514.2	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 491.53 lm

%lum = 95.6%

%lamp = 95.6%

Conical surface Flux(120deg): 507.95 lm

%lum = 98.8%


%lamp = 98.8%

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019 Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

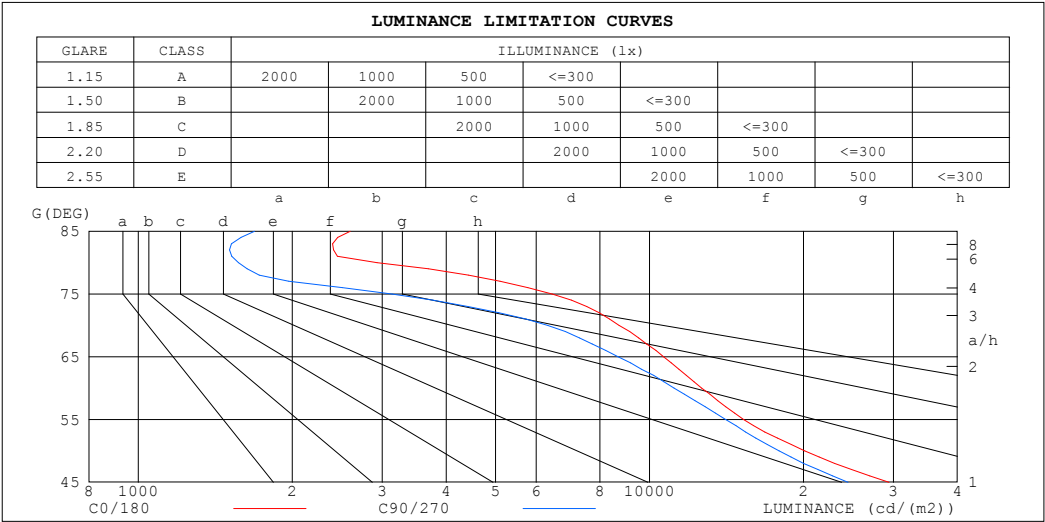

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	2596	1686
80	2929	1569
75	6448	3134
70	8722	6326
65	10658	8681
60	12640	11173
55	15277	14089
50	20118	17924
45	29405	24458


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019		
Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.12	1.09	1.07	1.09	1.07	1.06	1.05	1.04	1.02	1.02	1.00	.99	.98	.97	.96	.95
2.0	1.05	1.01	.98	1.03	.90	.97	1.00	.97	.95	.97	.95	.93	.94	.93	.91	.90
3.0	.99	.95	.91	.98	.94	.90	.95	.92	.89	.93	.90	.88	.91	.88	.86	.85
4.0	.94	.89	.85	.93	.88	.85	.91	.87	.84	.89	.85	.83	.87	.84	.82	.80
5.0	.89	.84	.80	.88	.83	.80	.86	.82	.79	.85	.81	.78	.83	.80	.78	.76
6.0	.85	.80	.76	.84	.79	.76	.83	.78	.75	.81	.77	.75	.80	.77	.74	.73
7.0	.81	.76	.72	.80	.75	.72	.79	.75	.72	.78	.74	.71	.77	.73	.71	.70
8.0	.77	.72	.69	.77	.72	.69	.76	.71	.68	.75	.71	.68	.74	.70	.68	.67
9.0	.74	.69	.66	.74	.69	.66	.73	.68	.65	.72	.68	.65	.71	.68	.65	.64
10.0	.71	.66	.63	.71	.66	.63	.70	.66	.63	.69	.65	.62	.69	.65	.62	.61

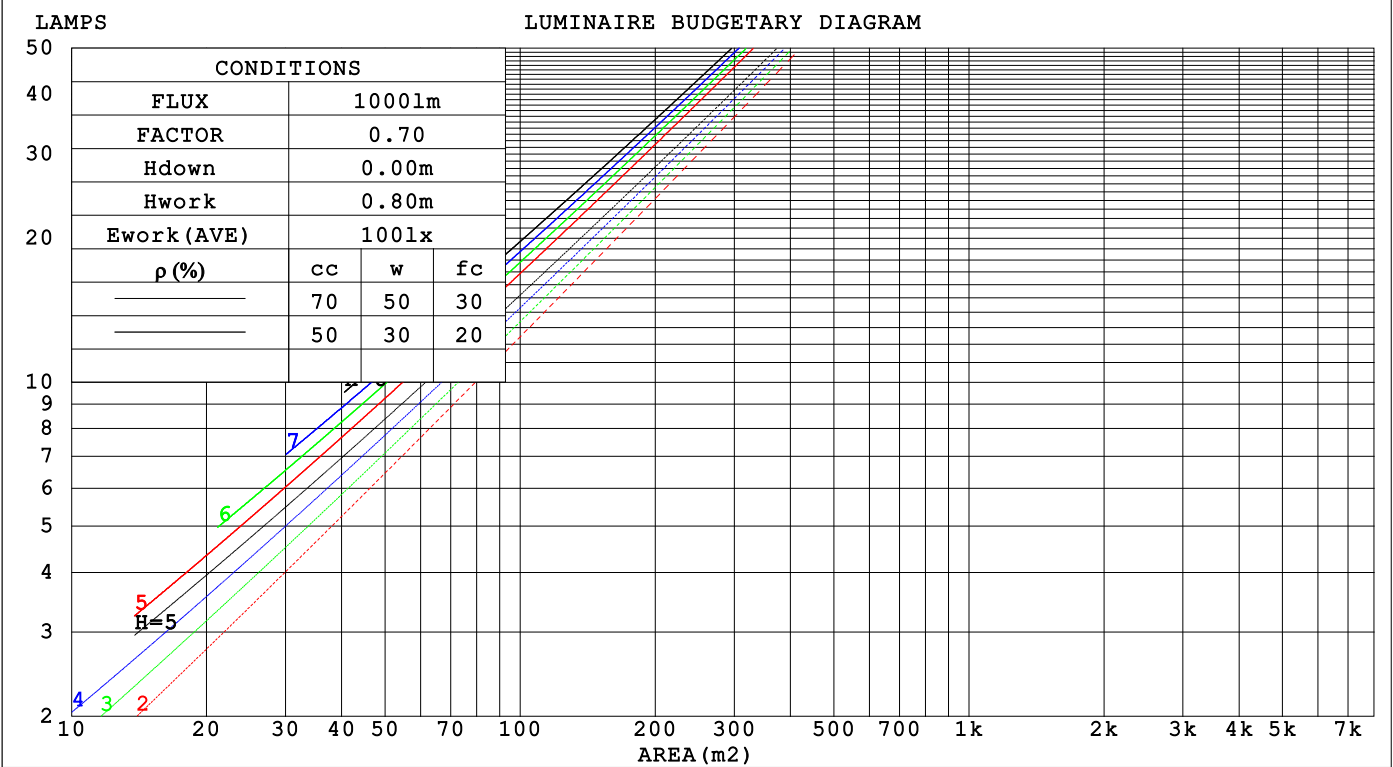

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

WEC AND CCEC

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019		Lamp Flux:514.206x1 lm
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)									
0.0																
1.0	.162	.092	.029	.155	.089	.028	.143	.082	.026	.131	.076	.024	.121	.070	.023	
2.0	.153	.084	.026	.147	.081	.025	.137	.076	.024	.127	.071	.022	.118	.067	.021	
3.0	.144	.077	.023	.140	.075	.023	.131	.071	.022	.123	.067	.021	.115	.064	.020	
4.0	.136	.071	.021	.132	.069	.020	.125	.066	.020	.118	.063	.019	.111	.060	.018	
5.0	.129	.066	.019	.126	.065	.019	.119	.062	.018	.113	.060	.018	.107	.057	.017	
6.0	.123	.061	.018	.120	.060	.017	.114	.058	.017	.109	.056	.017	.104	.055	.016	
7.0	.117	.058	.016	.114	.057	.016	.109	.055	.016	.104	.054	.016	.100	.052	.015	
8.0	.111	.054	.015	.109	.054	.015	.105	.052	.015	.101	.051	.015	.097	.050	.014	
9.0	.107	.052	.014	.105	.051	.014	.101	.050	.014	.097	.049	.014	.093	.047	.014	
10.0	.102	.049	.014	.100	.048	.014	.097	.047	.013	.093	.046	.013	.090	.045	.013	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.170	.157	.146	.146	.135	.126	.100	.093	.087	.057	.054	.051	.018	.017	.016	
2.0	.154	.133	.115	.132	.114	.099	.090	.079	.069	.052	.046	.041	.017	.015	.013	
3.0	.140	.113	.092	.120	.098	.080	.083	.068	.056	.048	.040	.033	.015	.013	.011	
4.0	.129	.098	.075	.111	.085	.065	.076	.059	.046	.044	.035	.027	.014	.011	.009	
5.0	.120	.087	.062	.103	.075	.054	.071	.052	.038	.041	.031	.023	.013	.010	.007	
6.0	.111	.077	.052	.096	.067	.045	.066	.047	.032	.038	.027	.019	.012	.009	.006	
7.0	.104	.069	.044	.090	.060	.039	.062	.042	.027	.036	.025	.016	.012	.008	.005	
8.0	.098	.063	.038	.085	.054	.033	.059	.038	.024	.034	.023	.014	.011	.007	.005	
9.0	.093	.057	.033	.080	.050	.029	.056	.035	.021	.032	.021	.012	.010	.007	.004	
10.0	.088	.053	.029	.076	.046	.025	.053	.032	.018	.031	.019	.011	.010	.006	.004	

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz											
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019					Lamp Flux:514.206x1 lm						
NAME: MD16-06-XX-01 3000K RA90 36D THU						TYPE:			WEIGHT:		
SPEC.:						DIM.:			SERIAL No.:		
MFR.: Norming lighting						SUR.: 40mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
x = 2H y = 2H		18.3	19.1	18.5	19.3	19.4	17.2	18.1	17.5	18.2	18.4
	3H	18.5	19.2	18.7	19.4	19.6	17.4	18.2	17.7	18.4	18.6
	4H	18.5	19.2	18.8	19.4	19.7	17.4	18.1	17.7	18.3	18.5
	6H	18.5	19.1	18.8	19.4	19.6	17.3	18.0	17.6	18.2	18.5
	8H	18.4	19.1	18.7	19.3	19.6	17.3	17.9	17.6	18.2	18.4
	12H	18.4	19.0	18.7	19.3	19.6	17.2	17.9	17.5	18.1	18.4
4H	2H	18.2	19.0	18.5	19.2	19.4	17.3	18.0	17.6	18.2	18.4
	3H	18.5	19.2	18.8	19.4	19.7	17.5	18.2	17.8	18.4	18.7
	4H	18.6	19.2	18.9	19.5	19.8	17.5	18.1	17.9	18.4	18.7
	6H	18.6	19.1	18.9	19.4	19.7	17.5	18.0	17.8	18.3	18.6
	8H	18.5	19.0	18.9	19.3	19.7	17.4	17.9	17.8	18.2	18.6
	12H	18.5	18.9	18.9	19.3	19.7	17.4	17.8	17.8	18.2	18.5
8H	4H	18.5	19.0	18.9	19.3	19.7	17.5	17.9	17.8	18.3	18.6
	6H	18.5	18.9	18.9	19.2	19.7	17.4	17.8	17.8	18.2	18.6
	8H	18.4	18.8	18.9	19.2	19.6	17.3	17.7	17.8	18.1	18.5
	12H	18.4	18.7	18.9	19.1	19.6	17.3	17.6	17.8	18.0	18.5
12H	4H	18.4	18.9	18.9	19.2	19.6	17.4	17.8	17.8	18.2	18.6
	6H	18.4	18.8	18.9	19.2	19.6	17.3	17.7	17.8	18.1	18.5
	8H	18.4	18.7	18.8	19.1	19.6	17.3	17.6	17.8	18.0	18.5
Variations with the observer position at spacings(CIE Pub.117):											
S = 1.0H		+ 2.1 / - 2.5					+ 1.5 / - 2.3				
1.5H		+ 3.5 / - 2.0					+ 2.4 / - 1.6				
2.0H		+ 2.6 / - 1.6					+ 2.2 / - 1.6				

CIE Pub.117, 514.2 lm Total Lamp Luminous Flux Corrected ($8\log(F/F_0) = -2.3$)
Area: 0.0012 m²

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019 Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	81	77	87	81	77	86	81	77	74
0.80	95	89	85	94	89	85	93	88	85	81
1.00	99	94	90	98	93	90	97	93	89	85
1.25	103	98	95	102	97	94	100	96	93	89
1.50	106	101	98	105	100	97	102	99	96	92
2.00	109	104	101	107	103	100	104	101	99	94
2.50	110	106	103	109	105	103	106	103	101	95
3.00	112	108	106	110	107	105	107	104	102	96
4.00	114	111	109	112	109	107	108	106	105	98
5.00	115	113	111	113	111	109	109	108	106	99
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 45.0DEG
 Test Speed: HIGH
 Temperature: 25.3DEG
 Operators: DAMIN
 Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
 Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
 Humidity: 65.0%
 Test Distance: 3.090m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019 Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

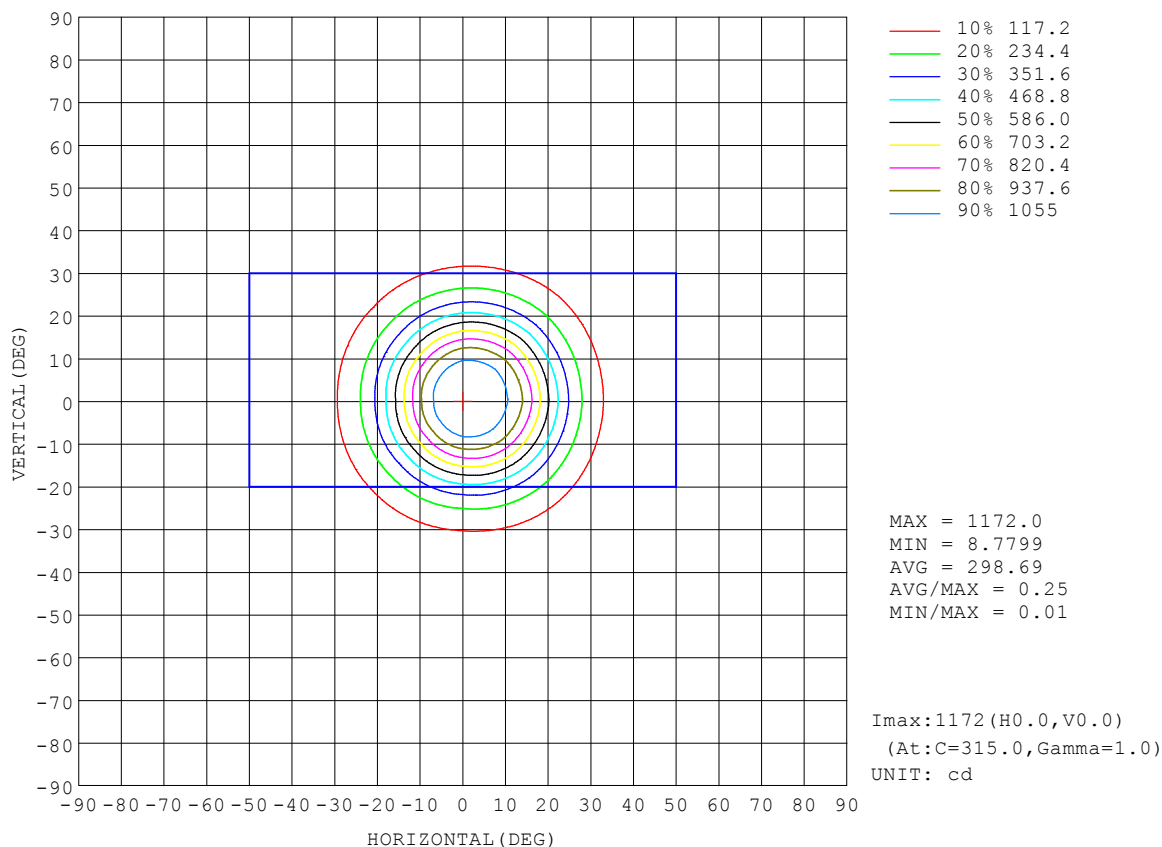


C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

AAI Figure

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019 Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

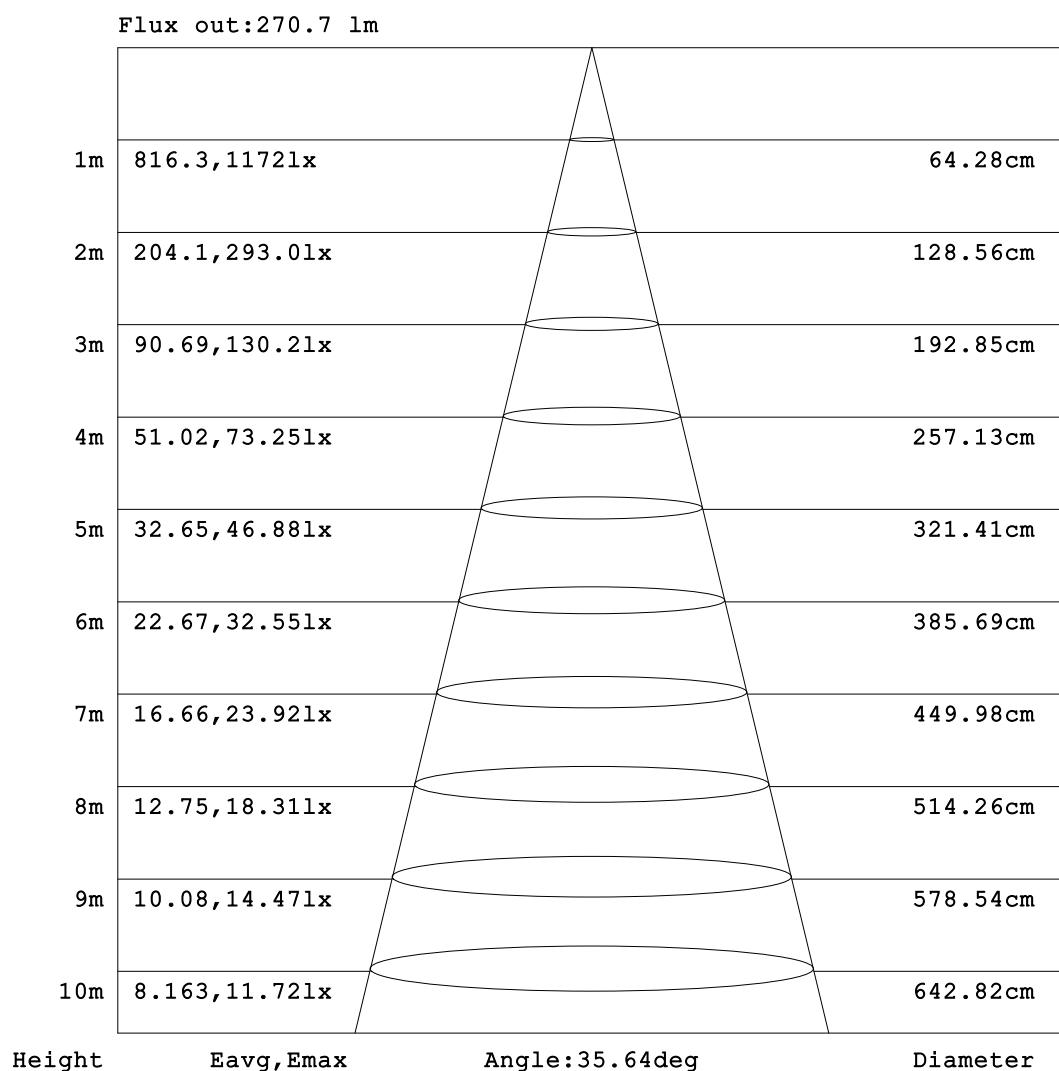


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

ISOLUX DIAGRAM

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019 Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

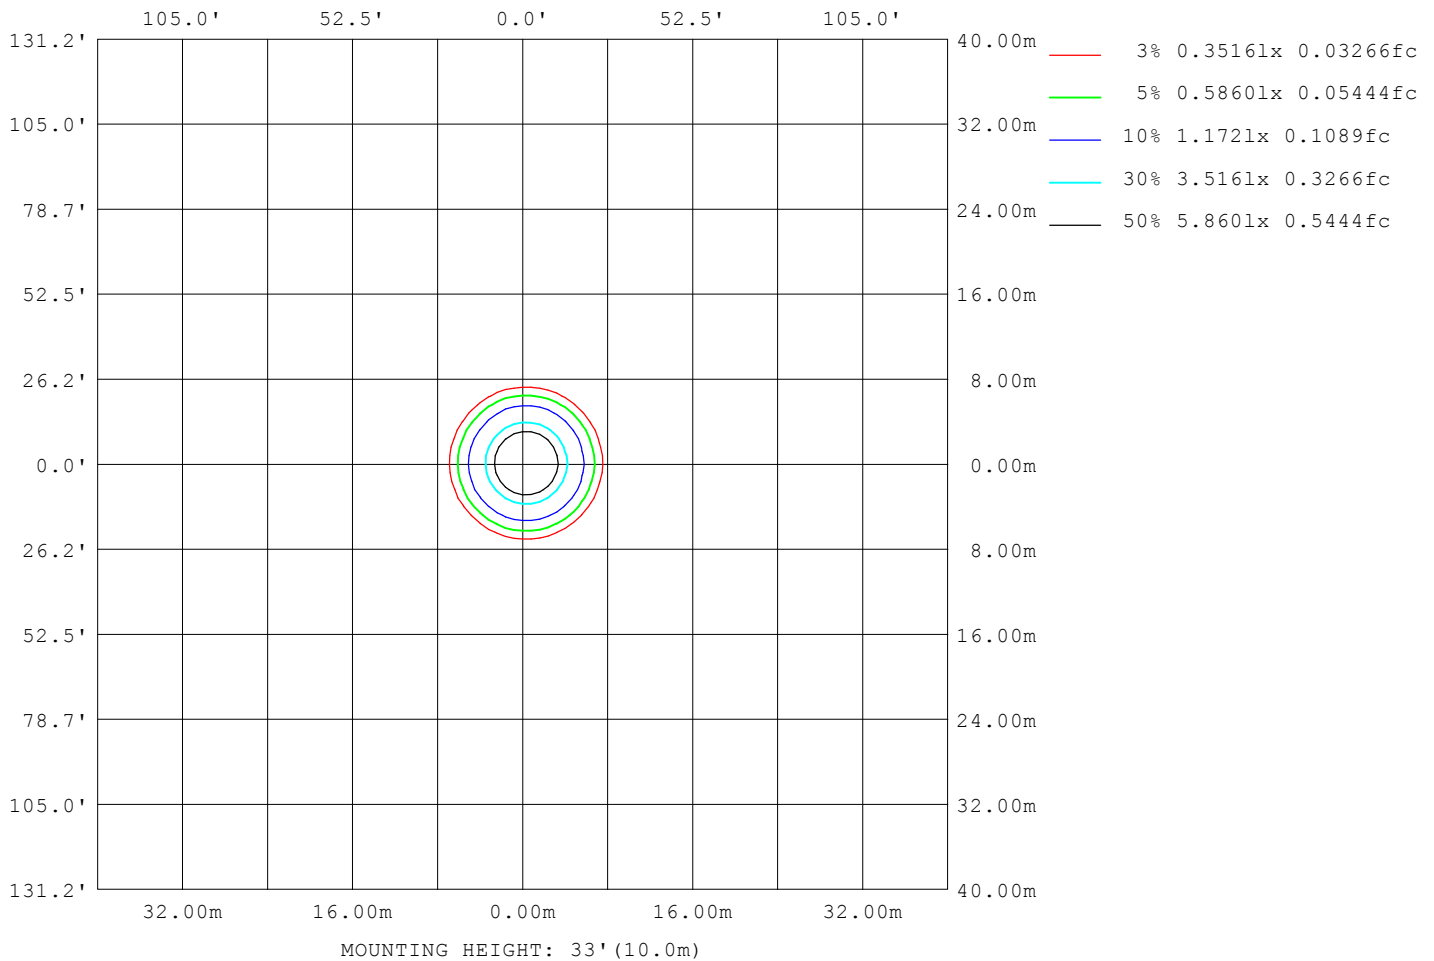

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

LED Avg.L Report

Test:U:240.4V I:0.0276A P:5.8W PF:0.8774 Freq:49.99Hz		
UTHDi:0.16% ITHDi:23.58% KDisp:0.9019 Lamp Flux:514.206x1 lm		
NAME: MD16-06-XX-01 3000K RA90 36D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	9122
L_0~180 (75) av	4079
L_0~180 (85) av	1739
L_90~270 (65) av	9235
L_90~270 (75) av	3676
L_90~270 (85) av	1831
L_45 (65) av	9075
L_45 (75) av	3853
L_45 (85) av	1745

Standard: GB/T 29293-2012

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature:25.3DEG
Operators:DAMIN
Test Date:2024-08-03

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

Planar Illuminance Curve

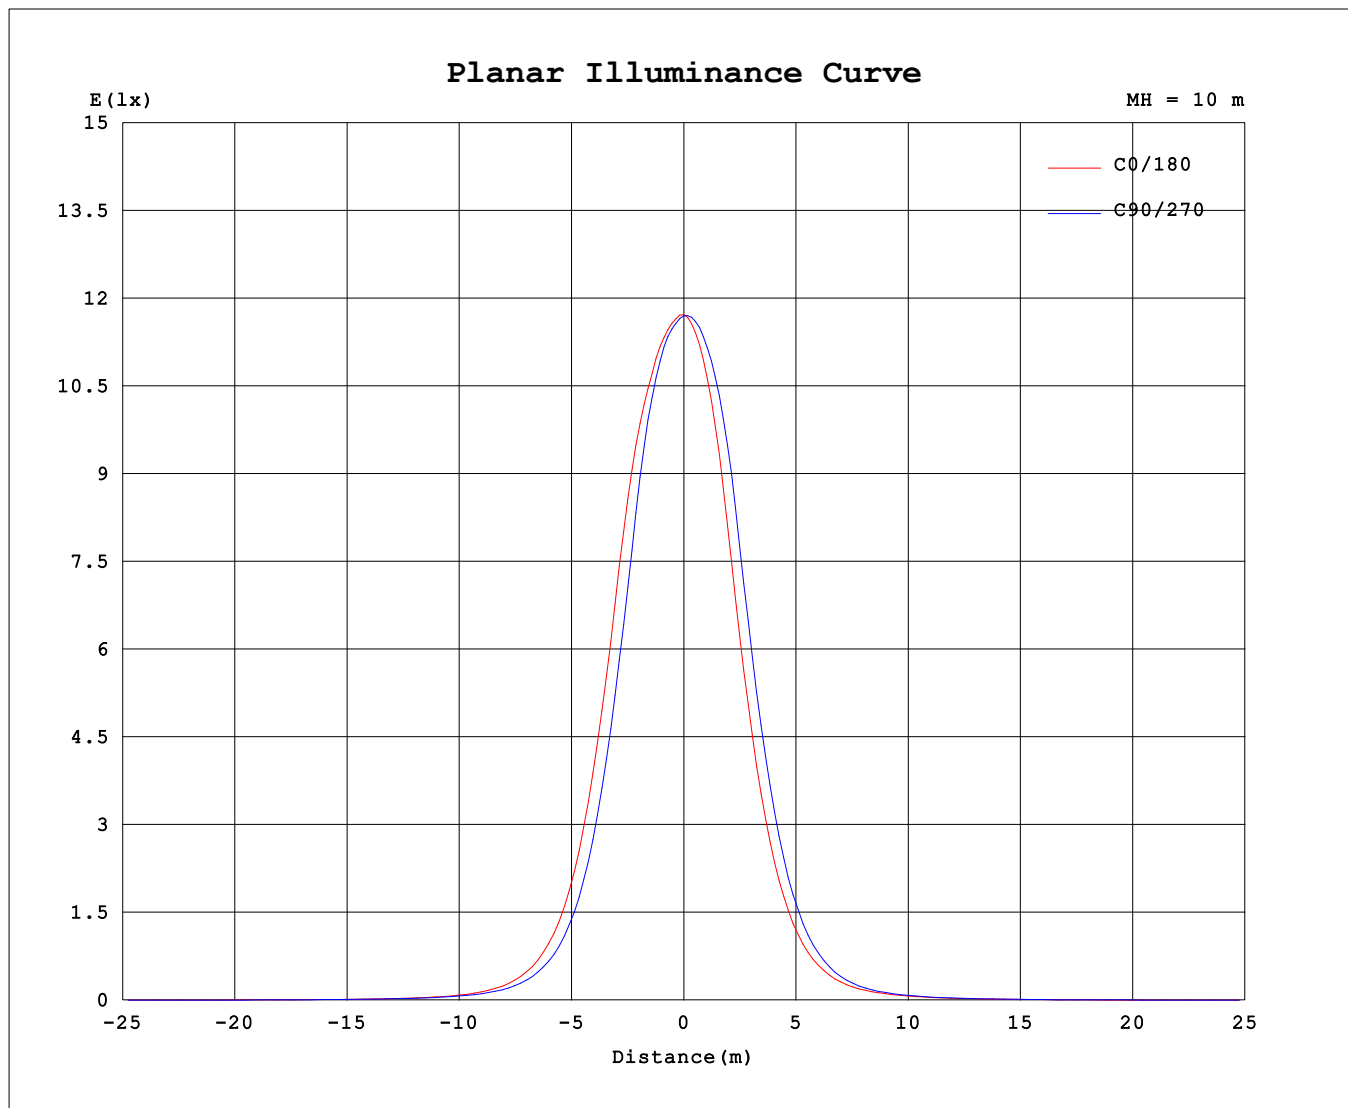

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	1171	1171	1171	1171	1171	1171	1171	1171
3.0	1161	1157	1152	1148	1145	1156	1165	1166
6.0	1135	1123	1111	1086	1079	1102	1134	1140
9.0	1084	1069	1031	980.1	967.0	1014	1072	1092
12.0	1013	975.6	890.5	816.8	799.4	865.3	961.8	1016
15.0	888.7	817.6	713.4	640.6	624.6	684.4	790.2	878.3
18.0	712.9	642.4	540.6	478.1	465.5	518.9	612.4	700.0
21.0	540.4	477.8	389.5	341.3	333.3	372.9	452.5	527.7
24.0	387.9	337.2	270.0	236.7	232.5	259.1	318.8	376.4
27.0	265.7	230.4	183.1	161.5	158.5	176.1	219.3	258.5
30.0	177.4	154.3	122.1	108.2	107.6	118.1	145.4	173.1
33.0	116.7	101.6	81.96	73.00	72.80	80.19	96.68	114.4
36.0	76.68	67.05	55.13	50.12	50.56	54.77	64.79	75.95
39.0	51.24	45.55	38.38	35.54	36.26	39.47	44.64	50.53
42.0	35.23	31.64	27.78	26.12	27.16	29.06	32.06	34.98
45.0	24.92	22.89	20.75	19.75	20.63	21.91	23.84	25.06
48.0	18.46	17.37	16.07	15.29	16.08	17.15	18.27	18.52
51.0	14.28	13.63	12.83	12.19	12.77	13.46	14.39	14.23
54.0	11.26	10.92	10.41	9.720	10.11	10.60	11.48	11.23
57.0	9.199	8.897	8.395	7.855	8.016	8.433	9.242	9.064
60.0	7.575	7.254	6.704	6.237	6.327	6.587	7.430	7.474
63.0	6.216	5.830	5.256	4.851	4.817	5.024	5.894	6.129
66.0	5.016	4.594	4.005	3.571	3.435	3.690	4.561	4.972
69.0	3.928	3.494	2.943	2.416	2.230	2.583	3.362	3.908
72.0	2.949	2.512	1.877	1.304	1.200	1.523	2.305	2.924
75.0	2.000	1.554	0.9735	0.5663	0.5336	0.7411	1.310	1.925
78.0	1.103	0.7583	0.4299	0.3376	0.3333	0.4001	0.5831	0.9679
81.0	0.4597	0.3831	0.2858	0.2241	0.2195	0.2612	0.3501	0.4255
84.0	0.3074	0.2534	0.1993	0.1513	0.1442	0.1756	0.2361	0.2857
87.0	0.2107	0.1762	0.1016	0.0096	0.0055	0.0541	0.1580	0.1954
90.0	0.1078	0.0434	0.0080	0.0055	0.0080	0.0039	0.0061	0.0862

C Range: 0 - 360DEG
C Interval: 45.0DEG
Test Speed: HIGH
Temperature: 25.3DEG
Operators: DAMIN
Test Date: 2024-08-03

γ Range: 0 - 90DEG
 γ Interval: 1.0DEG
Test System: EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity: 65.0%
Test Distance: 3.090m [K=1.0000]
Remarks: