


## LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 86.64 lm/W
MODEL		Imax (cd)	485.9	S/MH(C0/180)	0.86	
NOMINAL POWER(W)	6	LOR(%)	100.0	S/MH(C90/270)	0.93	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	503.86	$\eta$ UP,DN(C0-180)	0.0,50.3	
NOMINAL FLUX(lm)	503.862	CIE CLASS	DIRECT	$\eta$ UP,DN(C180-360)	0.0,49.7	
LAMPS INSIDE	1	$\eta$ up (%)	0.0	CIBSE SHR NOM	0.75	
TEST VOLTAGE(V)	240.34	$\eta$ down (%)	100.0	CIBSE SHR MAX	0.95	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

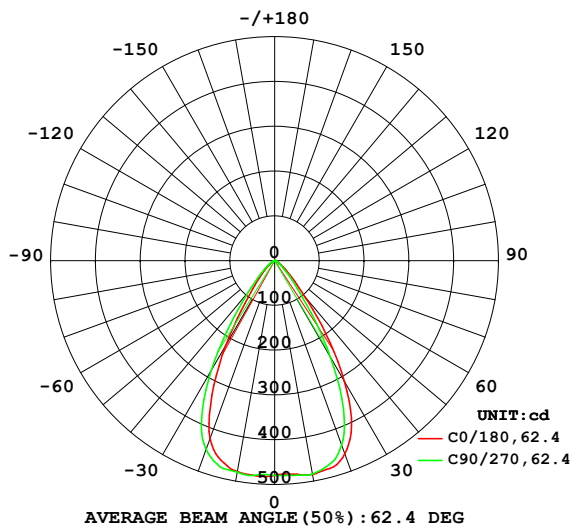

PLANAR ISOLUX DIAGRAM(UNIT:lx)

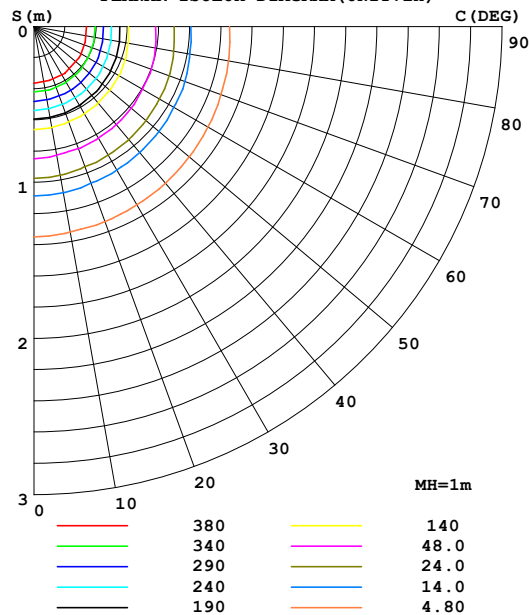

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ZONAL FLUX DIAGRAM

## ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	484.6	485.0	484.4	479.6	478.5	478.3	479.8	483.7	0- 10	45.99	45.99	9.13,9.13
20	458.5	452.0	438.5	427.9	422.4	431.2	448.2	458.5	10- 20	132.3	178.3	35.4,35.4
30	312.5	292.3	249.6	222.3	218.9	240.5	283.6	313.1	20- 30	166.9	345.3	68.5,68.5
40	105.4	91.41	72.44	63.35	63.78	72.73	91.26	103.3	30- 40	100.6	445.9	88.5,88.5
50	32.92	28.07	22.69	20.39	21.00	24.35	29.02	32.16	40- 50	37.35	483.2	95.9,95.9
60	10.70	9.165	7.192	6.477	6.860	8.010	9.459	10.49	50- 60	14.07	497.3	98.7,98.7
70	3.059	2.639	2.146	1.794	1.804	2.137	2.611	2.936	60- 70	4.910	502.2	99.7,99.7
80	0.7204	0.6298	0.5174	0.4396	0.4434	0.5213	0.6287	0.7197	70- 80	1.330	503.5	99.9,99.9
90	0.1618	0.0691	0.0074	0.0071	0.0058	0.0029	0.0013	0.1279	80- 90	0.3331	503.9	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 469 lm

%lum = 93.1%

%lamp = 93.1%

Conical surface Flux(120deg): 497.29 lm

%lum = 98.7%


%lamp = 98.7%

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

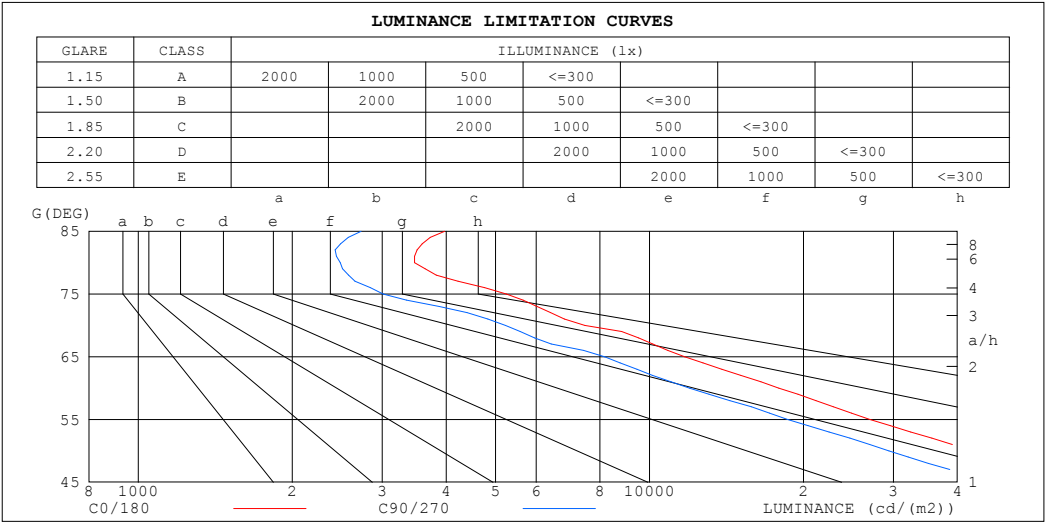

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	3974	2728
80	3467	2482
75	5251	3012
70	7474	5225
65	11711	8167
60	17891	11978
55	26990	18639
50	42804	29403
45	68534	47552


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019		
Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

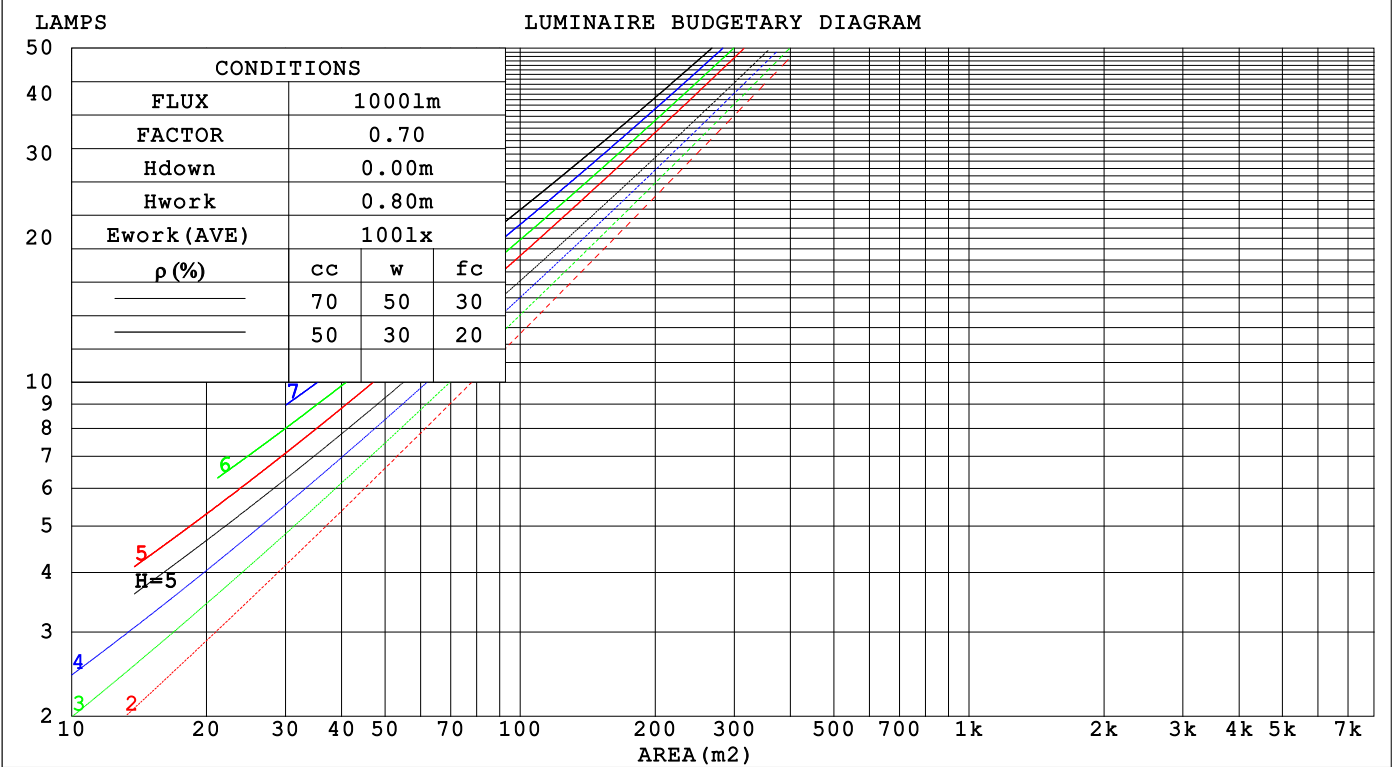

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## WEC AND CCEC

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Wall Exitance Coefficients(WEC)														
0.0																														
1.0	.186	.106	.033	.179	.102	.032	.166	.095	.030	.155	.089	.029	.144	.083	.027															
2.0	.179	.098	.030	.173	.095	.029	.162	.090	.028	.152	.086	.027	.143	.081	.026															
3.0	.170	.091	.027	.166	.089	.027	.156	.085	.026	.148	.081	.025	.140	.078	.024															
4.0	.162	.084	.025	.158	.083	.024	.150	.080	.024	.143	.077	.023	.136	.074	.023															
5.0	.155	.079	.023	.151	.077	.023	.144	.075	.022	.138	.073	.022	.132	.070	.021															
6.0	.147	.074	.021	.144	.073	.021	.138	.071	.021	.132	.069	.020	.127	.067	.020															
7.0	.141	.070	.020	.138	.069	.020	.132	.067	.019	.127	.065	.019	.123	.064	.019															
8.0	.134	.066	.018	.132	.065	.018	.127	.063	.018	.123	.062	.018	.118	.061	.018															
9.0	.129	.062	.017	.126	.062	.017	.122	.060	.017	.118	.059	.017	.114	.058	.017															
10.0	.123	.059	.016	.121	.059	.016	.117	.057	.016	.114	.056	.016	.110	.055	.016															

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.172	.157	.144	.147	.135	.124	.101	.093	.086	.058	.054	.050	.019	.017	.016	
2.0	.157	.132	.112	.135	.114	.097	.092	.079	.067	.053	.046	.039	.017	.015	.013	
3.0	.145	.114	.088	.125	.098	.077	.086	.068	.054	.049	.040	.032	.016	.013	.010	
4.0	.135	.099	.071	.116	.086	.062	.080	.060	.044	.046	.035	.026	.015	.011	.008	
5.0	.127	.088	.058	.109	.076	.051	.075	.053	.036	.044	.031	.021	.014	.010	.007	
6.0	.120	.078	.049	.103	.068	.042	.071	.048	.030	.041	.028	.018	.013	.009	.006	
7.0	.113	.071	.041	.098	.061	.036	.067	.043	.025	.039	.025	.015	.013	.008	.005	
8.0	.108	.065	.035	.093	.056	.031	.064	.039	.022	.037	.023	.013	.012	.008	.004	
9.0	.103	.060	.031	.089	.052	.027	.061	.036	.019	.036	.021	.011	.012	.007	.004	
10.0	.098	.055	.027	.085	.048	.023	.059	.034	.017	.034	.020	.010	.011	.007	.003	

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz										
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019					Lamp Flux:503.862x1 lm					
NAME: MD16-06-XX-01 3000K RA90 60D THU					TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: Norming lighting					SUR.: 40mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	23.3	24.3	23.6	24.5	24.7	22.1	23.1	22.3	23.2	23.4
3H	23.2	24.2	23.5	24.4	24.6	22.0	22.9	22.2	23.1	23.3
4H	23.2	24.0	23.5	24.3	24.5	21.9	22.7	22.2	23.0	23.2
6H	23.1	23.9	23.4	24.2	24.4	21.8	22.6	22.1	22.9	23.1
8H	23.1	23.8	23.4	24.1	24.4	21.8	22.5	22.1	22.8	23.1
12H	23.0	23.8	23.3	24.0	24.3	21.7	22.5	22.0	22.7	23.0
4H 2H	23.2	24.0	23.4	24.2	24.5	21.9	22.8	22.2	23.0	23.2
3H	23.1	23.8	23.4	24.1	24.4	21.8	22.6	22.1	22.8	23.1
4H	23.0	23.7	23.4	24.0	24.3	21.8	22.4	22.1	22.7	23.0
6H	22.9	23.5	23.3	23.9	24.2	21.7	22.3	22.0	22.6	22.9
8H	22.9	23.4	23.3	23.8	24.2	21.6	22.2	22.0	22.5	22.9
12H	22.8	23.3	23.3	23.7	24.1	21.6	22.1	22.0	22.5	22.8
8H 4H	22.9	23.4	23.3	23.8	24.1	21.6	22.2	22.0	22.5	22.9
6H	22.8	23.2	23.2	23.6	24.1	21.5	22.0	22.0	22.4	22.8
8H	22.8	23.2	23.2	23.6	24.0	21.5	21.9	21.9	22.3	22.8
12H	22.7	23.1	23.2	23.5	24.0	21.5	21.8	21.9	22.2	22.7
12H 4H	22.8	23.3	23.2	23.7	24.1	21.6	22.1	22.0	22.5	22.8
6H	22.7	23.1	23.2	23.6	24.0	21.5	21.9	21.9	22.3	22.8
8H	22.7	23.0	23.2	23.5	24.0	21.5	21.8	21.9	22.2	22.7
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 3.0 / - 5.3					+ 2.2 / - 5.4				
1.5H	+ 4.5 / - 4.4					+ 3.3 / - 3.6				
2.0H	+ 4.6 / - 4.4					+ 3.9 / - 4.0				

CIE Pub.117, 503.9 lm Total Lamp Luminous Flux Corrected ( $8\log(F/F_0) = -2.4$ )  
Area: 0.0012 m<sup>2</sup>

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	84	77	73	84	77	73	83	77	73	69
0.80	92	86	82	91	85	82	90	85	81	77
1.00	97	91	87	96	91	87	95	91	86	82
1.25	102	96	92	101	95	92	99	94	91	87
1.50	105	99	96	103	99	95	101	97	94	90
2.00	108	103	100	106	102	99	103	100	98	92
2.50	109	105	102	108	104	101	105	102	99	93
3.00	111	108	105	109	106	104	106	103	101	95
4.00	113	110	108	111	109	107	108	106	104	97
5.00	115	112	110	112	110	109	108	107	105	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 $\gamma$  Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

## ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

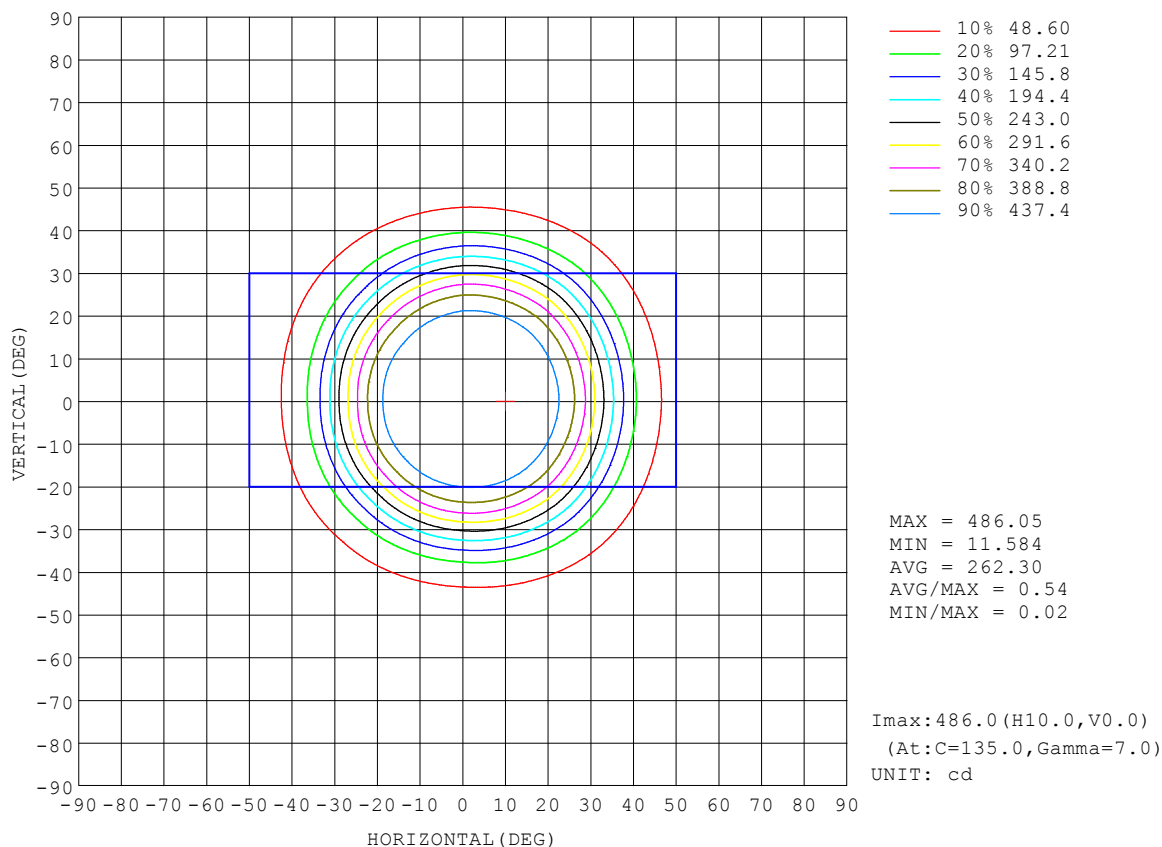


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:



## AAI Figure

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

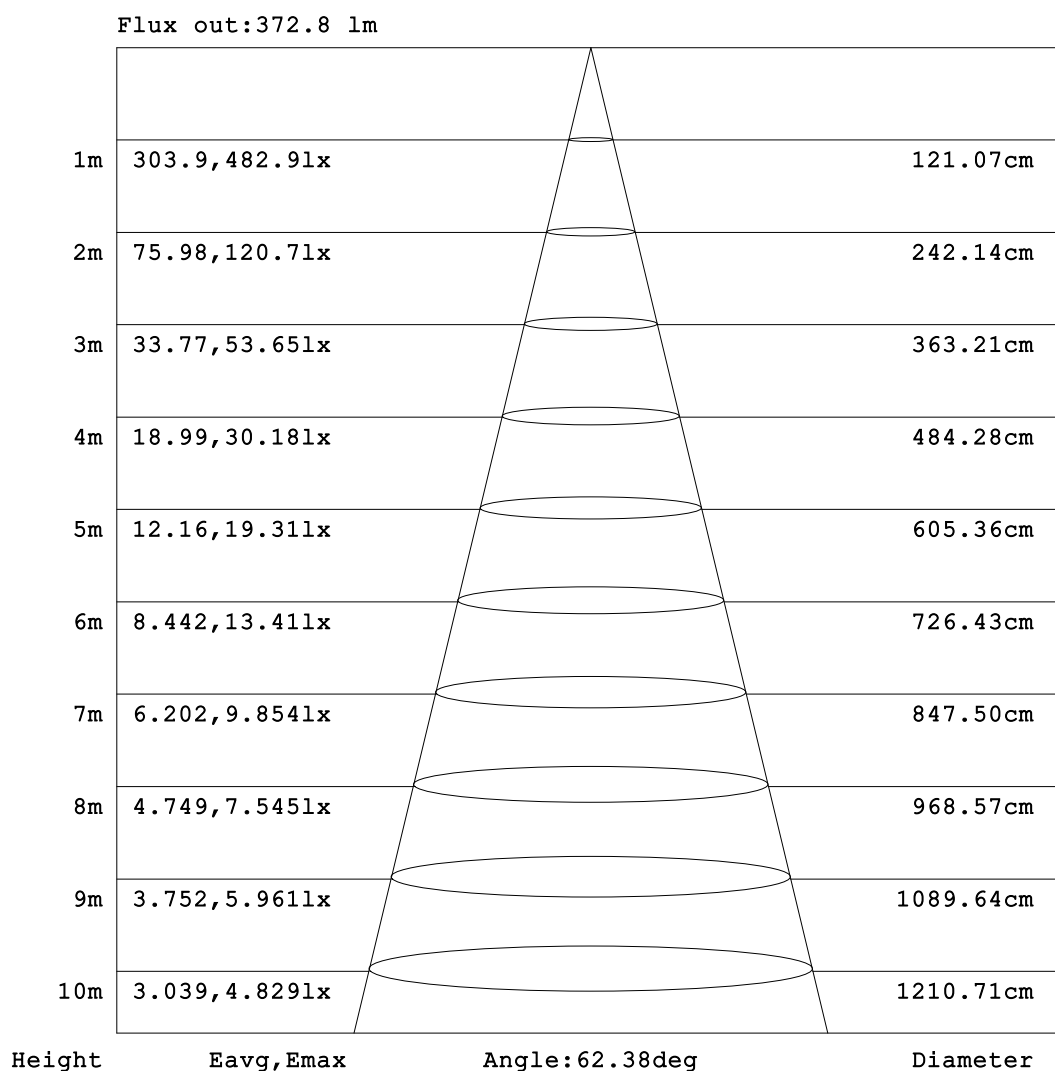


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ISOLUX DIAGRAM

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz		
UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:

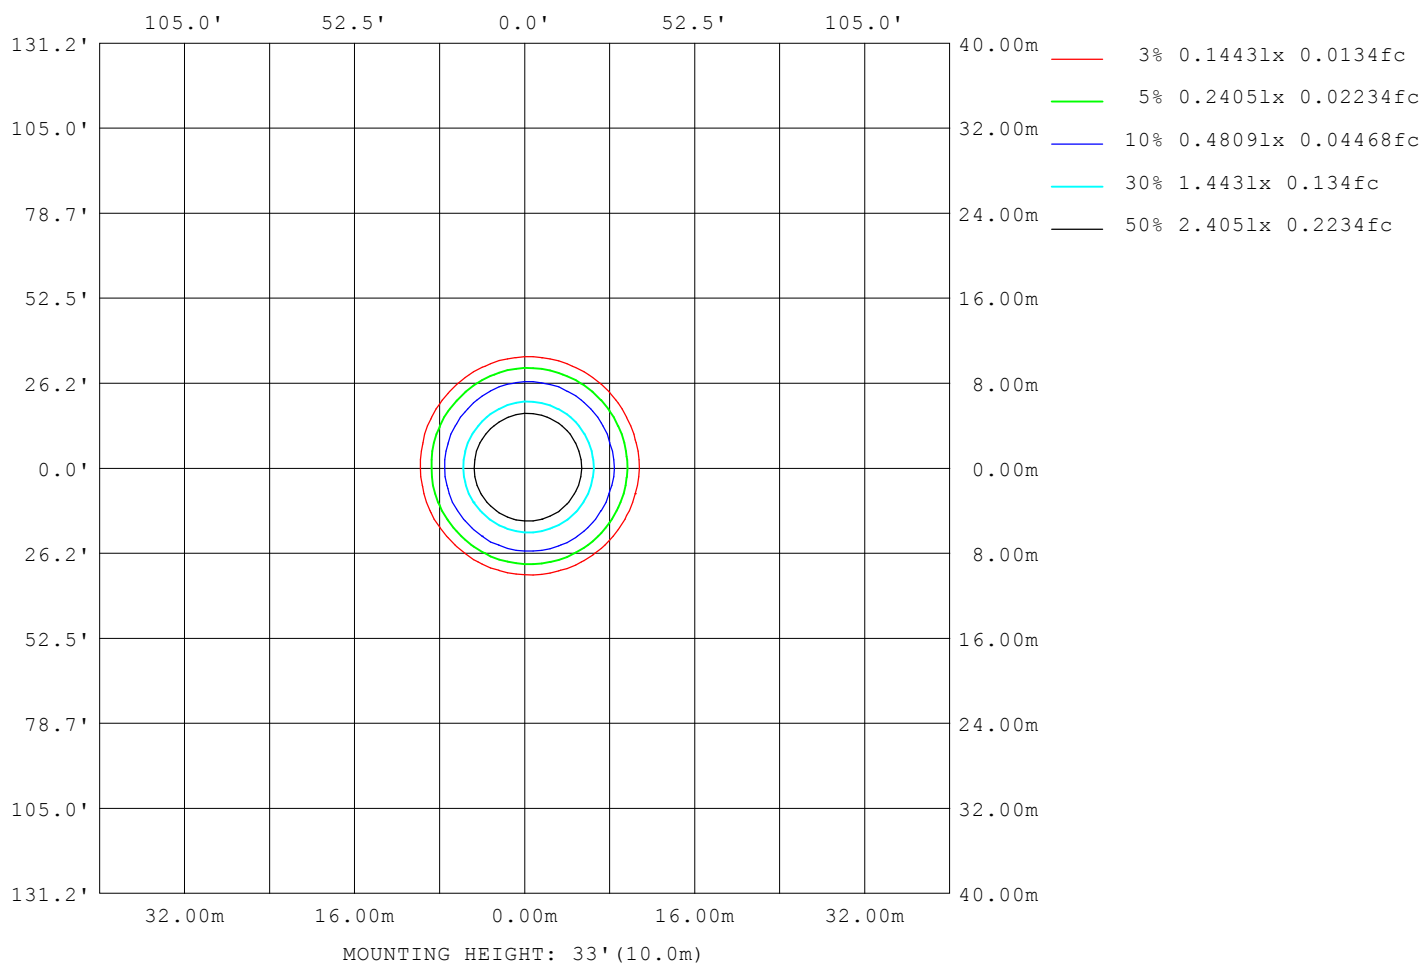

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## LED Avg.L Report

Test:U:240.4V I:0.0276A P:5.8W PF:0.8773 Freq:49.99Hz UTHDi:0.17% ITHDi:23.57% KDisp:0.9019 Lamp Flux:503.862x1 lm		
NAME: MD16-06-XX-01 3000K RA90 60D THU	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 40mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	9268
L_0~180 (75) av	3854
L_0~180 (85) av	2794
L_90~270 (65) av	9297
L_90~270 (75) av	3481
L_90~270 (85) av	3116
L_45 (65) av	9411
L_45 (75) av	3726
L_45 (85) av	3027

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-08-03

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

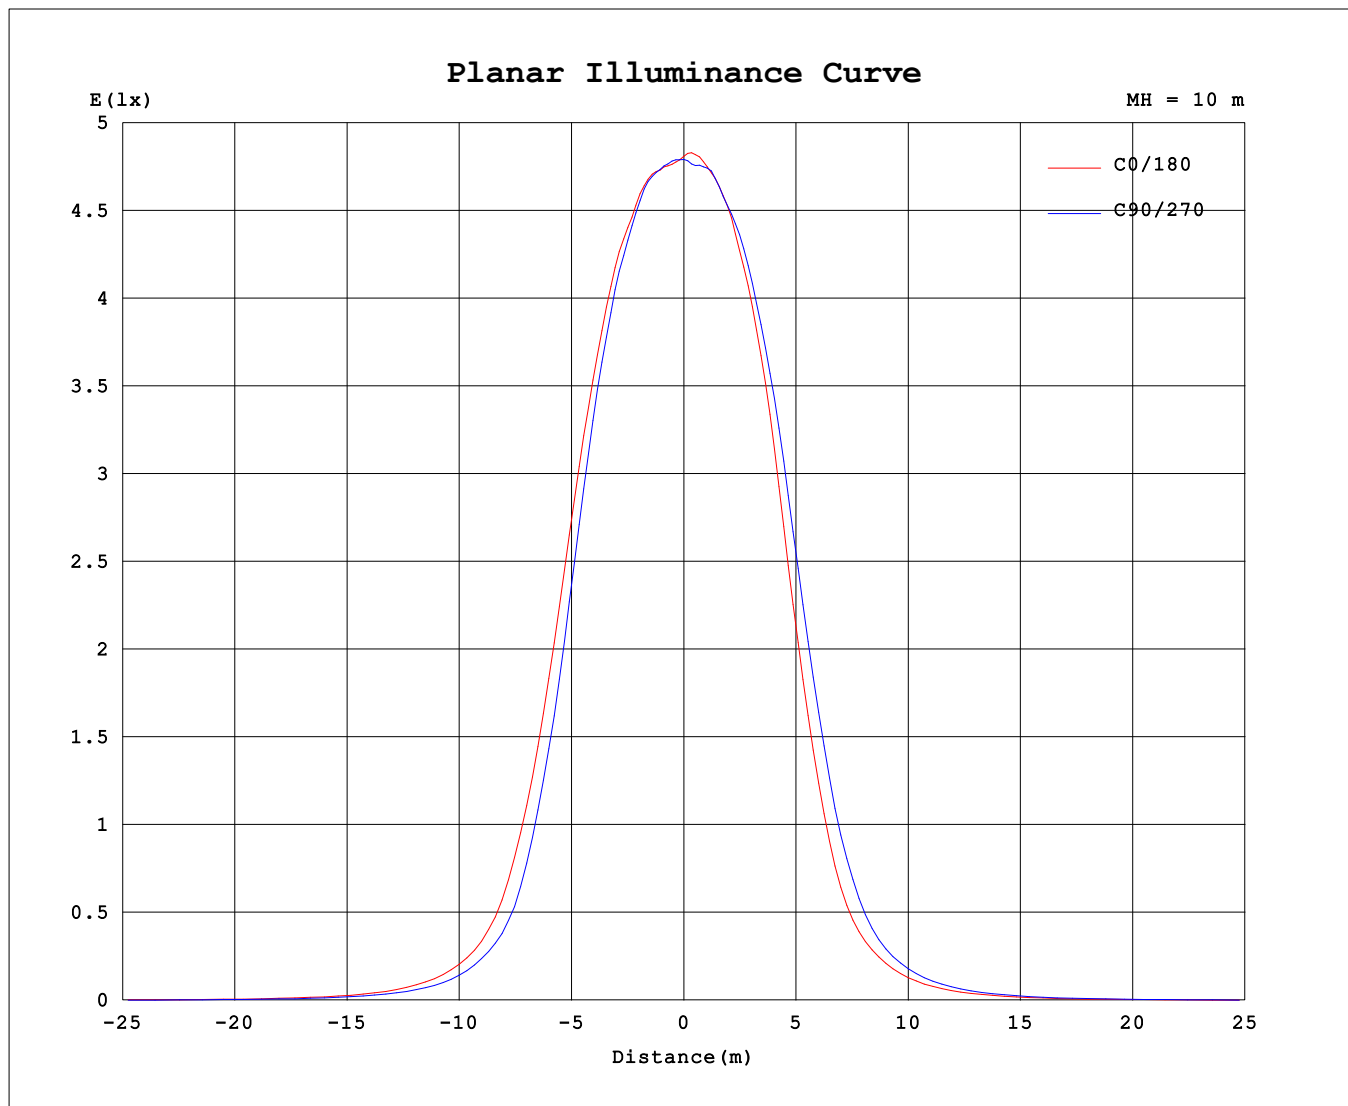

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

## Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	479.5	479.5	479.5	479.5	479.5	479.5	479.5	479.5
3.0	476.9	480.1	480.6	483.0	482.4	481.4	478.0	476.8
6.0	479.6	483.3	481.6	485.5	481.5	481.2	482.3	481.3
9.0	484.0	485.1	484.6	481.1	479.6	479.8	481.3	482.9
12.0	482.7	484.1	479.8	476.1	474.9	475.6	478.9	484.2
15.0	480.0	477.8	471.2	465.9	462.2	466.9	475.5	478.0
18.0	471.4	465.4	455.8	447.7	442.7	449.9	461.7	470.5
21.0	450.7	442.7	428.0	414.5	409.2	419.1	439.4	451.2
24.0	420.6	407.7	382.5	359.9	352.8	371.6	403.4	421.8
27.0	373.8	356.4	321.0	293.8	287.4	309.8	348.2	373.6
30.0	312.5	292.3	249.6	222.3	218.9	240.5	283.6	313.1
33.0	244.3	224.3	184.1	157.3	153.2	173.9	214.9	243.1
36.0	179.9	160.5	122.4	102.6	101.8	118.7	152.5	177.7
39.0	121.5	104.6	81.11	71.10	71.21	81.56	104.2	119.3
42.0	81.76	71.42	58.01	49.77	51.15	58.38	71.40	80.23
45.0	57.98	50.11	40.38	35.75	36.41	42.11	51.09	56.65
48.0	41.17	35.08	28.19	25.44	26.24	30.21	36.31	40.25
51.0	29.46	25.09	20.39	18.03	18.96	21.65	25.98	28.78
54.0	20.81	17.97	14.40	12.94	13.68	15.66	18.64	20.33
57.0	14.90	12.92	10.34	9.208	9.761	11.26	13.38	14.59
60.0	10.70	9.165	7.192	6.477	6.860	8.010	9.459	10.49
63.0	7.522	6.500	5.151	4.681	4.931	5.685	6.643	7.382
66.0	5.281	4.689	3.630	2.938	2.983	3.645	4.751	5.223
69.0	3.781	3.031	2.404	2.062	2.084	2.433	2.936	3.479
72.0	2.368	2.099	1.630	1.234	1.226	1.573	2.045	2.334
75.0	1.626	1.369	0.9361	0.7691	0.7678	0.9203	1.226	1.571
78.0	0.9519	0.8104	0.6433	0.5551	0.5603	0.6401	0.7832	0.9269
81.0	0.6496	0.5617	0.4583	0.3946	0.3991	0.4620	0.5711	0.6447
84.0	0.4657	0.3912	0.3233	0.2795	0.2783	0.3348	0.4100	0.4667
87.0	0.3330	0.2723	0.1535	0.0278	0.0039	0.0863	0.2866	0.3353
90.0	0.1618	0.0691	0.0074	0.0071	0.0058	0.0029	0.0013	0.1279

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-08-03

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks: