


## LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.06% KDisp:0.9483		Lamp Flux:1124.3lx1 lm
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D	LOWTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 113.18 lm/W			
MODEL		Imax (cd)	2722	S/MH(C0/180)	0.43
NOMINAL POWER(W)	10	LOR(%)	100.0	S/MH(C90/270)	0.43
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	1124.3	$\eta$ UP,DN(C0-180)	0.0,49.2
NOMINAL FLUX(lm)	1124.31	CIE CLASS	DIRECT	$\eta$ UP,DN(C180-360)	0.0,50.8
LAMPS INSIDE	1	$\eta$ up (%)	0.0	CIBSE SHR NOM	0.50
TEST VOLTAGE(V)	240.38	$\eta$ down (%)	100.0	CIBSE SHR MAX	0.50

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

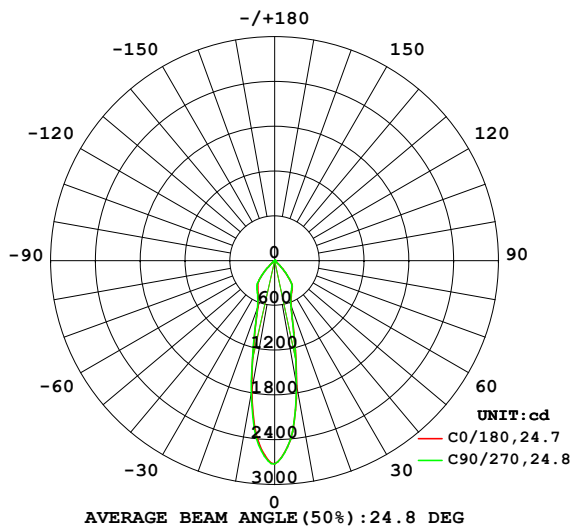

PLANAR ISOLUX DIAGRAM(UNIT:lx)

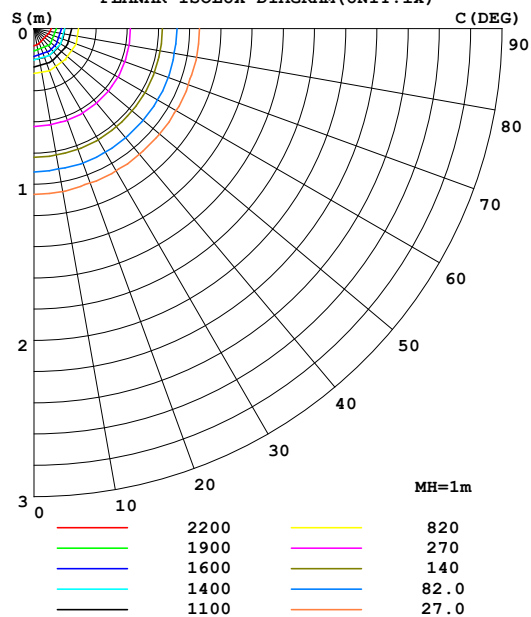

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ZONAL FLUX DIAGRAM

## ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	1704	1681	1683	1730	1767	1799	1809	1746	0- 10	210.1	210.1	18.7,18.7
20	653.9	647.8	643.1	650.9	664.0	673.0	681.4	668.2	10- 20	291.7	501.8	44.6,44.6
30	464.3	460.8	456.8	456.6	458.4	462.0	470.7	469.6	20- 30	246.6	748.4	66.6,66.6
40	285.5	284.0	284.4	293.8	297.8	302.1	302.2	289.9	30- 40	247.7	996.1	88.6,88.6
50	25.44	22.99	22.84	25.30	26.61	28.87	29.03	25.99	40- 50	106.0	1102	98,98
60	6.441	6.123	6.047	6.140	6.050	6.291	6.460	6.379	50- 60	11.25	1113	99,99
70	4.219	4.233	3.983	3.859	3.904	3.913	4.084	4.168	60- 70	4.758	1118	99.4,99.4
80	4.149	4.339	4.371	3.927	3.967	4.092	4.221	4.038	70- 80	4.100	1122	99.8,99.8
90	0.0375	0.0273	0.0408	0.0293	0.0279	0.0292	0.0373	0.0258	80- 90	2.116	1124	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1073.9 lm

%lum = 95.5%

%lamp = 95.5%

Conical surface Flux(120deg): 1113.3 lm

%lum = 99.0%


%lamp = 99.0%

C Range: 0 - 360DEG  
 C Interval: 45.0DEG  
 Test Speed: HIGH  
 Temperature:25.3DEG  
 Operators:DAMIN  
 Test Date:2024-10-17

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
 Humidity:65.0%  
 Test Distance:3.090m [K=1.0000]  
 Remarks:

## LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz			Lamp Flux:1124.31x1 lm		
UTHDi:0.17% ITHDi:19.06% KDisp:0.9483					
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D			LOWTYPE:		WEIGHT:
SPEC.:			DIM.:		SERIAL No.:
MFR.: Norming lighting			SUR.: 41mm		Shielding Angle:

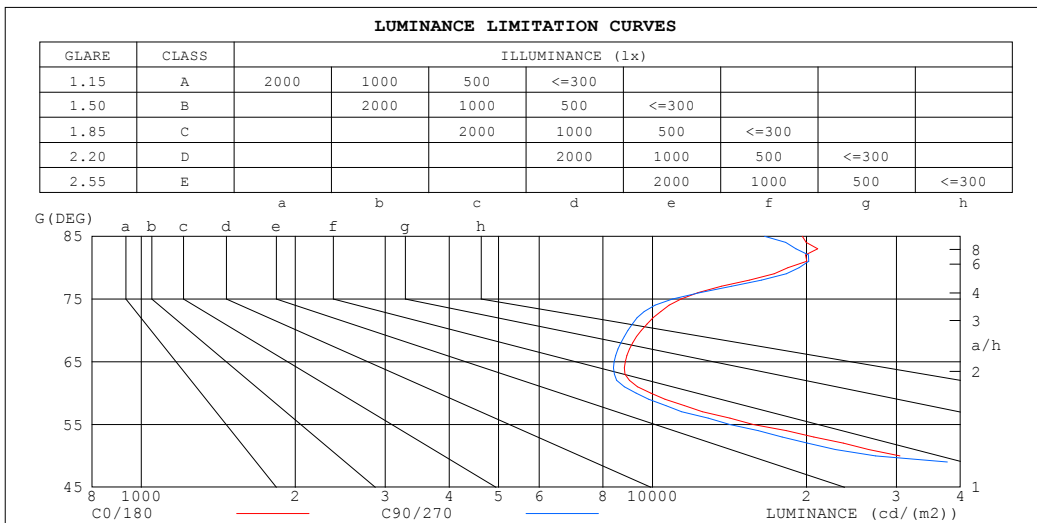

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	19646	16565
80	18411	19344
75	11365	10931
70	9504	8950
65	8842	8407
60	9926	9294
55	15740	14164
50	30499	27303
45	136751	134010


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.06% KDisp:0.9483		Lamp Flux:1124.3lx1 lm
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D	10WTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

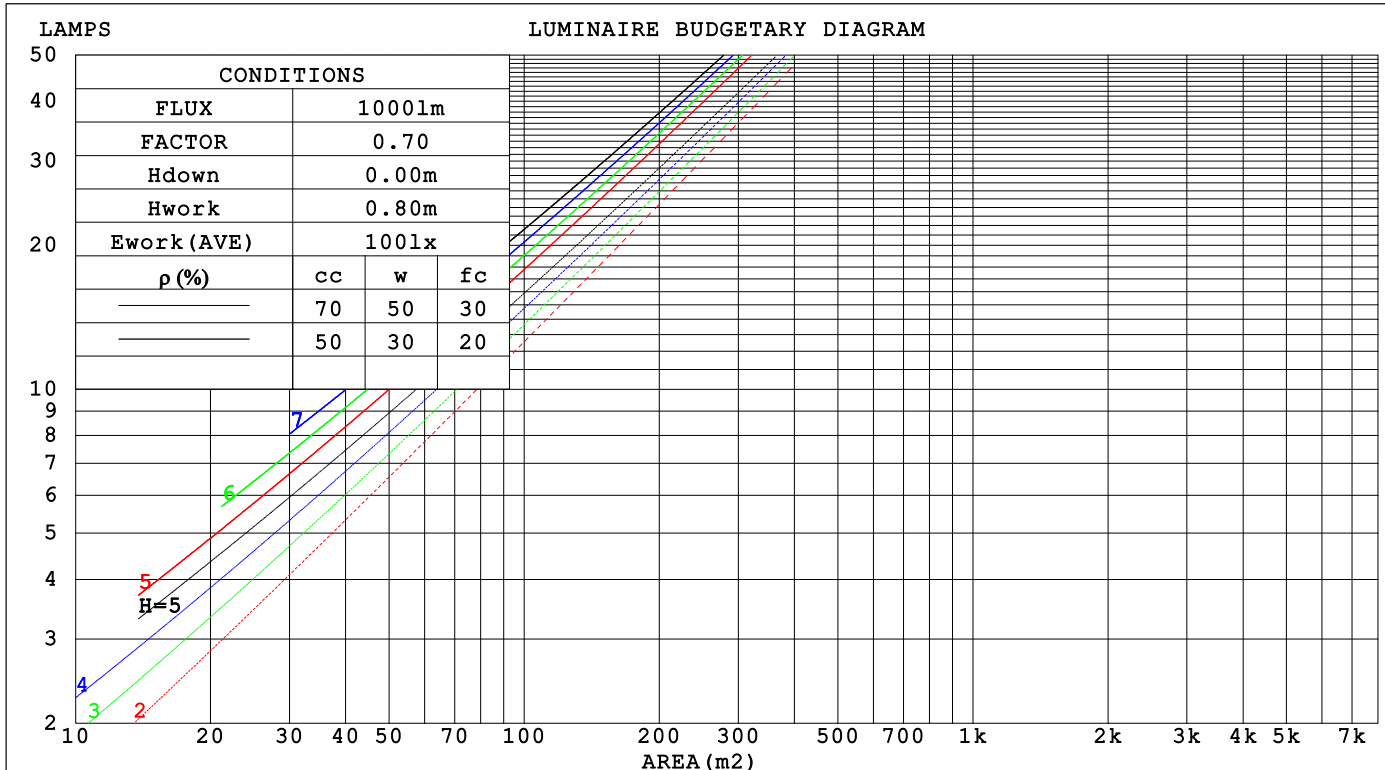

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-17

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

### WEC AND CCEC

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz			UTHDi:0.17% ITHDi:19.06% KDisp:0.9483			Lamp Flux:1124.31x1 lm		
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D			LOWTYPE:			WEIGHT:		
SPEC.:			DIM.:			SERIAL No.:		
MFR.: Norming lighting			SUR.: 41mm			Shielding Angle:		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.177	.101	.032	.171	.097	.031	.158	.091	.029	.147	.085	.027	.136	.079	.025		
2.0	.169	.093	.028	.164	.090	.028	.153	.085	.026	.143	.080	.025	.134	.076	.024		
3.0	.161	.086	.026	.156	.084	.025	.147	.080	.024	.139	.076	.023	.131	.072	.022		
4.0	.153	.079	.023	.149	.078	.023	.141	.075	.022	.134	.072	.022	.127	.069	.021		
5.0	.145	.074	.021	.142	.073	.021	.135	.070	.021	.128	.068	.020	.123	.066	.020		
6.0	.138	.069	.020	.135	.068	.020	.129	.066	.019	.124	.064	.019	.118	.062	.018		
7.0	.132	.065	.018	.129	.064	.018	.124	.063	.018	.119	.061	.018	.114	.059	.017		
8.0	.126	.061	.017	.123	.061	.017	.119	.059	.017	.114	.058	.017	.110	.056	.016		
9.0	.120	.058	.016	.118	.057	.016	.114	.056	.016	.110	.055	.016	.106	.054	.016		
10.0	.115	.055	.015	.113	.055	.015	.109	.054	.015	.106	.052	.015	.102	.051	.015		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.171	.157	.145	.146	.135	.125	.100	.093	.086	.058	.054	.050	.018	.017	.016		
2.0	.156	.133	.113	.134	.114	.098	.092	.079	.068	.053	.046	.040	.017	.015	.013		
3.0	.143	.114	.090	.123	.098	.078	.084	.068	.055	.049	.040	.032	.016	.013	.011		
4.0	.133	.099	.073	.114	.085	.063	.079	.060	.044	.045	.035	.026	.015	.011	.009		
5.0	.124	.087	.060	.107	.075	.052	.074	.053	.037	.043	.031	.022	.014	.010	.007		
6.0	.117	.078	.050	.100	.067	.044	.069	.047	.031	.040	.028	.018	.013	.009	.006		
7.0	.110	.070	.042	.095	.061	.037	.065	.043	.026	.038	.025	.016	.012	.008	.005		
8.0	.104	.064	.036	.090	.056	.032	.062	.039	.022	.036	.023	.013	.012	.008	.004		
9.0	.099	.059	.032	.085	.051	.028	.059	.036	.020	.034	.021	.012	.011	.007	.004		
10.0	.094	.054	.028	.081	.047	.024	.056	.033	.017	.033	.020	.010	.011	.006	.003		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz UTHDi:0.17% ITHDi:19.06% KDisp:0.9483Lamp Flux:1124.31x1 lm										
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D 10WTYPE:						WEIGHT:				
SPEC.:						DIM.:			SERIAL No.:	
MFR.: Norming lighting						SUR.: 41mm			Shielding Angle:	
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	25.2	26.1	25.4	26.3	26.5	25.1	26.1	25.4	26.2	26.4
3H	25.0	25.9	25.3	26.1	26.3	25.0	25.8	25.2	26.0	26.2
4H	25.0	25.8	25.3	26.0	26.2	24.9	25.7	25.2	25.9	26.2
6H	24.9	25.7	25.2	25.9	26.2	24.9	25.6	25.2	25.9	26.1
8H	24.9	25.7	25.2	25.9	26.2	24.9	25.6	25.2	25.9	26.1
12H	24.9	25.6	25.2	25.9	26.2	24.9	25.6	25.2	25.8	26.1
4H 2H	24.9	25.7	25.2	26.0	26.2	24.9	25.7	25.2	25.9	26.1
3H	24.8	25.5	25.1	25.8	26.0	24.7	25.4	25.1	25.7	26.0
4H	24.7	25.4	25.1	25.7	26.0	24.7	25.3	25.0	25.6	25.9
6H	24.8	25.3	25.1	25.6	26.0	24.7	25.3	25.1	25.6	25.9
8H	24.8	25.3	25.2	25.6	26.0	24.7	25.2	25.1	25.6	26.0
12H	24.8	25.3	25.2	25.6	26.0	24.7	25.2	25.1	25.6	26.0
8H 4H	24.6	25.1	25.0	25.5	25.9	24.6	25.1	25.0	25.4	25.8
6H	24.7	25.1	25.1	25.5	25.9	24.6	25.1	25.1	25.5	25.9
8H	24.8	25.1	25.2	25.5	26.0	24.7	25.1	25.1	25.5	25.9
12H	24.8	25.1	25.3	25.6	26.0	24.7	25.1	25.2	25.5	26.0
12H 4H	24.6	25.1	25.0	25.4	25.8	24.5	25.0	24.9	25.4	25.8
6H	24.7	25.0	25.1	25.5	25.9	24.6	25.0	25.1	25.4	25.9
8H	24.7	25.1	25.2	25.5	26.0	24.7	25.0	25.2	25.5	25.9
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H	+ 2.5 / - 7.8					+ 2.5 / - 7.8				
1.5H	+ 4.7 / - 7.7					+ 4.7 / - 7.7				
2.0H	+ 6.7 / - 3.0					+ 6.7 / - 3.0				

CIE Pub.117, 1124 lm Total Lamp Luminous Flux Corrected ( $8\log(F/F_0) = 0.4$ )  
Area: 0.0013 m<sup>2</sup>

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz			UTHDi:0.17% ITHDi:19.06% KDisp:0.9483			Lamp Flux:1124.31x1 lm		
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D			LOWTYPE:			WEIGHT:		
SPEC.:			DIM.:			SERIAL No.:		
MFR.: Norming lighting			SUR.: 41mm			Shielding Angle:		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	84	78	73	84	77	73	83	77	73	69
0.80	92	86	82	92	86	82	90	85	81	77
1.00	97	91	88	97	91	87	95	91	87	83
1.25	102	96	93	101	96	92	99	94	91	87
1.50	105	100	96	103	99	96	101	97	94	90
2.00	108	103	100	106	102	99	104	100	98	92
2.50	110	105	102	108	104	101	105	102	100	93
3.00	111	108	105	109	106	104	106	103	101	95
4.00	113	110	108	111	109	107	108	105	104	97
5.00	115	112	110	112	110	108	108	107	105	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.06% KDisp:0.9483		Lamp Flux:1124.3lx1 lm
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D	LOWTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

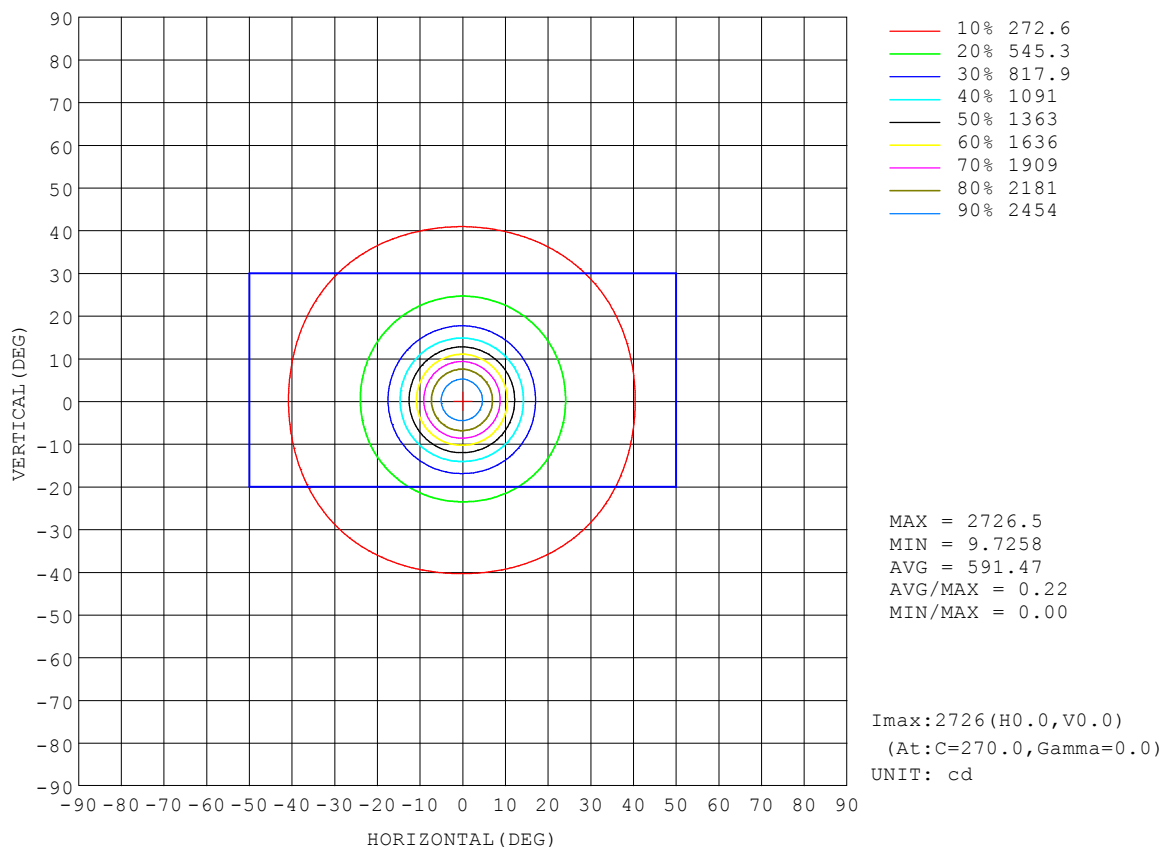


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:



AAI Figure

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.06% KDisp:0.9483		Lamp Flux:1124.3lx1 lm
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D	LOWTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

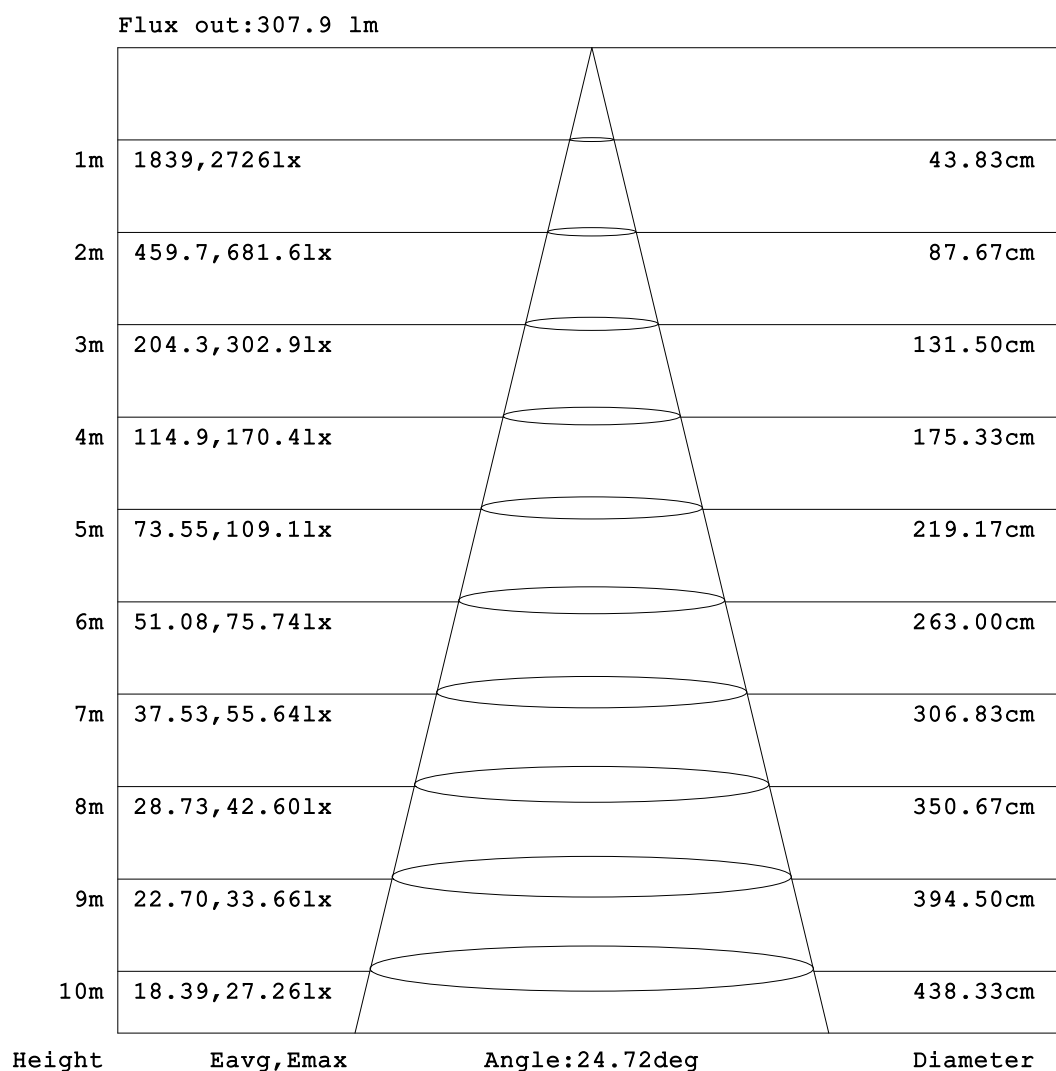


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

ISOLUX DIAGRAM

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.06% KDisp:0.9483		Lamp Flux:1124.3lx1 lm
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D	LOWTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

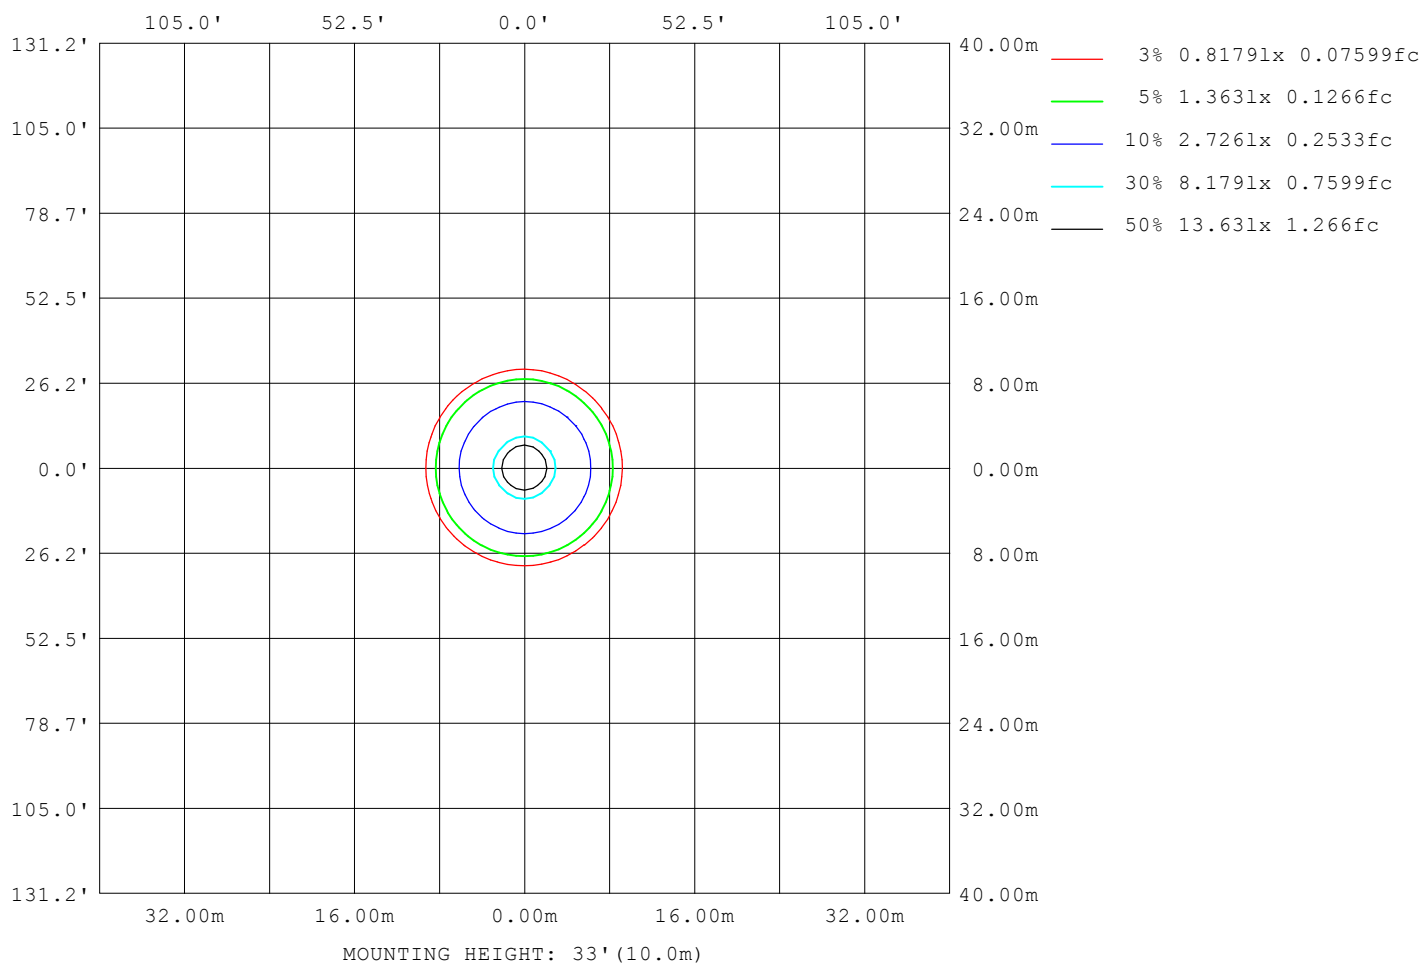

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## LED Avg.L Report

Test:U:240.4V I:0.0444A P:9.9W PF:0.9312 Freq:49.99Hz		
UTHDi:0.17% ITHDi:19.06% KDisp:0.9483 Lamp Flux:1124.31x1 lm		
NAME: FUSION-MD23-AHD-013-COB-02SC 3000K RA90 25D	LOWTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	8553
L_0~180 (75) av	10806
L_0~180 (85) av	17707
L_90~270 (65) av	8447
L_90~270 (75) av	10950
L_90~270 (85) av	18389
L_45 (65) av	8488
L_45 (75) av	10687
L_45 (85) av	17614

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

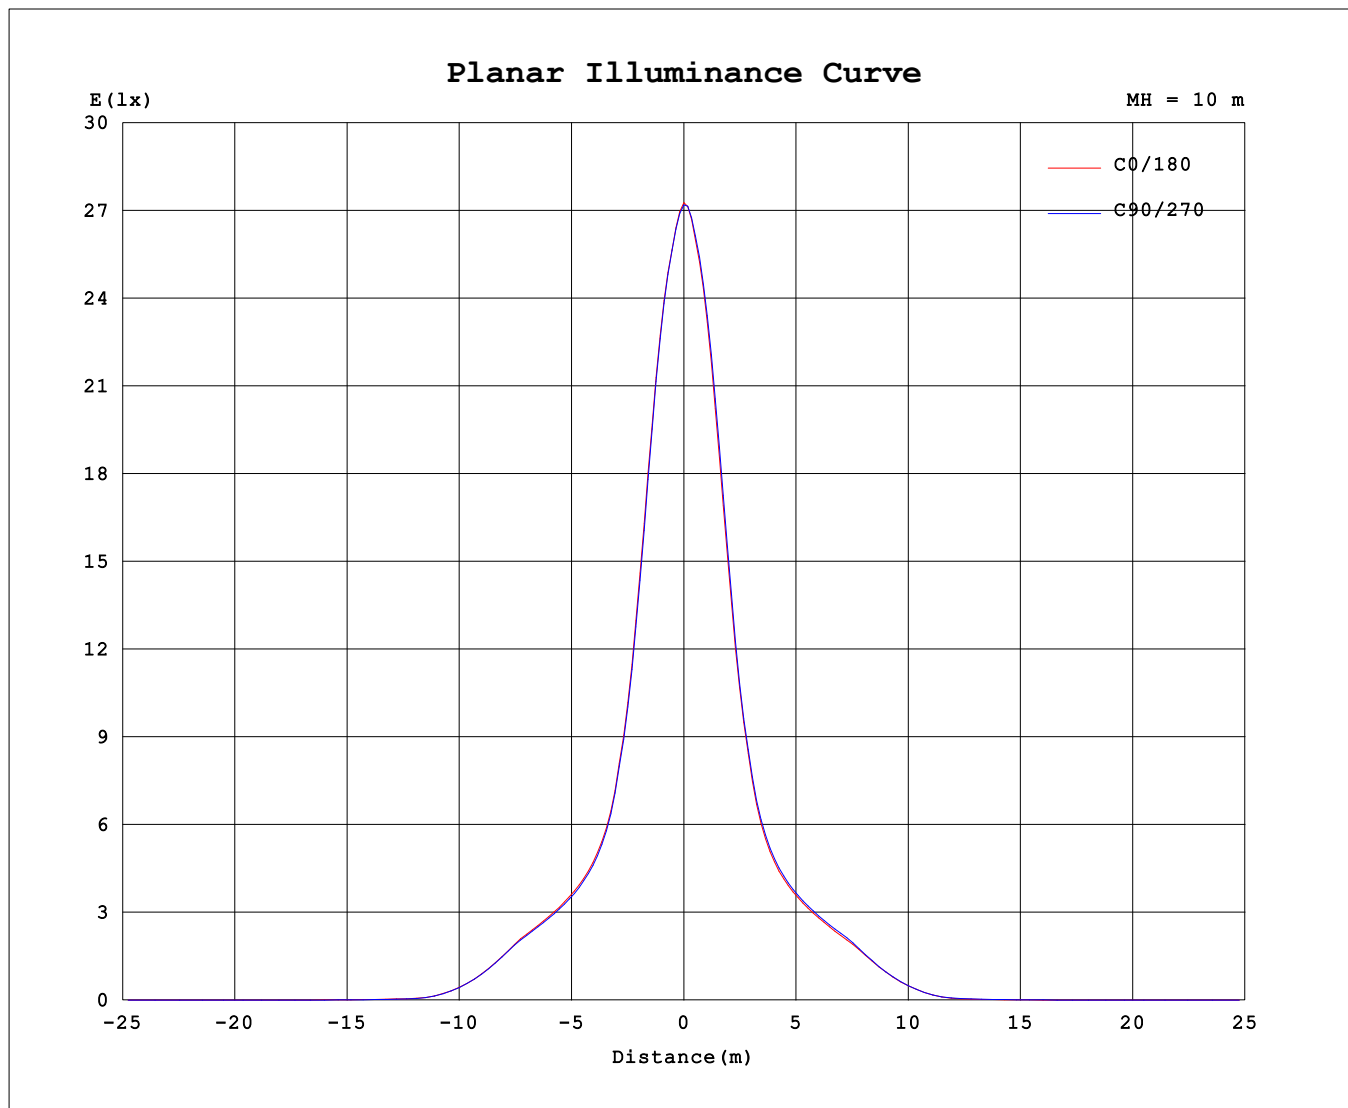

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-17

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

### Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	2722	2722	2722	2722	2722	2722	2722	2722
3.0	2572	2563	2576	2591	2606	2617	2626	2598
6.0	2307	2289	2301	2332	2353	2367	2382	2332
9.0	1868	1846	1850	1894	1923	1959	1964	1906
12.0	1384	1366	1366	1408	1446	1473	1481	1422
15.0	1002	993.8	990.1	1017	1051	1064	1069	1032
18.0	750.9	744.4	741.8	756.6	777.4	788.3	795.7	770.9
21.0	619.0	613.1	608.5	613.8	624.4	632.6	640.9	630.6
24.0	545.9	540.4	536.1	537.8	544.2	549.7	558.5	552.5
27.0	499.6	495.3	490.3	491.6	495.0	498.5	507.3	504.0
30.0	464.3	460.8	456.8	456.6	458.4	462.0	470.7	469.6
33.0	433.1	430.7	425.7	424.2	424.6	430.2	438.3	437.2
36.0	396.5	394.6	390.7	390.0	390.0	396.0	403.5	397.9
39.0	317.2	317.5	315.7	323.7	327.1	332.0	332.6	321.1
42.0	220.0	217.4	218.6	228.5	234.9	237.3	237.5	224.3
45.0	125.5	121.5	123.3	132.8	139.7	142.3	141.5	129.8
48.0	49.24	46.00	48.55	55.61	60.65	61.62	60.52	54.14
51.0	21.61	19.71	18.66	20.92	21.39	21.44	22.45	21.32
54.0	13.94	12.35	12.31	12.82	12.47	13.41	14.32	13.91
57.0	8.849	8.152	8.083	8.425	8.354	8.973	9.181	8.789
60.0	6.441	6.123	6.047	6.140	6.050	6.291	6.460	6.379
63.0	5.202	5.135	4.975	4.920	4.899	4.952	5.043	5.091
66.0	4.704	4.674	4.483	4.400	4.405	4.411	4.521	4.602
69.0	4.325	4.340	4.107	3.989	4.023	4.014	4.182	4.271
72.0	4.024	4.037	3.753	3.611	3.670	3.712	3.907	3.961
75.0	3.817	3.870	3.681	3.346	3.454	3.476	3.687	3.691
78.0	4.173	4.447	4.417	3.885	3.995	3.842	4.002	3.953
81.0	4.068	4.219	4.115	3.775	3.857	3.943	3.968	3.789
84.0	2.711	2.691	2.476	2.244	2.358	2.651	2.716	2.629
87.0	0.6862	0.5689	0.4825	0.4617	0.6029	0.7897	0.9002	0.7451
90.0	0.0375	0.0273	0.0408	0.0293	0.0279	0.0292	0.0373	0.0258

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: HIGH  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-17

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks: