


## LUMINAIRE PHOTOMETRIC TEST REPORT


Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz		
UTHDi:0.17% ITHDi:17.46% KDisp:0.9773 Lamp Flux:1672.03x1 lm		
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D	15WTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 113.97 lm/W
MODEL		Imax (cd)	5738	S/MH(C0/180)	0.32	
NOMINAL POWER(W)	15	LOR(%)	100.0	S/MH(C90/270)	0.32	
RATED VOLTAGE(V)	240	TOTAL FLUX(lm)	1672.0	$\eta$ UP,DN(C0-180)	0.0,49.1	
NOMINAL FLUX(lm)	1672.03	CIE CLASS	DIRECT	$\eta$ UP,DN(C180-360)	0.0,50.9	
LAMPS INSIDE	1	$\eta$ up (%)	0.0	CIBSE SHR NOM	0.00	
TEST VOLTAGE(V)	240.38	$\eta$ down (%)	100.0	CIBSE SHR MAX	0.30	

LUMINOUS INTENSITY DISTRIBUTION DIAGRAM

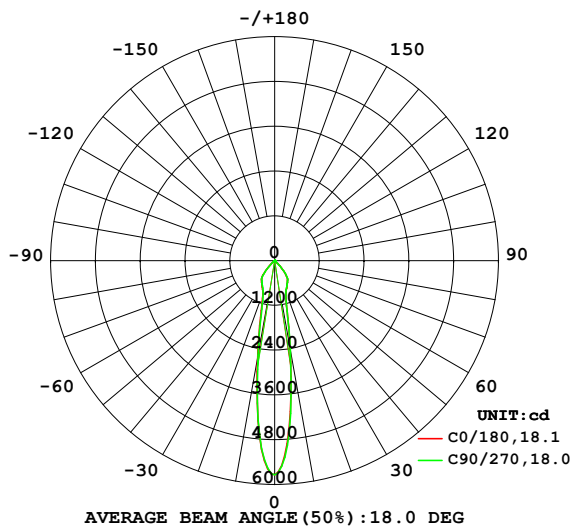

PLANAR ISOLUX DIAGRAM(UNIT:lx)

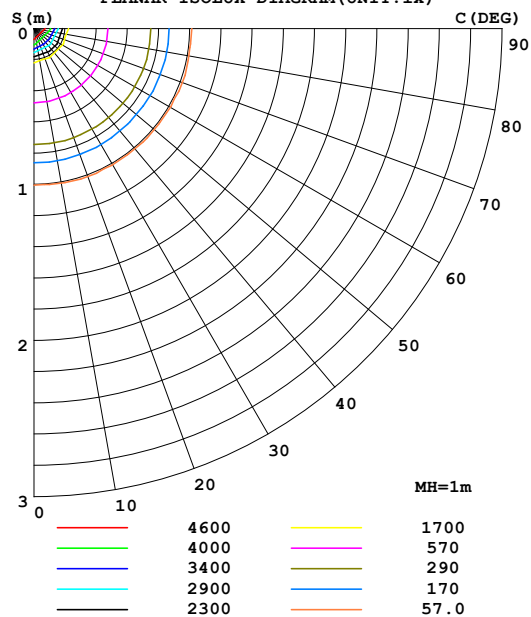

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## ZONAL FLUX DIAGRAM

## ZONAL FLUX DIAGRAM:

$\gamma$	C0	C45	C90	C135	C180	C225	C270	C315	$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	2397	2355	2430	2509	2661	2716	2578	2453	0- 10	367.5	367.5	22,22
20	906.9	896.0	895.4	905.1	941.8	951.5	920.7	903.6	10- 20	388.2	755.7	45.2,45.2
30	689.7	689.7	688.1	690.3	699.8	693.7	688.1	685.7	20- 30	360.9	1117	66.8,66.8
40	422.9	421.3	432.7	456.3	462.0	461.4	450.5	428.0	30- 40	372.3	1489	89,89
50	26.47	27.01	26.37	30.20	30.50	32.42	34.04	28.92	40- 50	152.0	1641	98.1,98.1
60	9.504	9.607	9.559	9.595	9.548	8.861	9.233	9.404	50- 60	13.28	1654	98.9,98.9
70	7.275	7.177	7.343	7.109	6.822	6.510	6.796	6.989	60- 70	8.015	1662	99.4,99.4
80	5.448	5.505	5.563	5.262	4.911	4.889	4.990	5.246	70- 80	6.412	1669	99.8,99.8
90	0.0653	0.0504	0.0706	0.0527	0.0560	0.0545	0.0633	0.0534	80- 90	3.360	1672	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1604 lm

%lum = 95.9%

%lamp = 95.9%

Conical surface Flux(120deg): 1654.2 lm

%lum = 98.9%


%lamp = 98.9%

C Range: 0 - 360DEG  
 C Interval: 45.0DEG  
 Test Speed: MEDIUM  
 Temperature:25.3DEG  
 Operators:DAMIN  
 Test Date:2024-10-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
 Humidity:65.0%  
 Test Distance:3.090m [K=1.0000]  
 Remarks:

## LUMINANCE LIMITATION CURVES

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz			Lamp Flux:1672.03x1 lm		
UTHDi:0.17% ITHDi:17.46% KDisp:0.9773					
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D			15WTYPE:		WEIGHT:
SPEC.:			DIM.:		SERIAL No.:
MFR.: Norming lighting			SUR.: 41mm		Shielding Angle:

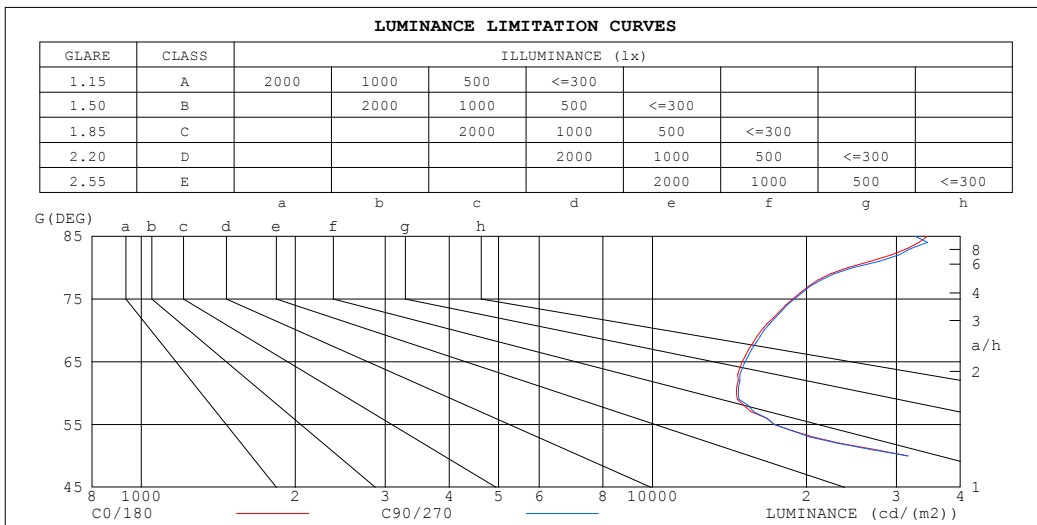

LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	34448	32665
80	24091	24660
75	18813	18933
70	16335	16526
65	14971	15172
60	14597	14716
55	17326	17326
50	31618	31581
45	180675	190318


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

## CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz		
UTHDi:0.17% ITHDi:17.46% KDisp:0.9773		Lamp Flux:1672.03x1 lm
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D	15WTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio															

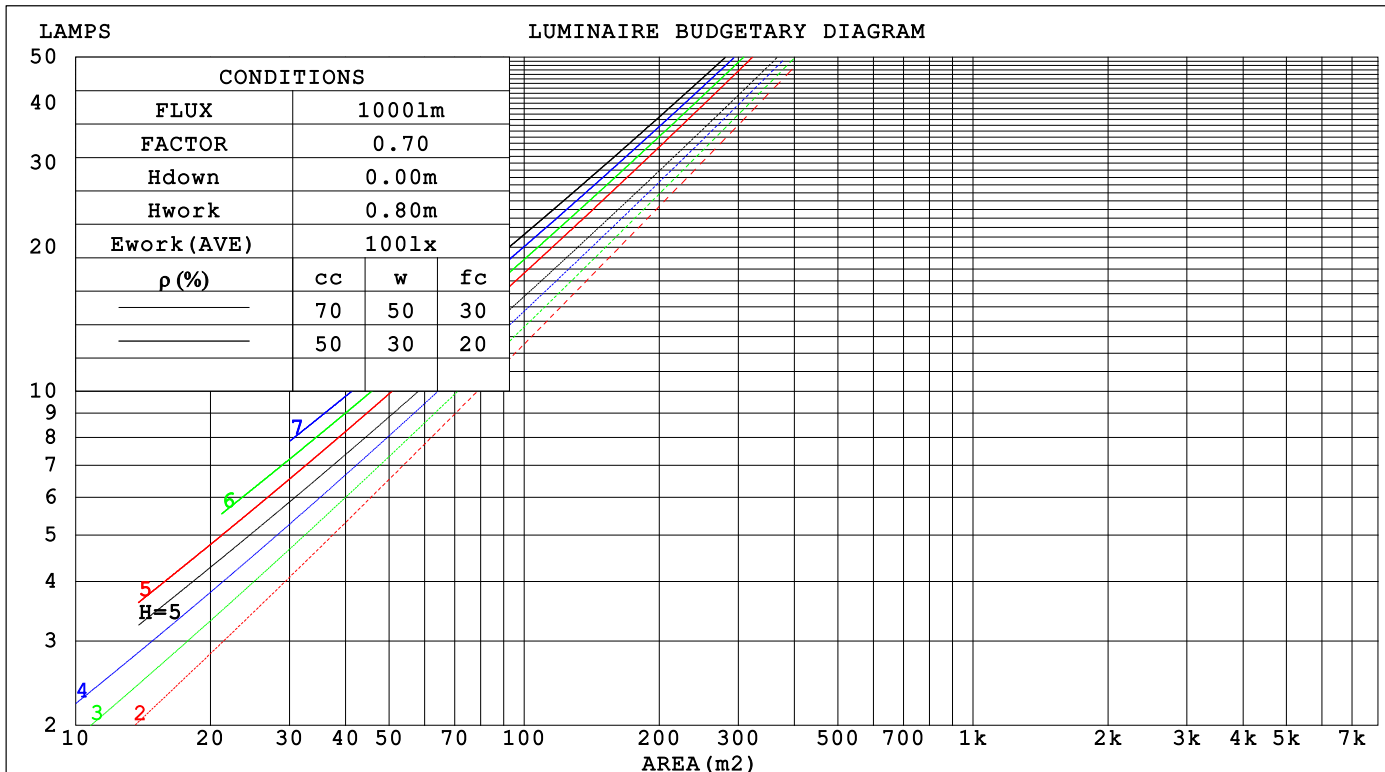

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### WEC AND CCEC

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz			UTHDi:0.17% ITHDi:17.46% KDisp:0.9773			Lamp Flux:1672.03x1 lm		
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D			15WTYPE:			WEIGHT:		
SPEC.:			DIM.:			SERIAL No.:		
MFR.: Norming lighting			SUR.: 41mm			Shielding Angle:		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients(WEC)										
0.0																	
1.0	.175	.100	.032	.169	.096	.031	.156	.090	.029	.145	.083	.027	.134	.078	.025		
2.0	.167	.092	.028	.161	.089	.027	.151	.084	.026	.141	.079	.025	.132	.075	.024		
3.0	.158	.084	.025	.154	.082	.025	.145	.078	.024	.136	.075	.023	.129	.071	.022		
4.0	.150	.078	.023	.146	.077	.023	.139	.073	.022	.131	.071	.021	.125	.068	.021		
5.0	.143	.073	.021	.139	.072	.021	.133	.069	.020	.126	.067	.020	.120	.064	.019		
6.0	.136	.068	.019	.133	.067	.019	.127	.065	.019	.121	.063	.019	.116	.061	.018		
7.0	.129	.064	.018	.127	.063	.018	.121	.061	.018	.117	.060	.017	.112	.058	.017		
8.0	.123	.060	.017	.121	.060	.017	.116	.058	.017	.112	.057	.016	.108	.055	.016		
9.0	.118	.057	.016	.116	.056	.016	.112	.055	.016	.108	.054	.015	.104	.053	.015		
10.0	.113	.054	.015	.111	.054	.015	.107	.052	.015	.104	.051	.015	.100	.050	.014		

pcc	80%			70%			50%			30%			10%			0	
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0	
pfc	20%			20%			20%			20%			20%			0	
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)										
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020		
1.0	.171	.157	.145	.146	.135	.125	.100	.093	.086	.058	.054	.050	.018	.017	.016		
2.0	.156	.133	.113	.133	.114	.098	.091	.079	.068	.053	.046	.040	.017	.015	.013		
3.0	.143	.114	.090	.123	.098	.078	.084	.068	.055	.049	.040	.032	.016	.013	.011		
4.0	.132	.099	.073	.114	.085	.063	.078	.059	.045	.045	.035	.026	.015	.011	.009		
5.0	.124	.087	.060	.106	.075	.052	.073	.053	.037	.042	.031	.022	.014	.010	.007		
6.0	.116	.078	.050	.100	.067	.044	.069	.047	.031	.040	.028	.018	.013	.009	.006		
7.0	.109	.070	.043	.094	.061	.037	.065	.043	.026	.038	.025	.016	.012	.008	.005		
8.0	.103	.064	.037	.089	.055	.032	.062	.039	.023	.036	.023	.014	.012	.008	.004		
9.0	.098	.059	.032	.084	.051	.028	.059	.036	.020	.034	.021	.012	.011	.007	.004		
10.0	.093	.054	.028	.080	.047	.024	.056	.033	.017	.033	.020	.010	.011	.006	.003		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### UGR(Unified Glare Rating) Table

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz UTHDi:0.17% ITHDi:17.46% KDisp:0.9773 Lamp Flux:1672.03x1 lm										
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D					LAMP TYPE:			WEIGHT:		
SPEC.:					DIM.:			SERIAL No.:		
MFR.: Norming lighting					SUR.: 41mm			Shielding Angle:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise				Viewed endwise				
x = 2H y = 2H	2H	26.4	27.3	26.6	27.5	27.7	26.5	27.4	26.7	27.6
	3H	26.3	27.1	26.5	27.3	27.5	26.4	27.2	26.6	27.4
	4H	26.2	27.0	26.5	27.3	27.5	26.3	27.1	26.6	27.3
	6H	26.2	26.9	26.5	27.2	27.4	26.3	27.0	26.6	27.3
	8H	26.2	26.9	26.5	27.2	27.4	26.3	27.0	26.6	27.2
	12H	26.2	26.9	26.5	27.1	27.4	26.3	27.0	26.6	27.2
4H	2H	26.2	27.0	26.5	27.2	27.4	26.3	27.1	26.5	27.3
	3H	26.1	26.7	26.4	27.0	27.3	26.1	26.8	26.4	27.1
	4H	26.0	26.6	26.4	26.9	27.2	26.1	26.7	26.4	27.0
	6H	26.0	26.6	26.4	26.9	27.2	26.1	26.6	26.5	27.0
	8H	26.0	26.5	26.4	26.9	27.3	26.1	26.6	26.5	27.0
	12H	26.1	26.5	26.5	26.9	27.3	26.1	26.6	26.5	27.0
8H	4H	25.9	26.4	26.3	26.8	27.1	26.0	26.5	26.4	26.8
	6H	25.9	26.3	26.4	26.7	27.2	26.0	26.4	26.4	26.8
	8H	26.0	26.4	26.4	26.8	27.2	26.1	26.4	26.5	26.9
	12H	26.1	26.4	26.5	26.8	27.3	26.1	26.5	26.6	26.9
12H	4H	25.9	26.3	26.3	26.7	27.1	25.9	26.4	26.3	26.8
	6H	25.9	26.3	26.4	26.7	27.1	26.0	26.3	26.4	26.8
	8H	26.0	26.3	26.5	26.7	27.2	26.1	26.4	26.5	26.8
Variations with the observer position at spacings(CIE Pub.117):										
S = 1.0H		+ 2.5 / - 7.8				+ 2.6 / - 7.9				
1.5H		+ 4.8 / - 7.9				+ 4.9 / - 8.0				
2.0H		+ 6.6 / - 2.5				+ 6.7 / - 2.6				

CIE Pub.117, 1672 lm Total Lamp Luminous Flux Corrected (8log(F/F0) = 1.8)  
Area: 0.0013 m2

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### UTILIZATION FACTORS TABLE

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz			UTHDi:0.17% ITHDi:17.46% KDisp:0.9773			Lamp Flux:1672.03x1 lm		
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D			15WTYPE:			WEIGHT:		
SPEC.:			DIM.:			SERIAL No.:		
MFR.: Norming lighting			SUR.: 41mm			Shielding Angle:		


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	85	78	74	84	78	74	83	77	74	70
0.80	93	86	82	92	86	82	91	85	82	78
1.00	98	92	88	97	91	87	95	91	87	83
1.25	102	96	93	101	96	92	99	95	92	87
1.50	105	100	96	104	99	96	101	98	95	90
2.00	108	103	100	106	102	99	104	100	98	92
2.50	110	106	102	108	104	101	105	102	100	94
3.00	111	108	105	109	106	104	106	104	101	95
4.00	113	110	108	111	109	107	108	106	104	97
5.00	115	112	110	112	110	109	108	107	105	98
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

## ISOCANDELA DIAGRAM

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz		
UTHDi:0.17% ITHDi:17.46% KDisp:0.9773 Lamp Flux:1672.03x1 lm		
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D	15WTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

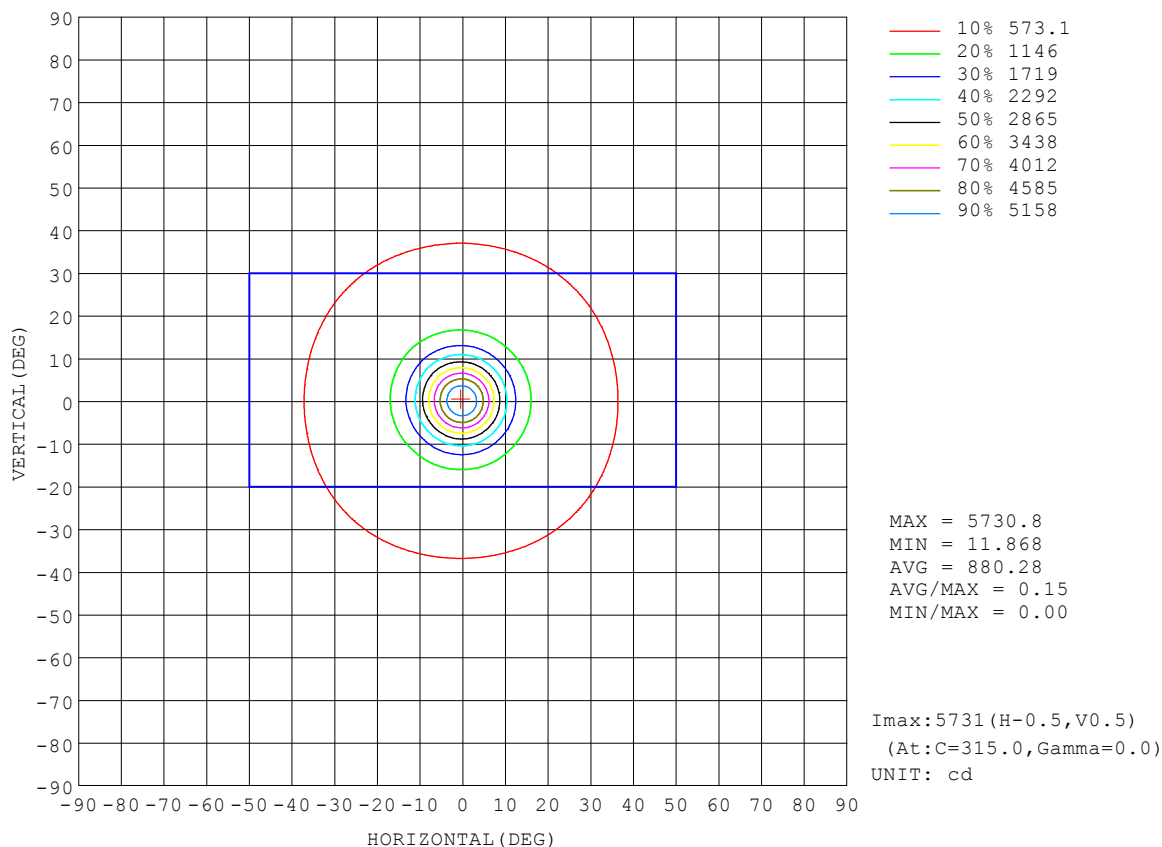


C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:



AAI Figure

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz		
UTHDi:0.17% ITHDi:17.46% KDisp:0.9773		Lamp Flux:1672.03x1 lm
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D	15W TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

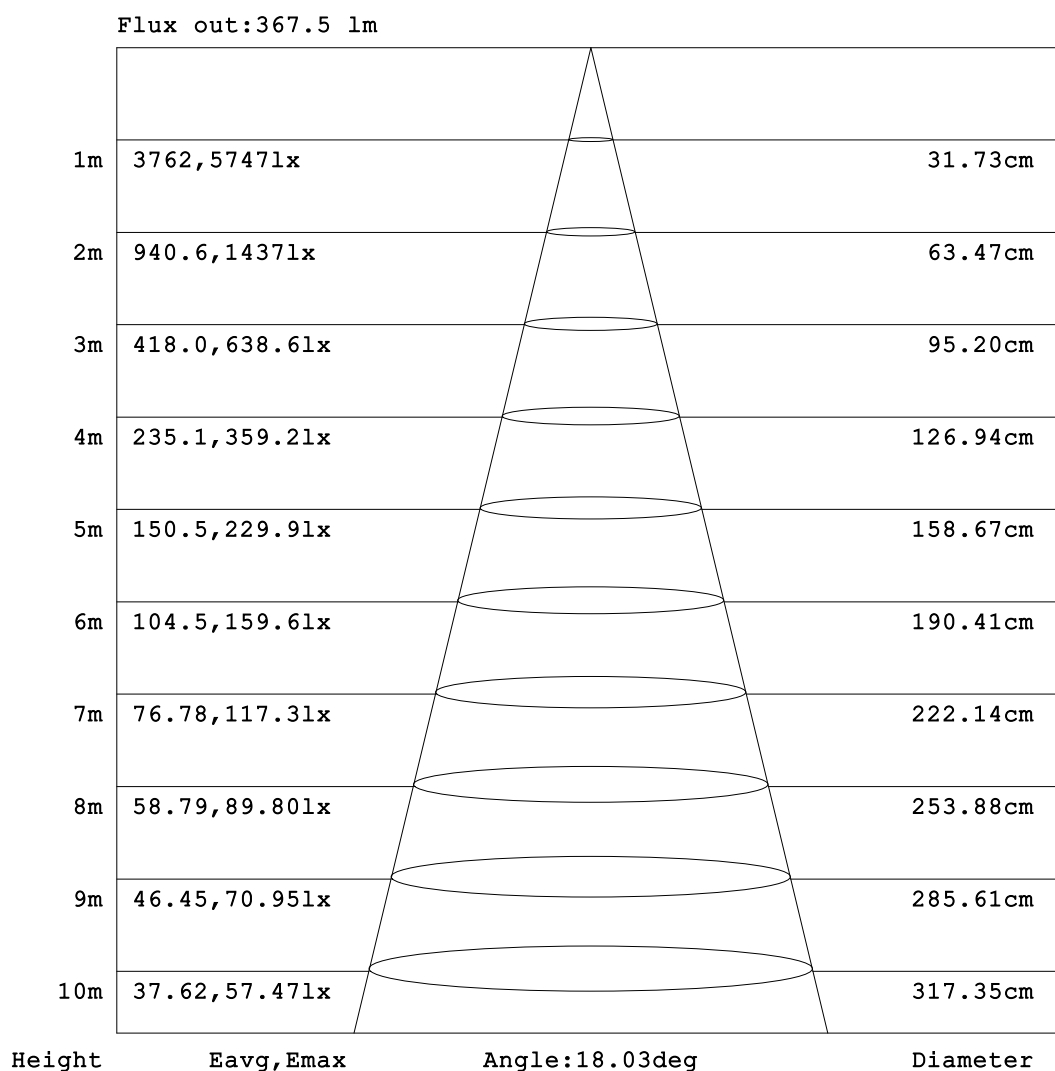


Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

ISOLUX DIAGRAM

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz		
UTHDi:0.17% ITHDi:17.46% KDisp:0.9773		Lamp Flux:1672.03x1 lm
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D	15W TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:

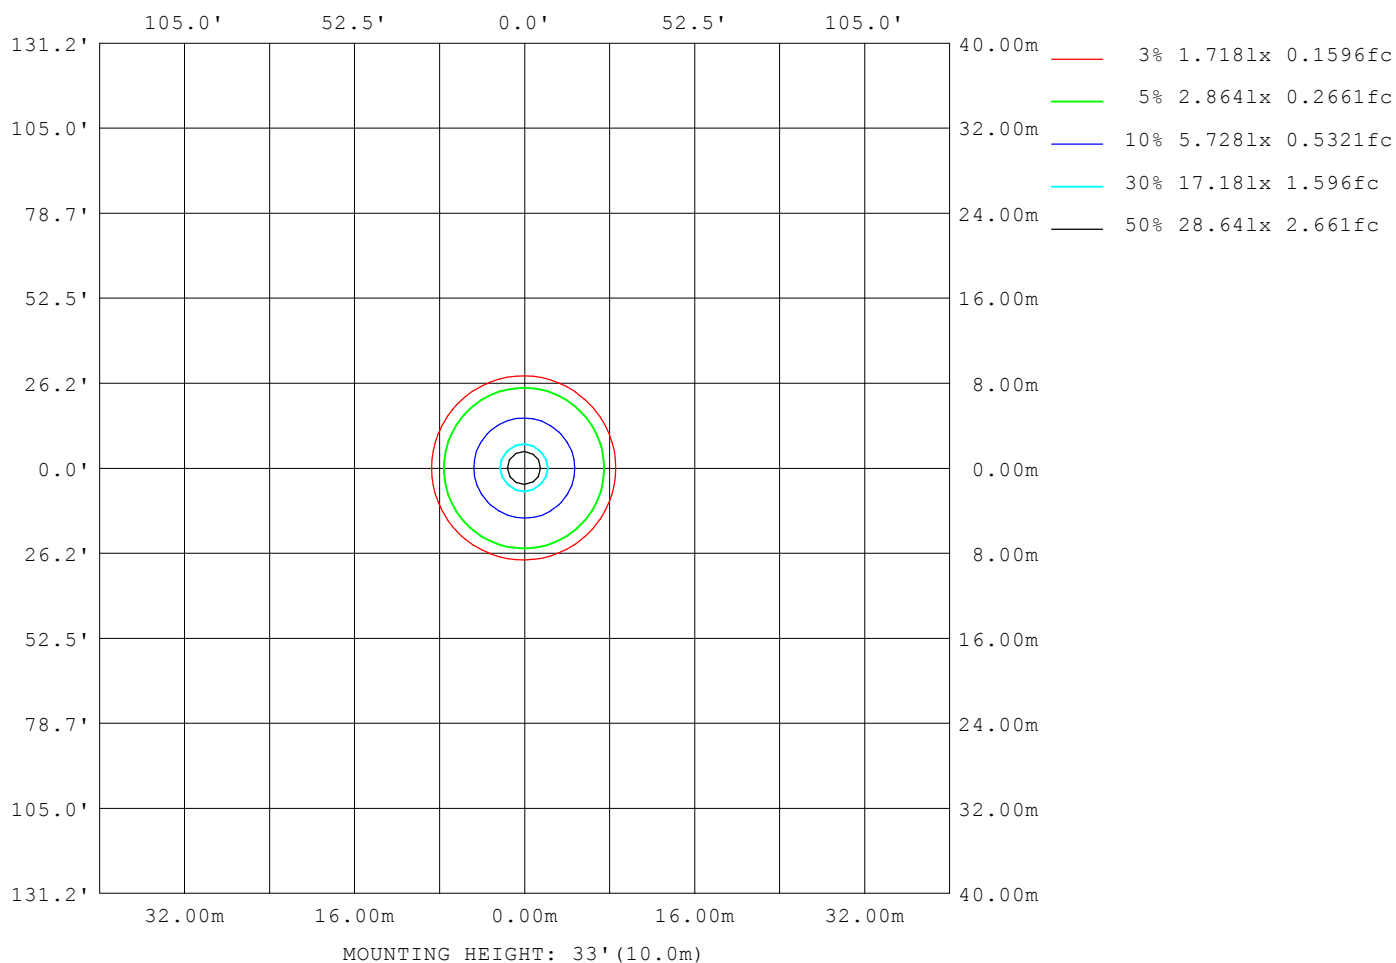

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

### LED Avg.L Report

Test:U:240.4V I:0.0634A P:14.7W PF:0.9626 Freq:49.99Hz		
UTHDi:0.17% ITHDi:17.46% KDisp:0.9773		Lamp Flux:1672.03x1 lm
NAME: FUSION-MD23-AHD-018-COB-02SC 4000K RA90 15D	15WTYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.: Norming lighting	SUR.: 41mm	Shielding Angle:


AvgL	cd/m2
L_0~180 (65) av	14713
L_0~180 (75) av	18108
L_0~180 (85) av	32733
L_90~270 (65) av	14663
L_90~270 (75) av	18252
L_90~270 (85) av	33346
L_45 (65) av	14482
L_45 (75) av	17901
L_45 (85) av	32904

Standard: GB/T 29293-2012

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks:

## Planar Illuminance Curve

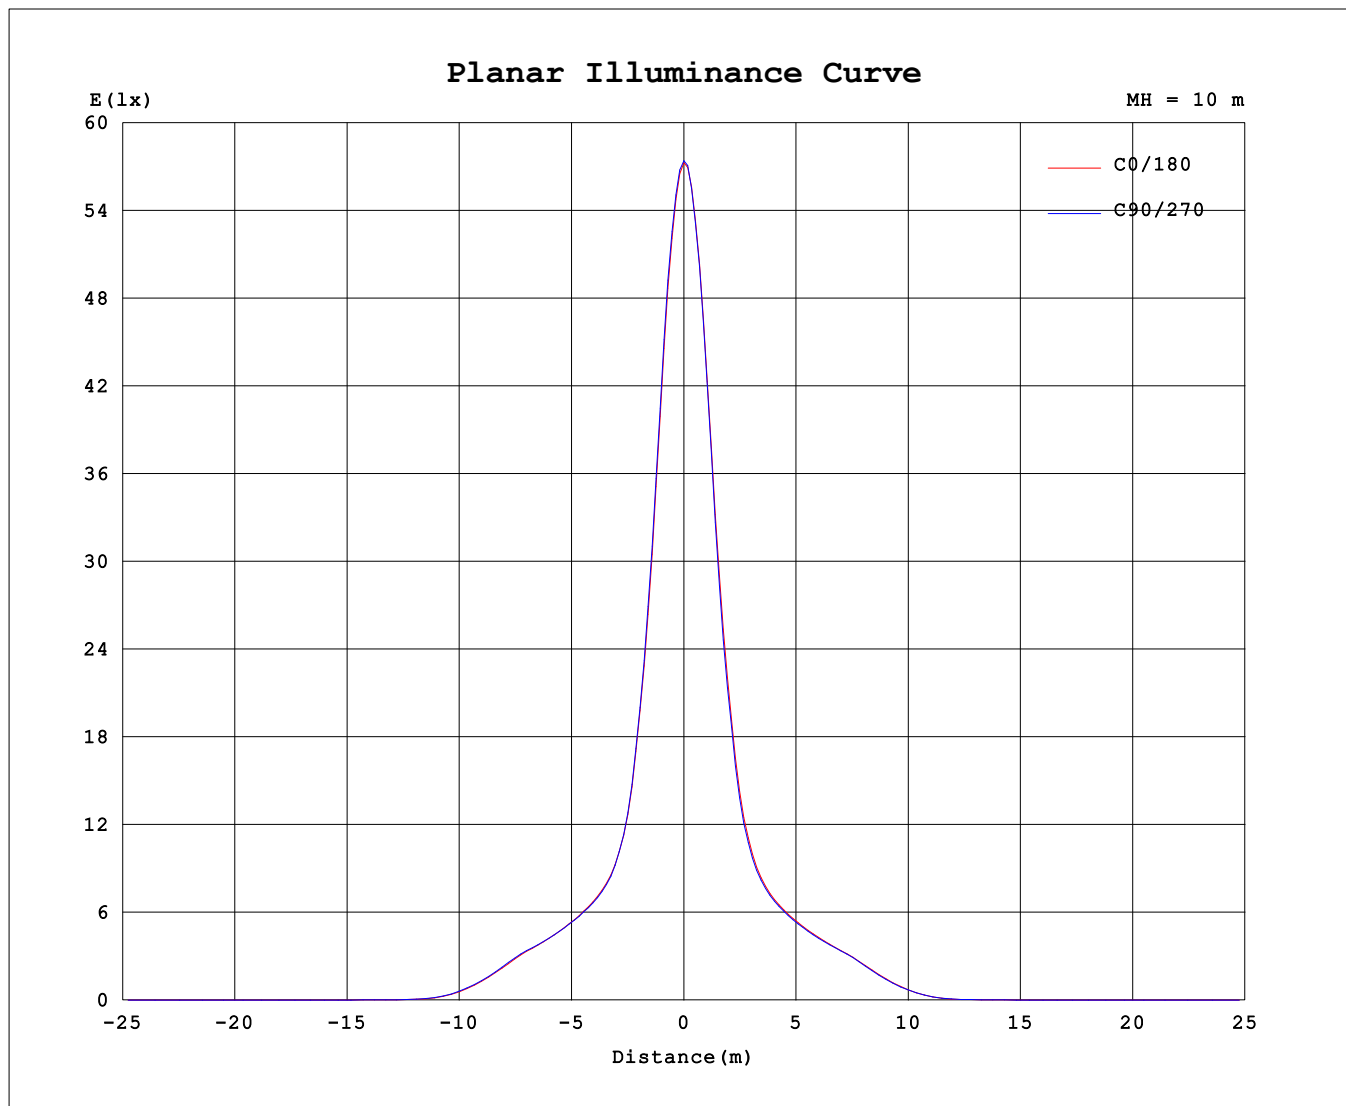

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature: 25.3DEG  
Operators: DAMIN  
Test Date: 2024-10-18

$\gamma$  Range: 0 - 90DEG  
 $\gamma$  Interval: 1.0DEG  
Test System: EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity: 65.0%  
Test Distance: 3.090m [K=1.0000]  
Remarks:

```

γ Range: 0 - 90DEG
γ Interval: 1.0DEG
Test System:EVERFINE GO-SPEX500_V1 SYSTEM V2.00.453
Humidity:65.0%
Test Distance:3.090m [K=1.0000]
Remarks:

```

### Photometric Data Table [cd]

G/C	0.0	45.0	90.0	135.0	180.0	225.0	270.0	315.0
0.0	5738	5738	5738	5738	5738	5738	5738	5738
3.0	5241	5242	5275	5307	5365	5386	5335	5269
6.0	4068	4045	4113	4211	4311	4356	4273	4141
9.0	2744	2702	2793	2871	3019	3085	2942	2809
12.0	1820	1788	1838	1914	2049	2084	1994	1860
15.0	1255	1226	1255	1297	1392	1409	1344	1275
18.0	997.0	981.5	986.6	1006	1062	1071	1033	997.6
21.0	873.3	864.7	862.5	869.8	899.6	902.8	880.6	867.4
24.0	801.8	795.3	792.6	795.0	813.9	812.0	798.5	793.1
27.0	741.8	740.5	737.0	738.8	752.4	747.2	739.0	734.4
30.0	689.7	689.7	688.1	690.3	699.8	693.7	688.1	685.7
33.0	641.5	642.4	645.0	646.9	651.2	644.3	643.9	640.4
36.0	586.5	588.5	596.3	602.3	604.0	597.1	598.4	589.1
39.0	470.8	470.0	482.7	502.6	507.1	506.4	498.2	476.2
42.0	318.4	319.1	326.5	351.6	360.9	359.1	348.3	324.5
45.0	166.4	170.0	174.8	196.6	202.4	204.4	199.3	174.7
48.0	56.22	56.68	60.18	73.06	76.62	79.92	76.24	62.97
51.0	22.30	22.43	21.84	22.55	22.81	21.49	25.46	23.99
54.0	14.35	14.52	14.29	14.70	14.93	13.97	15.71	15.50
57.0	11.06	11.26	11.16	11.45	11.40	10.79	11.31	11.21
60.0	9.504	9.607	9.559	9.595	9.548	8.861	9.233	9.404
63.0	8.676	8.678	8.744	8.714	8.499	8.018	8.345	8.471
66.0	8.055	8.003	8.140	7.978	7.671	7.251	7.551	7.739
69.0	7.466	7.380	7.555	7.325	7.023	6.695	6.969	7.171
72.0	6.935	6.858	6.981	6.723	6.450	6.172	6.458	6.649
75.0	6.341	6.294	6.366	6.104	5.844	5.600	5.916	6.094
78.0	5.696	5.715	5.763	5.480	5.207	5.032	5.317	5.488
81.0	5.437	5.569	5.652	5.323	4.915	4.986	4.964	5.233
84.0	4.523	4.653	4.685	4.492	4.294	4.329	4.322	4.383
87.0	1.397	1.227	1.226	1.462	1.589	1.676	1.681	1.521
90.0	0.0653	0.0504	0.0706	0.0527	0.0560	0.0545	0.0633	0.0534

C Range: 0 - 360DEG  
C Interval: 45.0DEG  
Test Speed: MEDIUM  
Temperature:25.3DEG  
Operators:DAMIN  
Test Date:2024-10-18

γ Range: 0 - 90DEG  
γ Interval: 1.0DEG  
Test System:EVERFINE GO-SPEX500\_V1 SYSTEM V2.00.453  
Humidity:65.0%  
Test Distance:3.090m [K=1.0000]  
Remarks: