



Indoor Luminaire Photometric Data

Description Information

Luminary Name: TR08-06-XX-02 3000K RA90 15D		Lum. Catalog:	Test ID: 01
Lamp Name:		Lamp Catalog: LED	Test Date: 2021/10/27
Manufacture: Shenzhen Norming Lighting Co., Ltd		Shld. Ang(°):	Test Machine:GON-2000
Test Lab: Quality Department		Frequency (Hz):	Lamp CCT (K): Ra:
Lum. Size (W*L*H):0.038m*0.038m*0.000m		Lum. Area (m2):0.001	Lum. W (kg): 0.000
Test System: C, γ	Test Step: C=90.0 γ=1.0	Temp. (°C): 25	Humidity(%): 50.0


Character Parameter

Lamp Speciality Parameter		Luminaire Speciality Parameter	
Rated Flux(lm): 479.220	Luminary Flux(lm): 479.222	Field Angle(10%Imax): 31.0(°)	
Rated Power(W):	Luminary Efficiency: 100.00%	Down Lumens&Percent: 477.054lm 99.55%	
Rated Voltage(V):	Luminary EER(lm/W): 76.761	Up Lumens&Percent: 2.168lm 0.45%	
Tested Power(W): 6.243	Max. Candela(cd): 3970.247	S/MH: C0_a180=0.334 C90_270=0.233	
Lamps' Inside: 1	Max Cand@Ang. (°): C=0.0 γ=5.0	CIE Type: Semi-Direct	
Tested Electrics (V, A, pf):241.2, 0.030, 0.843	Beam Angle(50%Imax): 17.8(°)	ErP Φ use(90°): 383.909lm	
Lamp Size (W*L*H):0.038m*0.038m*0.000m	Left=-4.4°, Right=13.4°	IRF(%): 1297.519	

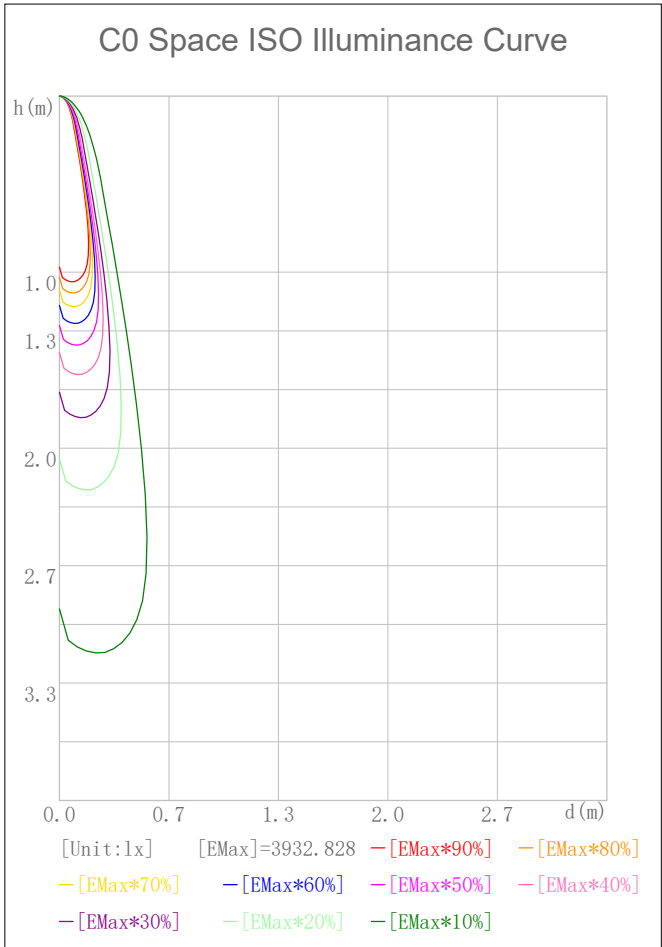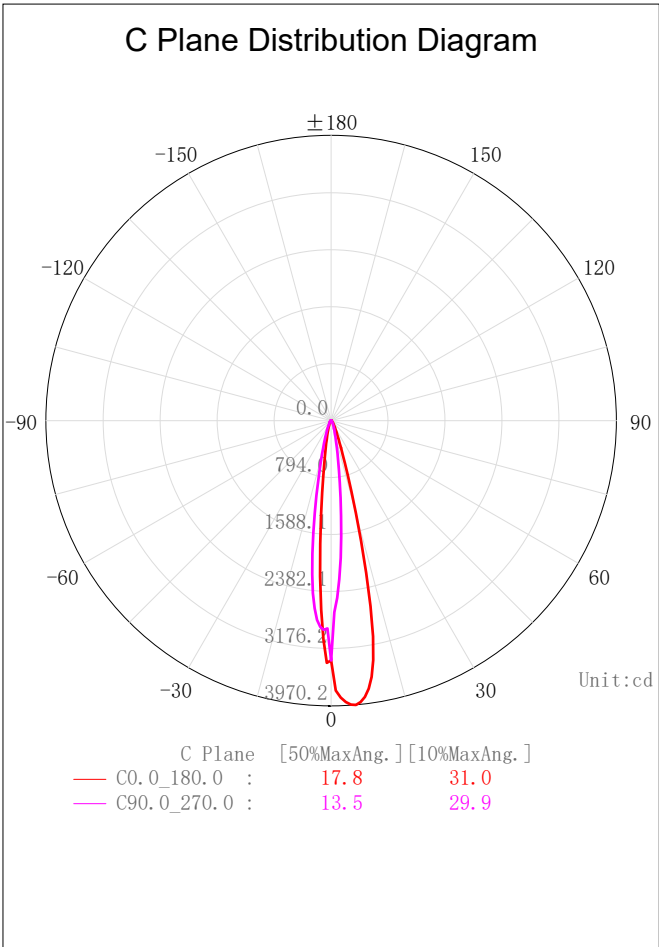

2D Plane Light Intensity Distribution Curve


Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Department
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/10/27

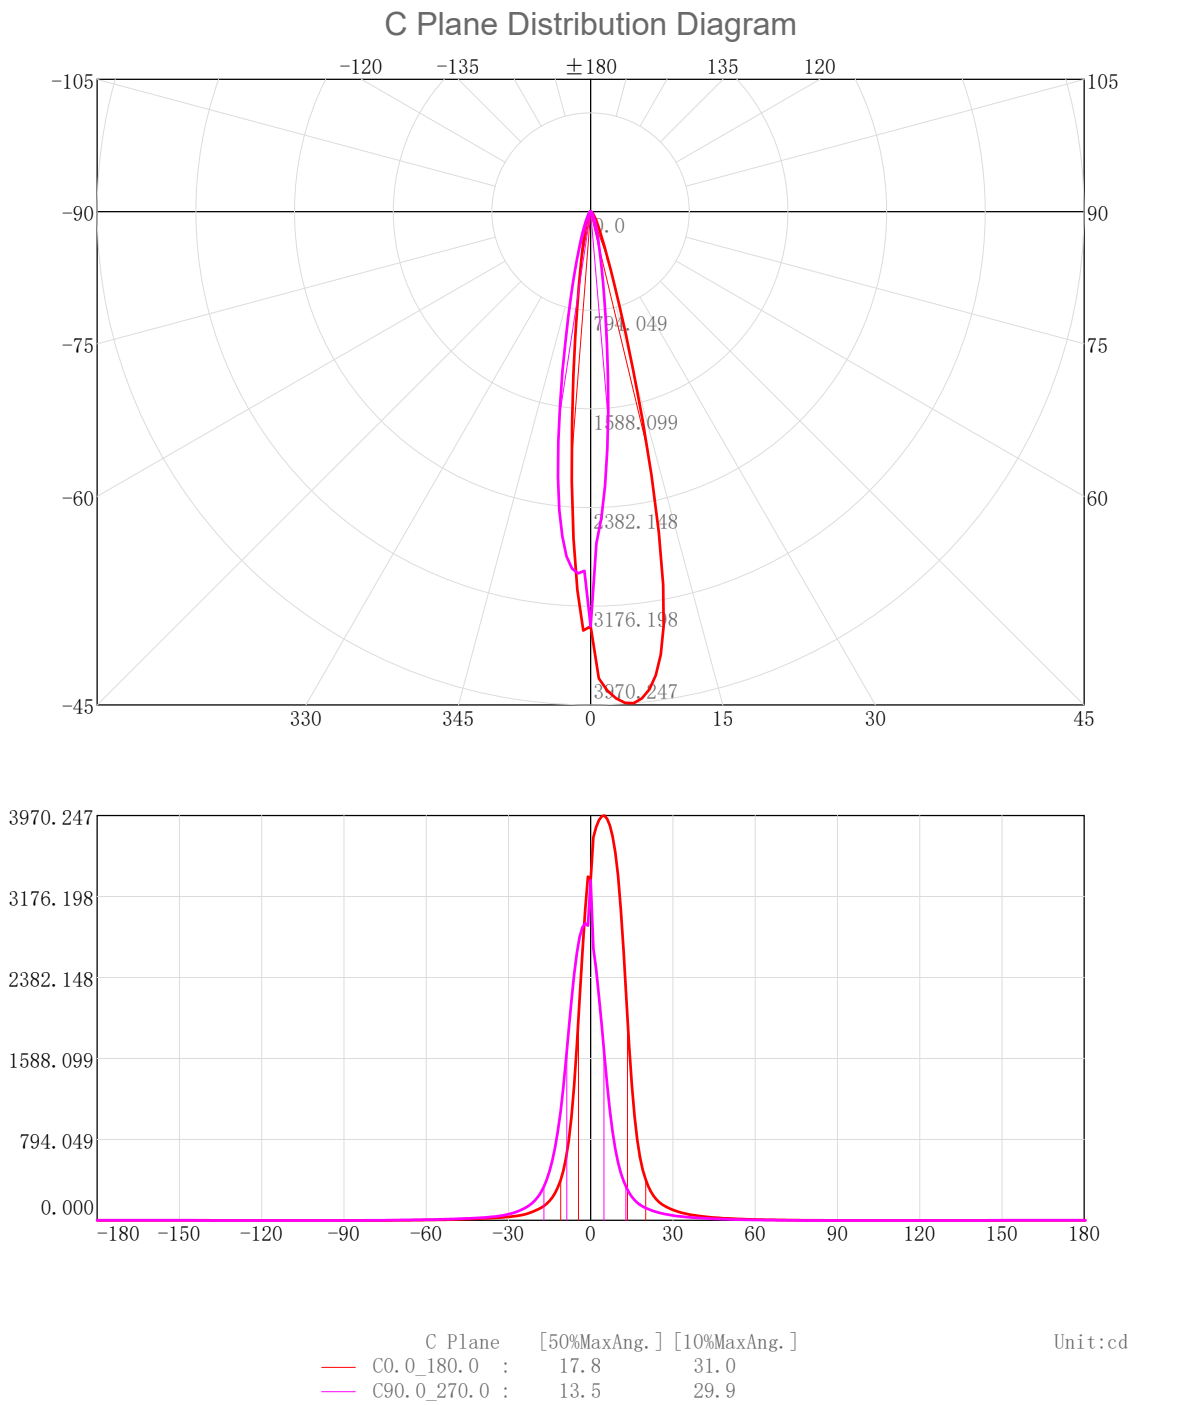

3D Light Intensity Distribution Modal

Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Department
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/10/27

3D Light Intensity Distribution Modal

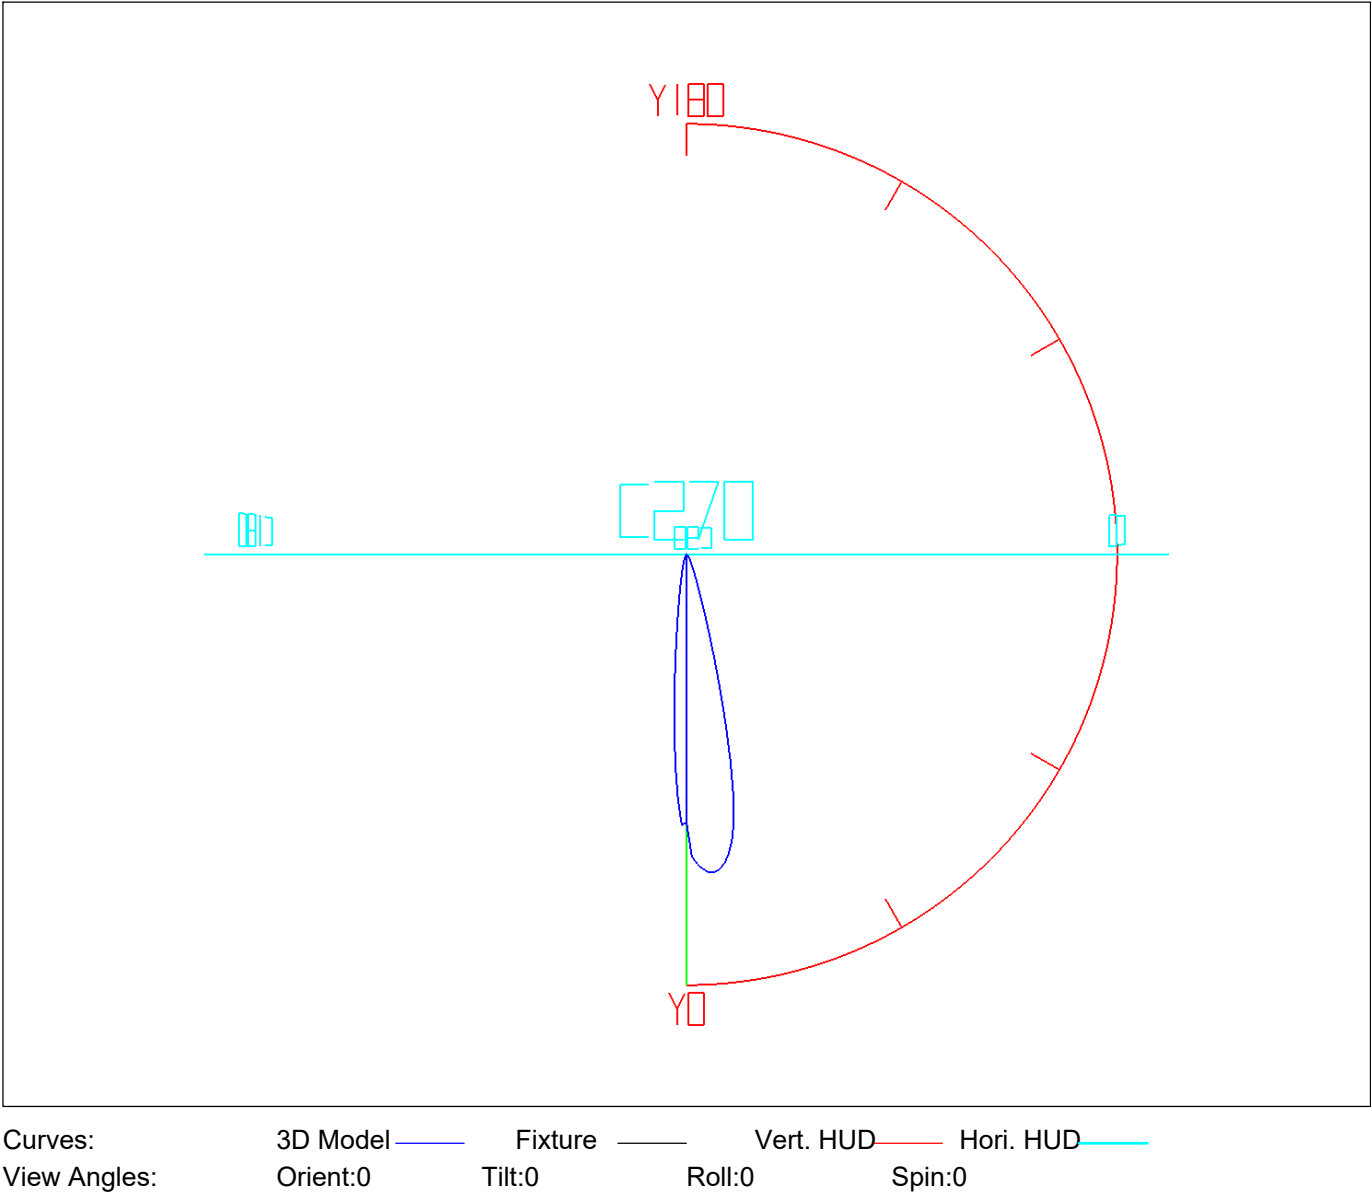

IES Indoor Report

Photometric Filename:TR08-06-XX-02 3000K RA90 15D.IES

Zonal Flux Tabulation


Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
0.0-1.0	3.11	3.11	0.65	0.65	47.0-48.0	1.32	459.60	0.28	95.91
1.0-2.0	8.96	12.07	1.87	2.52	48.0-49.0	1.25	460.85	0.26	96.17
2.0-3.0	14.30	26.37	2.98	5.50	49.0-50.0	1.18	462.03	0.25	96.41
3.0-4.0	18.80	45.18	3.92	9.43	50.0-51.0	1.11	463.15	0.23	96.65
4.0-5.0	22.33	67.50	4.66	14.09	51.0-52.0	1.05	464.19	0.22	96.86
5.0-6.0	24.88	92.39	5.19	19.28	52.0-53.0	0.98	465.17	0.21	97.07
6.0-7.0	26.58	118.97	5.55	24.83	53.0-54.0	0.92	466.10	0.19	97.26
7.0-8.0	27.56	146.53	5.75	30.58	54.0-55.0	0.87	466.97	0.18	97.44
8.0-9.0	27.93	174.46	5.83	36.40	55.0-56.0	0.82	467.78	0.17	97.61
9.0-10.0	27.69	202.15	5.78	42.18	56.0-57.0	0.77	468.55	0.16	97.77
10.0-11.0	26.78	228.93	5.59	47.77	57.0-58.0	0.72	469.27	0.15	97.92
11.0-12.0	25.13	254.06	5.24	53.01	58.0-59.0	0.67	469.94	0.14	98.06
12.0-13.0	22.81	276.87	4.76	57.77	59.0-60.0	0.63	470.57	0.13	98.20
13.0-14.0	20.10	296.97	4.19	61.97	60.0-61.0	0.59	471.16	0.12	98.32
14.0-15.0	17.33	314.30	3.62	65.59	61.0-62.0	0.55	471.72	0.12	98.43
15.0-16.0	14.78	329.08	3.08	68.67	62.0-63.0	0.52	472.24	0.11	98.54
16.0-17.0	12.61	341.69	2.63	71.30	63.0-64.0	0.49	472.72	0.10	98.64
17.0-18.0	10.85	352.54	2.26	73.57	64.0-65.0	0.45	473.17	0.09	98.74
18.0-19.0	9.44	361.98	1.97	75.54	65.0-66.0	0.42	473.59	0.09	98.83
19.0-20.0	8.31	370.30	1.73	77.27	66.0-67.0	0.39	473.98	0.08	98.91
20.0-21.0	7.40	377.70	1.54	78.81	67.0-68.0	0.36	474.34	0.07	98.98
21.0-22.0	6.65	384.34	1.39	80.20	68.0-69.0	0.33	474.66	0.07	99.05
22.0-23.0	6.02	390.36	1.26	81.46	69.0-70.0	0.30	474.96	0.06	99.11
23.0-24.0	5.48	395.84	1.14	82.60	70.0-71.0	0.27	475.23	0.06	99.17
24.0-25.0	5.03	400.88	1.05	83.65	71.0-72.0	0.24	475.48	0.05	99.22
25.0-26.0	4.65	405.52	0.97	84.62	72.0-73.0	0.22	475.70	0.05	99.26
26.0-27.0	4.31	409.83	0.90	85.52	73.0-74.0	0.20	475.89	0.04	99.31
27.0-28.0	4.01	413.84	0.84	86.36	74.0-75.0	0.18	476.07	0.04	99.34
28.0-29.0	3.75	417.59	0.78	87.14	75.0-76.0	0.16	476.22	0.03	99.37
29.0-30.0	3.50	421.09	0.73	87.87	76.0-77.0	0.14	476.36	0.03	99.40
30.0-31.0	3.29	424.38	0.69	88.56	77.0-78.0	0.12	476.48	0.02	99.43
31.0-32.0	3.09	427.47	0.64	89.20	78.0-79.0	0.10	476.58	0.02	99.45
32.0-33.0	2.91	430.37	0.61	89.81	79.0-80.0	0.09	476.67	0.02	99.47
33.0-34.0	2.74	433.12	0.57	90.38	80.0-81.0	0.08	476.74	0.02	99.48
34.0-35.0	2.59	435.71	0.54	90.92	81.0-82.0	0.07	476.81	0.01	99.50
35.0-36.0	2.45	438.16	0.51	91.43	82.0-83.0	0.06	476.87	0.01	99.51
36.0-37.0	2.33	440.49	0.49	91.92	83.0-84.0	0.05	476.92	0.01	99.52
37.0-38.0	2.21	442.70	0.46	92.38	84.0-85.0	0.04	476.96	0.01	99.53
38.0-39.0	2.10	444.80	0.44	92.82	85.0-86.0	0.03	476.99	0.01	99.53
39.0-40.0	2.00	446.80	0.42	93.23	86.0-87.0	0.03	477.02	0.01	99.54
40.0-41.0	1.90	448.70	0.40	93.63	87.0-88.0	0.02	477.03	0.00	99.54
41.0-42.0	1.81	450.50	0.38	94.01	88.0-89.0	0.01	477.05	0.00	99.55
42.0-43.0	1.72	452.22	0.36	94.37	89.0-90.0	0.01	477.05	0.00	99.55
43.0-44.0	1.63	453.85	0.34	94.71	90.0-91.0	0.00	477.06	0.00	99.55
44.0-45.0	1.55	455.41	0.32	95.03	91.0-92.0	0.00	477.06	0.00	99.55
45.0-46.0	1.47	456.88	0.31	95.34	92.0-93.0	0.00	477.06	0.00	99.55
46.0-47.0	1.40	458.28	0.29	95.63	93.0-94.0	0.00	477.06	0.00	99.55

Zonal Flux Tabulation - (Cont.)

Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
94. 0-95. 0	0. 00	477. 06	0. 00	99. 55	141. 0-142. 0	0. 03	477. 18	0. 01	99. 57
95. 0-96. 0	0. 00	477. 06	0. 00	99. 55	142. 0-143. 0	0. 04	477. 22	0. 01	99. 58
96. 0-97. 0	0. 00	477. 06	0. 00	99. 55	143. 0-144. 0	0. 05	477. 26	0. 01	99. 59
97. 0-98. 0	0. 00	477. 06	0. 00	99. 55	144. 0-145. 0	0. 05	477. 32	0. 01	99. 60
98. 0-99. 0	0. 00	477. 06	0. 00	99. 55	145. 0-146. 0	0. 06	477. 38	0. 01	99. 62
99. 0-100. 0	0. 00	477. 06	0. 00	99. 55	146. 0-147. 0	0. 07	477. 44	0. 01	99. 63
100. 0-101. 0	0. 00	477. 06	0. 00	99. 55	147. 0-148. 0	0. 07	477. 51	0. 01	99. 64
101. 0-102. 0	0. 00	477. 06	0. 00	99. 55	148. 0-149. 0	0. 08	477. 59	0. 02	99. 66
102. 0-103. 0	0. 00	477. 06	0. 00	99. 55	149. 0-150. 0	0. 08	477. 67	0. 02	99. 68
103. 0-104. 0	0. 00	477. 06	0. 00	99. 55	150. 0-151. 0	0. 08	477. 75	0. 02	99. 69
104. 0-105. 0	0. 00	477. 06	0. 00	99. 55	151. 0-152. 0	0. 08	477. 84	0. 02	99. 71
105. 0-106. 0	0. 00	477. 06	0. 00	99. 55	152. 0-153. 0	0. 09	477. 92	0. 02	99. 73
106. 0-107. 0	0. 00	477. 06	0. 00	99. 55	153. 0-154. 0	0. 08	478. 01	0. 02	99. 75
107. 0-108. 0	0. 00	477. 06	0. 00	99. 55	154. 0-155. 0	0. 08	478. 09	0. 02	99. 76
108. 0-109. 0	0. 00	477. 06	0. 00	99. 55	155. 0-156. 0	0. 08	478. 17	0. 02	99. 78
109. 0-110. 0	0. 00	477. 06	0. 00	99. 55	156. 0-157. 0	0. 08	478. 26	0. 02	99. 80
110. 0-111. 0	0. 00	477. 06	0. 00	99. 55	157. 0-158. 0	0. 08	478. 33	0. 02	99. 82
111. 0-112. 0	0. 00	477. 06	0. 00	99. 55	158. 0-159. 0	0. 08	478. 41	0. 02	99. 83
112. 0-113. 0	0. 00	477. 06	0. 00	99. 55	159. 0-160. 0	0. 07	478. 49	0. 02	99. 85
113. 0-114. 0	0. 00	477. 06	0. 00	99. 55	160. 0-161. 0	0. 07	478. 56	0. 01	99. 86
114. 0-115. 0	0. 00	477. 06	0. 00	99. 55	161. 0-162. 0	0. 07	478. 63	0. 01	99. 88
115. 0-116. 0	0. 00	477. 06	0. 00	99. 55	162. 0-163. 0	0. 07	478. 69	0. 01	99. 89
116. 0-117. 0	0. 00	477. 06	0. 00	99. 55	163. 0-164. 0	0. 06	478. 75	0. 01	99. 90
117. 0-118. 0	0. 00	477. 06	0. 00	99. 55	164. 0-165. 0	0. 06	478. 81	0. 01	99. 92
118. 0-119. 0	0. 00	477. 06	0. 00	99. 55	165. 0-166. 0	0. 06	478. 87	0. 01	99. 93
119. 0-120. 0	0. 00	477. 06	0. 00	99. 55	166. 0-167. 0	0. 05	478. 92	0. 01	99. 94
120. 0-121. 0	0. 00	477. 06	0. 00	99. 55	167. 0-168. 0	0. 05	478. 97	0. 01	99. 95
121. 0-122. 0	0. 00	477. 06	0. 00	99. 55	168. 0-169. 0	0. 04	479. 01	0. 01	99. 96
122. 0-123. 0	0. 00	477. 06	0. 00	99. 55	169. 0-170. 0	0. 04	479. 05	0. 01	99. 96
123. 0-124. 0	0. 00	477. 06	0. 00	99. 55	170. 0-171. 0	0. 03	479. 08	0. 01	99. 97
124. 0-125. 0	0. 00	477. 06	0. 00	99. 55	171. 0-172. 0	0. 03	479. 12	0. 01	99. 98
125. 0-126. 0	0. 00	477. 06	0. 00	99. 55	172. 0-173. 0	0. 03	479. 14	0. 01	99. 98
126. 0-127. 0	0. 00	477. 06	0. 00	99. 55	173. 0-174. 0	0. 02	479. 16	0. 00	99. 99
127. 0-128. 0	0. 00	477. 06	0. 00	99. 55	174. 0-175. 0	0. 02	479. 18	0. 00	99. 99
128. 0-129. 0	0. 00	477. 06	0. 00	99. 55	175. 0-176. 0	0. 01	479. 20	0. 00	100. 00
129. 0-130. 0	0. 00	477. 06	0. 00	99. 55	176. 0-177. 0	0. 01	479. 21	0. 00	100. 00
130. 0-131. 0	0. 00	477. 06	0. 00	99. 55	177. 0-178. 0	0. 01	479. 22	0. 00	100. 00
131. 0-132. 0	0. 00	477. 06	0. 00	99. 55	178. 0-179. 0	0. 00	479. 22	0. 00	100. 00
132. 0-133. 0	0. 00	477. 06	0. 00	99. 55	179. 0-180. 0	0. 00	479. 22	0. 00	100. 00
133. 0-134. 0	0. 00	477. 06	0. 00	99. 55					
134. 0-135. 0	0. 00	477. 06	0. 00	99. 55					
135. 0-136. 0	0. 00	477. 06	0. 00	99. 55					
136. 0-137. 0	0. 01	477. 07	0. 00	99. 55					
137. 0-138. 0	0. 01	477. 08	0. 00	99. 55					
138. 0-139. 0	0. 01	477. 10	0. 00	99. 56					
139. 0-140. 0	0. 02	477. 12	0. 00	99. 56					
140. 0-141. 0	0. 03	477. 14	0. 01	99. 57					

Rectangle ISO Lighting Intensity Diagram


Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Department
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/10/27

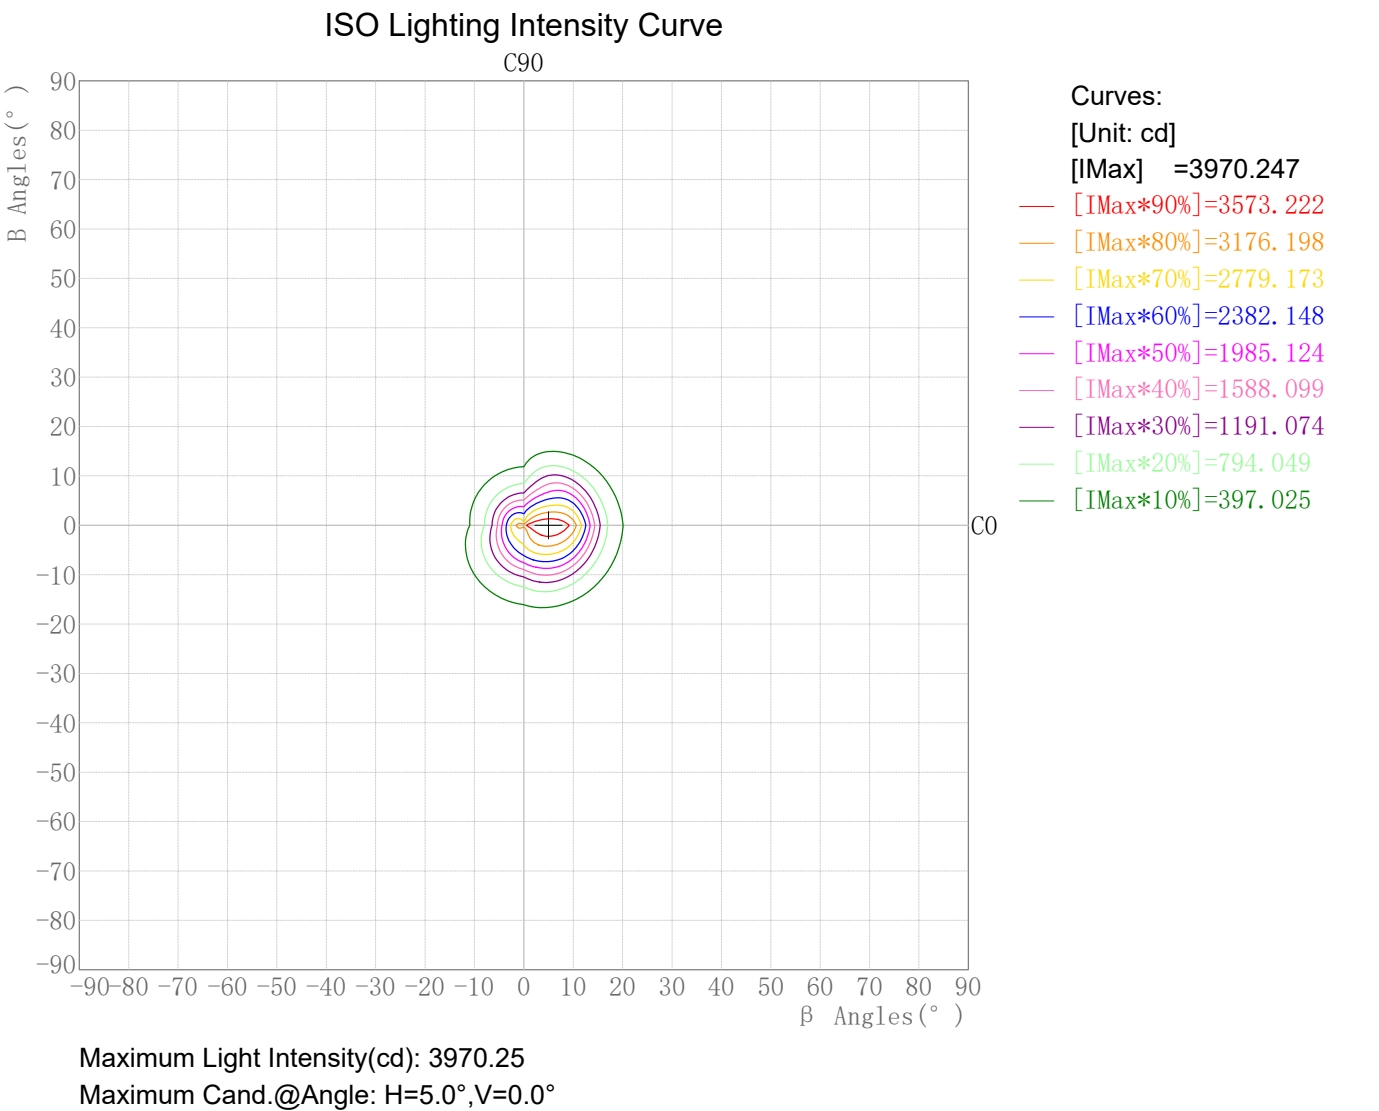

Plane ISO-Illuminance Diagram

Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catalog:	Test ID:01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/10/27

Plane ISO-Illuminance Curve

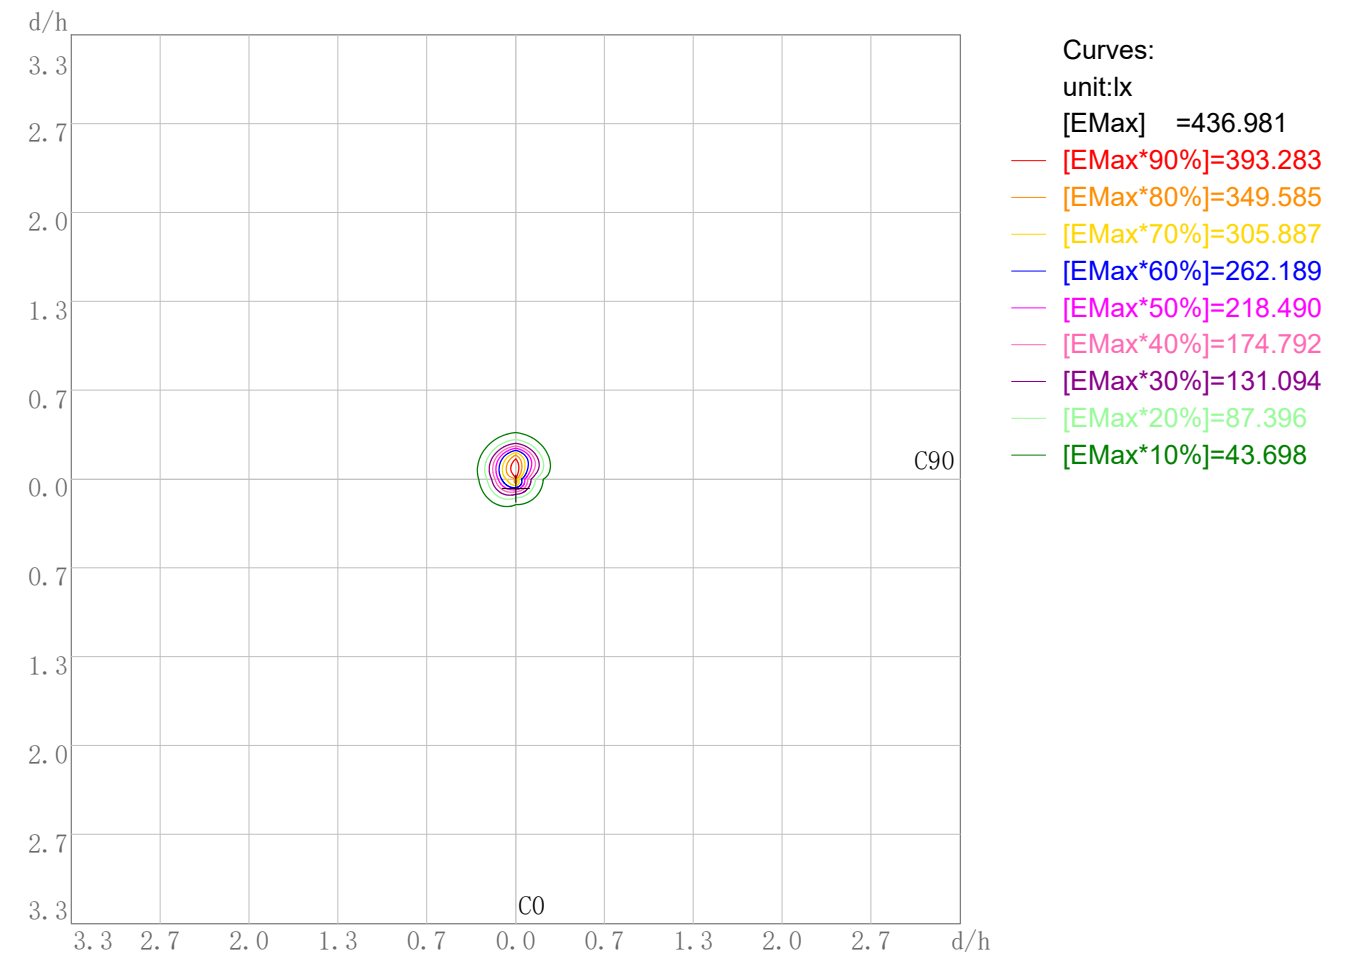

Working Plane Luminaire Mounting Height(m): 3.00

Working Plane Maximum Illuminance(lx): 436.98

Working Plane Maximum Illuminance Position(d/h):H0.0 V0.1


IES Indoor Report

Photometric Filename:TR08-06-XX-02 3000K RA90 15D.IES

3D Plane ISO Illuminance Diagram

Lum. Name: TR08-06-XX-02 3000K RA90 15D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/10/27

3D Plane Illuminance Modal

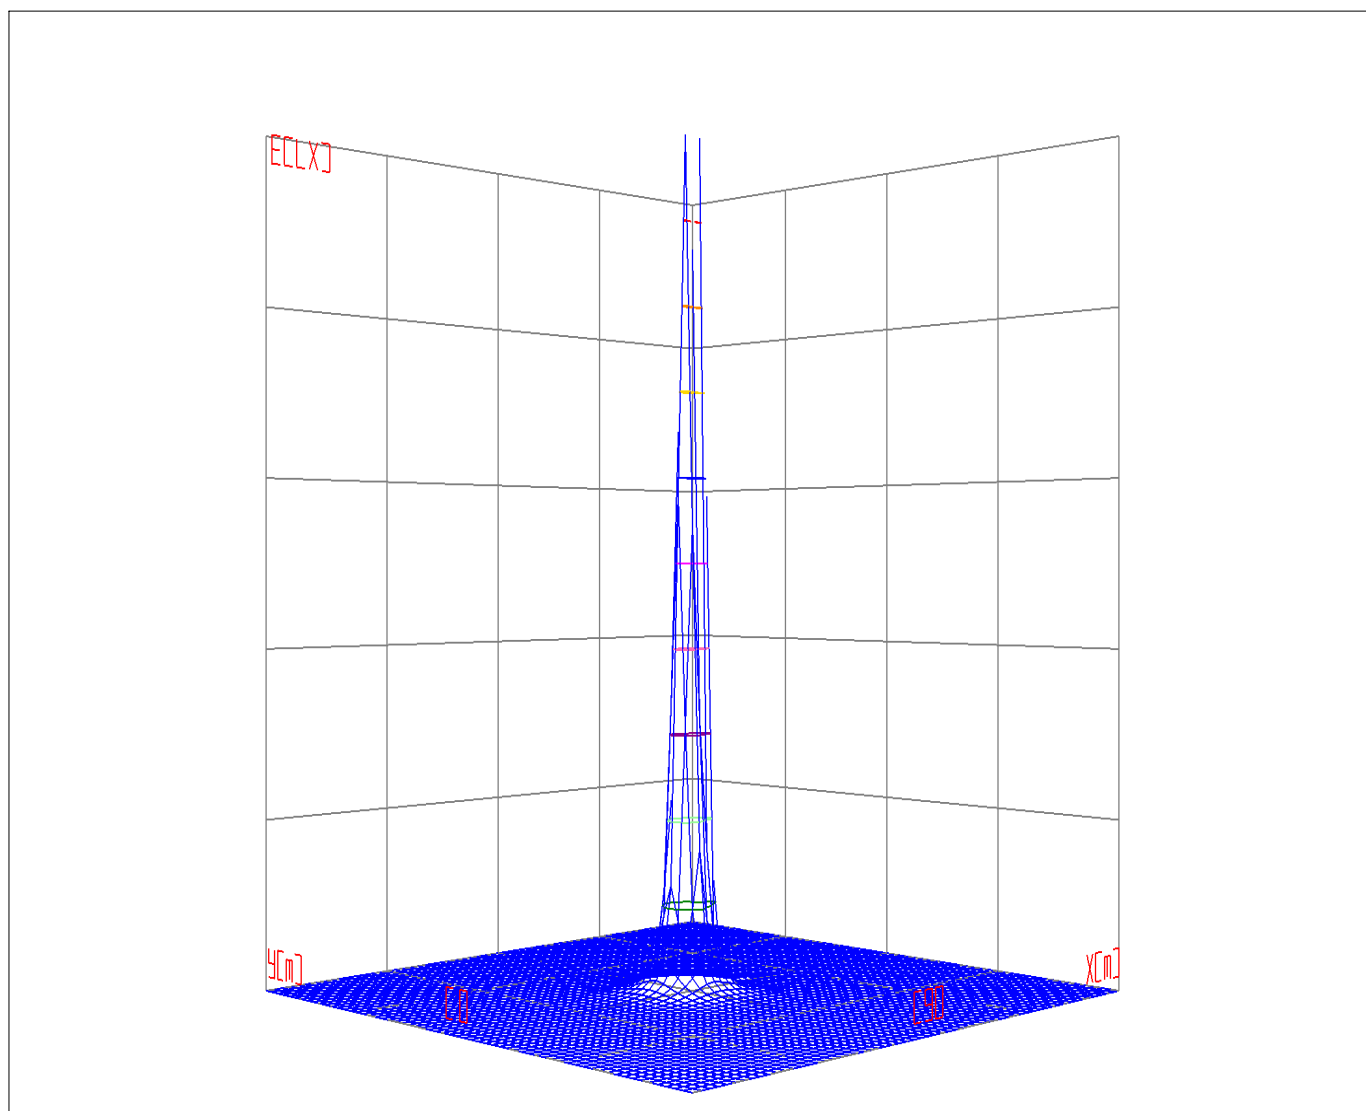


Curves: 3D Model — 90% — 80% — 70% — 60% — 50% — 40% — 30% — 20% — 10% —
View Angles(deg): 0 Height(m): 3.0 Distance(m): 10.0

Space ISO Illuminance Diagram

Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Department
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/10/27


Space ISO Illuminance Curve

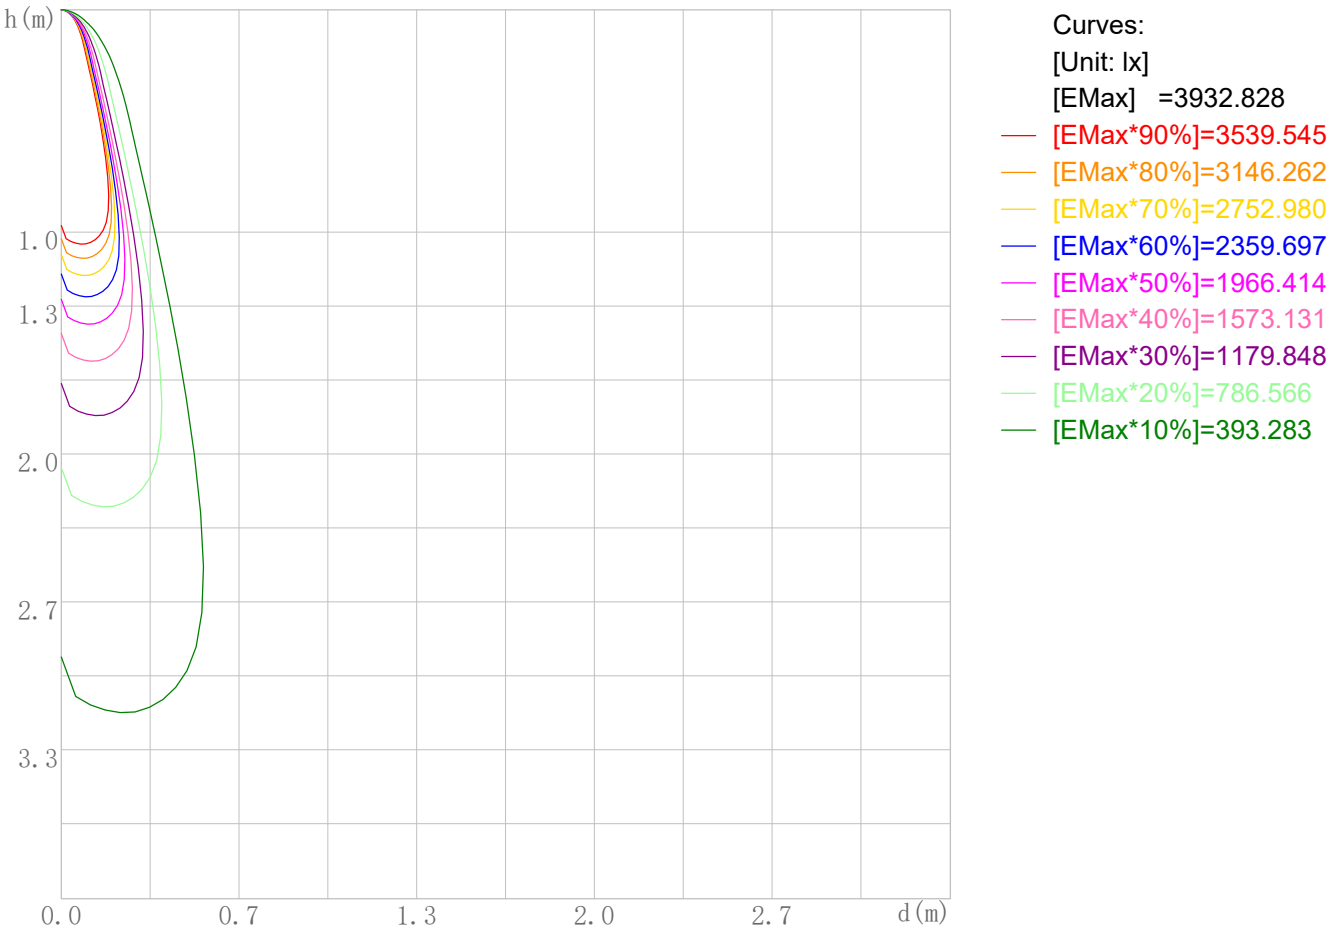

Space Plane Maximum Illuminance and @Angle:3932.83lx,4.0deg
Plane Maximum Lighting Intensity and @Angle:3970.247cd,0deg

Illuminance-Distance Diagram

Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Department
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/10/27

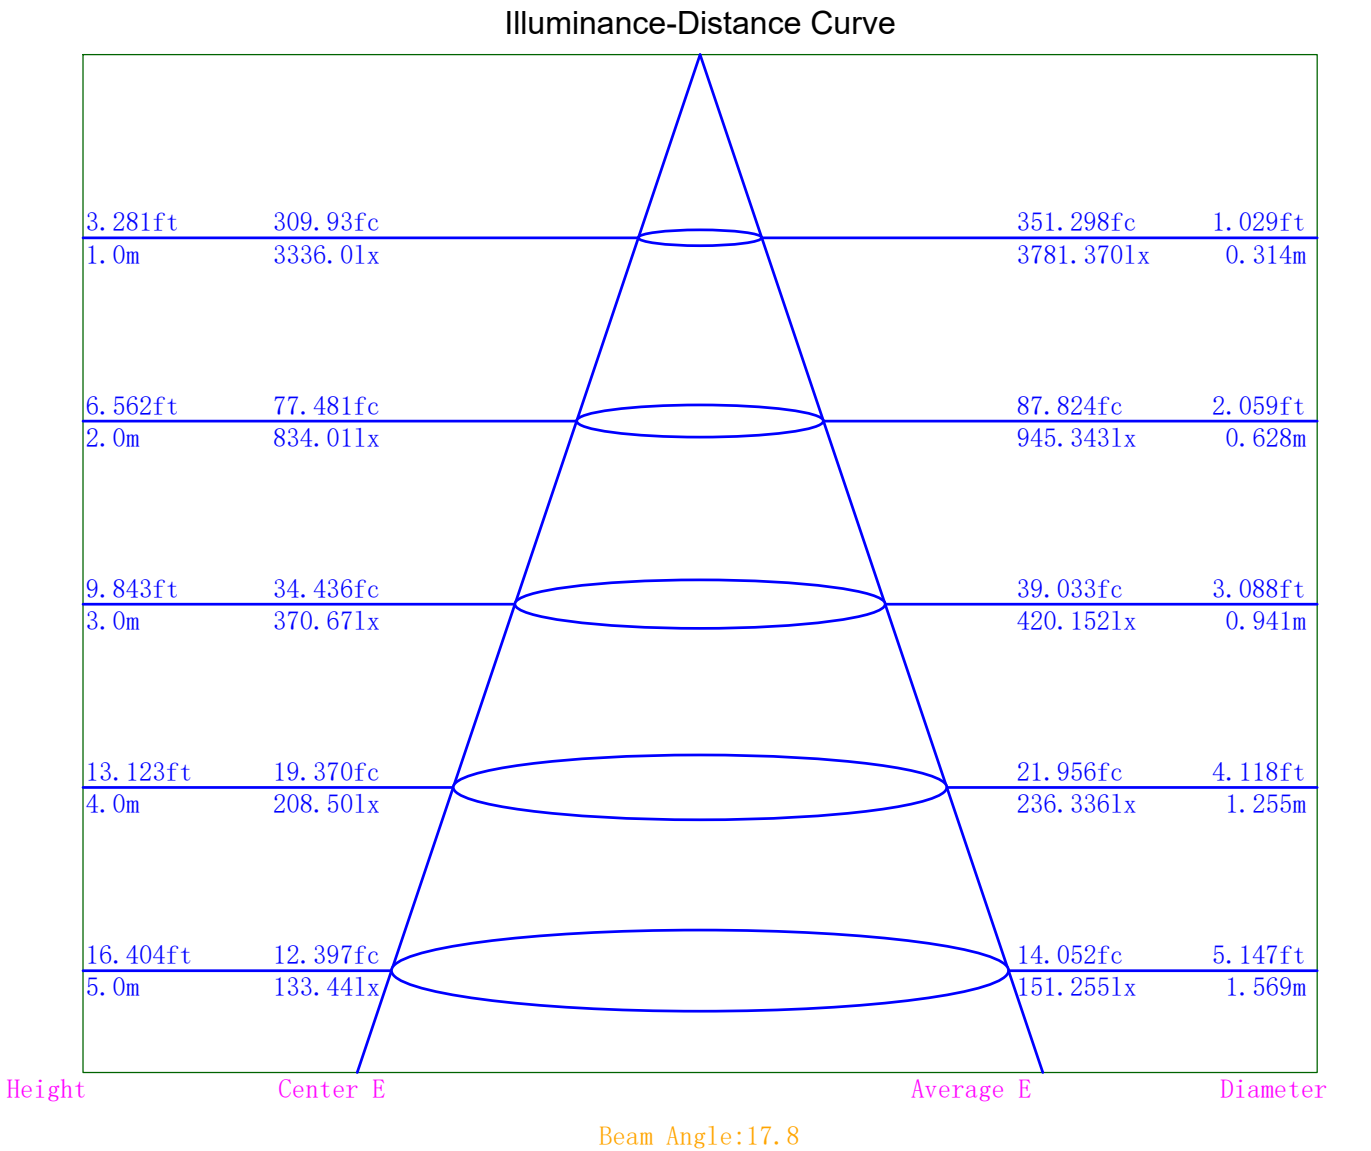

Indoor Luminance Limiting Curves

Lum. Name: TR08-06-XX-02 3000K RA90 15D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/10/27


Glare Grade Table

GI	Quality	Using Illuminance							
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E	a				2000	1000	500	<=300
			b	c	d	e	f	g	h

Luminance Table

Gama(deg)	45	50	55	60	65	70	75	80	85
C0	35276	27126	21133	16050	13584	11591	9628	8627	8953
C90	20347	15233	10952	8606	6330	4187	2647	340	0

Luminance Limiting Curve

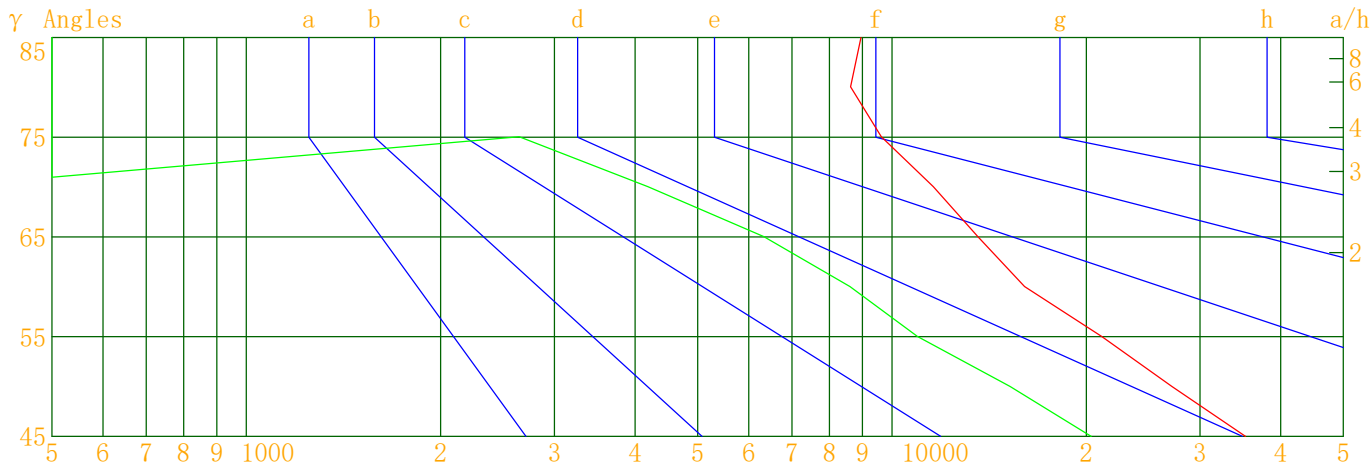

Luminous Size:

Length(m)=-0.038

Width(m)=-0.038

Height(m)=0.000

Area(m^2)=0.001134

Luminous Type:

Without Luminous Side


Luminous Curves:

C0-C180 Color: —

C90-C270 Color: —

Indoor Budgetary Estimate Table

Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Department
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/10/27

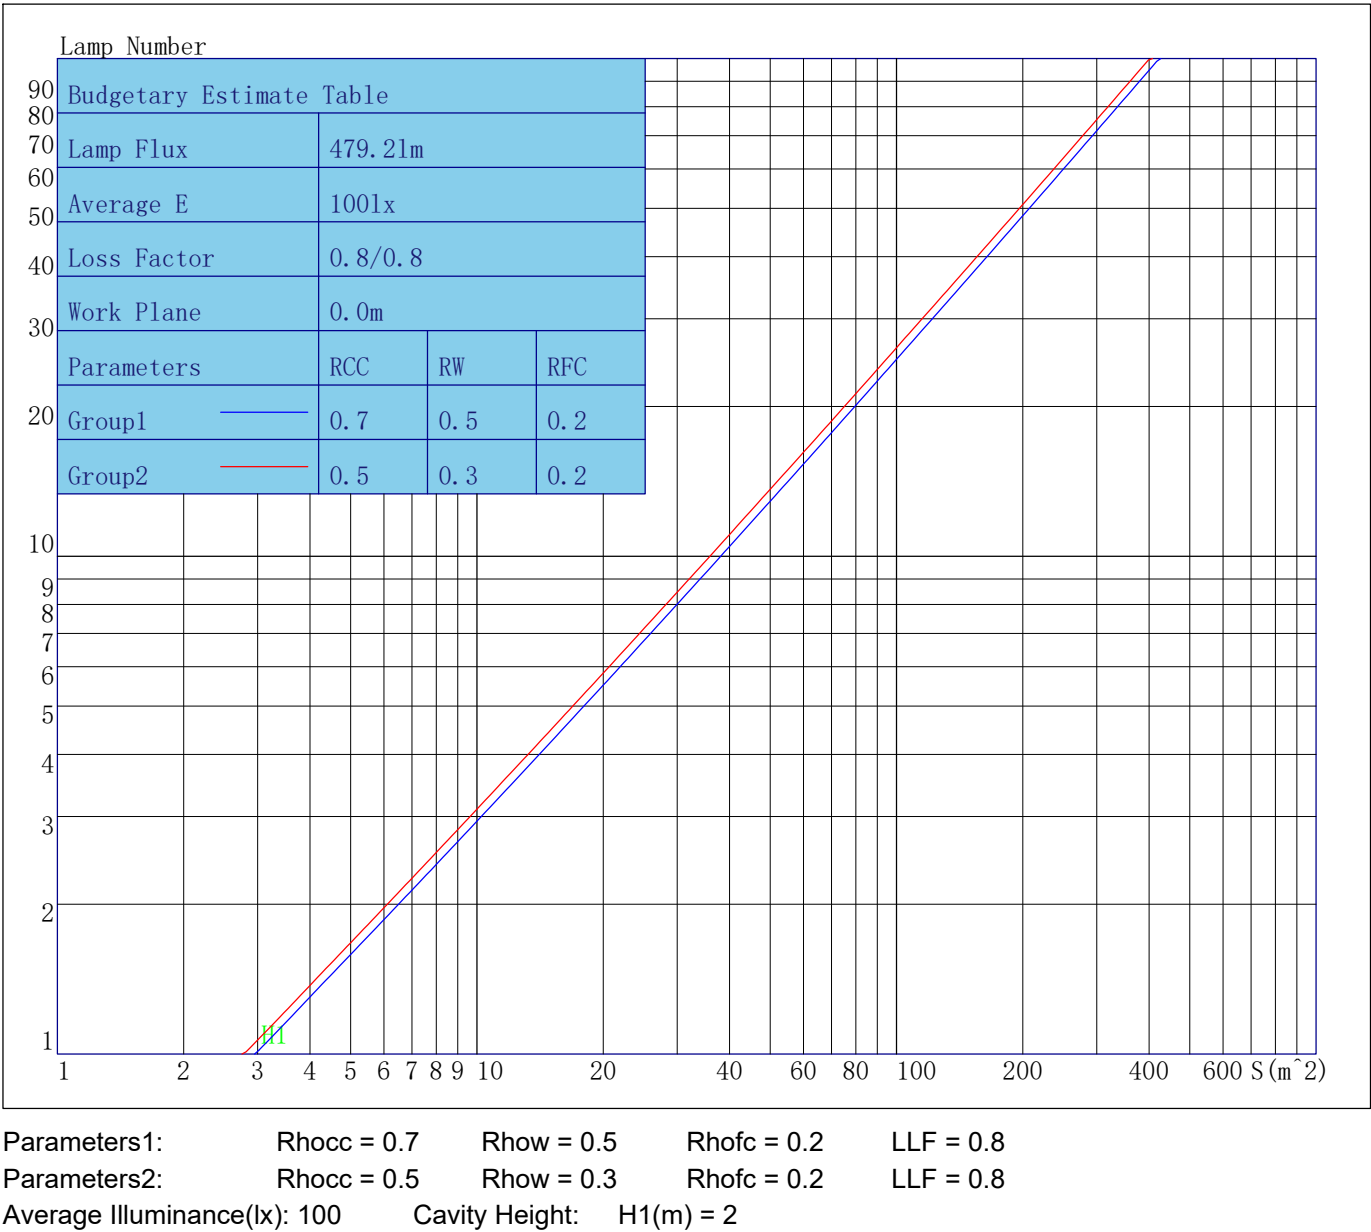

Indoor Coefficient of Utilization Table

Lum. Name:TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Department
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/10/27

Coefficients of Utilization - Zonal Cavity Method																		
Coef.	Effective Floor Cavity Reflectance RFC=0.20																	
RhoCC (%)	80				70				50			30			10			0
RhoW (%)	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	Coefficient of Utilization(%)																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	112	110	109	112	110	108	107	106	105	104	102	101	100	99	98	97	96
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	96	95	94	92
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89
4	103	98	94	91	102	97	93	90	95	91	89	93	90	88	91	89	87	86
5	100	94	90	87	99	93	89	86	92	88	86	90	87	85	89	86	84	83
6	97	91	87	84	96	90	86	83	89	85	83	88	84	82	86	84	82	81
7	95	88	84	81	94	87	83	81	86	83	80	85	82	80	84	81	79	78
8	92	85	81	78	91	85	81	78	84	80	78	83	80	78	82	79	77	76
9	90	83	79	76	89	83	79	76	82	78	76	81	78	76	80	77	75	74
10	88	81	77	74	87	81	77	74	80	76	74	79	76	74	79	76	74	73

Unified Glare Rating Table

Lum. Name: TR08-06-XX-02 3000K RA90 15D	Lum. Catelog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/10/27

Unified Glare Rating Table

Ceiling RCC	0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
Wall RW	0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
Floor RFC	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room Size	Vewed crosswise					Vewed endwise				
X=2H Y=2H	18.0	19.3	18.4	19.6	19.9	14.8	16.1	15.2	16.4	16.7
	18.4	19.6	18.8	19.9	20.3	15.0	16.1	15.3	16.4	16.8
	18.5	19.6	19.0	20.0	20.4	14.9	16.0	15.3	16.4	16.8
	18.6	19.6	19.1	20.0	20.4	14.8	15.8	15.3	16.2	16.6
	18.7	19.6	19.1	20.0	20.4	14.8	15.8	15.2	16.2	16.6
	18.7	19.6	19.1	20.0	20.5	14.7	15.7	15.2	16.1	16.5
X=4H Y=2H	18.0	19.1	18.4	19.5	19.9	14.9	16.0	15.3	16.4	16.8
	18.5	19.5	18.9	19.9	20.3	15.1	16.1	15.6	16.5	16.9
	18.7	19.6	19.1	20.0	20.5	15.1	16.0	15.6	16.4	16.9
	18.9	19.7	19.3	20.1	20.6	15.0	15.9	15.5	16.3	16.8
	18.9	19.7	19.4	20.1	20.6	15.0	15.8	15.5	16.2	16.7
	19.0	19.7	19.5	20.2	20.6	14.9	15.6	15.4	16.1	16.6
X=8H Y=4H	18.6	19.4	19.1	19.9	20.3	15.1	15.9	15.6	16.3	16.8
	18.8	19.5	19.3	20.0	20.6	15.0	15.7	15.5	16.2	16.8
	18.9	19.6	19.5	20.1	20.6	14.9	15.6	15.5	16.1	16.6
	19.1	19.6	19.6	20.1	20.7	14.9	15.5	15.4	16.0	16.5
X=12H Y=4H	18.6	19.3	19.1	19.8	20.3	15.0	15.8	15.5	16.2	16.7
	18.8	19.5	19.3	19.9	20.5	15.0	15.6	15.5	16.1	16.6
	18.9	19.5	19.4	20.0	20.6	14.9	15.5	15.4	16.0	16.6
Variations with the objverver position at spacings										
S=1.0H	0.4/-0.4					1.4/-1.9				
S=1.5H	0.9/-1.0					2.1/-3.0				
S=2.0H	1.5/-1.5					2.9/-4.0				
Reduced UGR Table:										
Nordic Standard Table:	BK0					BK0				
Correction Value	1.1					0.6				

o the CIE Pub.117,data has been corrected,refers to the lamp’s lumens 8.2flm.

Candela Tabulation

V/H	C0.0	C90.0	C180.0	C270.0
γ 0.0	3336.03	3336.03	3336.03	3336.03
γ 1.0	3756.24	2667.87	3370.04	2890.87
γ 2.0	3855.03	2468.18	3045.82	2912.26
γ 3.0	3921.52	2207.93	2635.80	2874.15
γ 4.0	3961.71	1917.04	2170.84	2779.55
γ 5.0	3970.25	1618.30	1719.08	2621.51
γ 6.0	3937.79	1333.86	1325.76	2413.67
γ 7.0	3873.38	1079.75	1011.49	2154.52
γ 8.0	3765.91	869.20	781.37	1869.09
γ 9.0	3609.47	701.33	611.70	1575.01
γ 10.0	3384.52	569.90	485.46	1301.58
γ 11.0	3058.60	467.21	391.87	1062.91
γ 12.0	2638.99	386.20	321.33	866.89
γ 13.0	2175.58	323.10	266.49	709.65
γ 14.0	1724.56	273.04	224.75	584.45
γ 15.0	1335.53	232.85	191.07	483.15
γ 16.0	1026.73	200.44	164.37	401.38
γ 17.0	793.20	174.62	143.11	336.05
γ 18.0	621.85	154.13	125.89	283.05
γ 19.0	497.07	137.19	111.03	240.19
γ 20.0	404.34	123.07	98.18	205.89
γ 21.0	334.31	111.00	86.83	177.96
γ 22.0	280.32	100.36	76.55	155.73
γ 23.0	238.19	91.02	67.75	137.04
γ 24.0	205.35	82.60	60.27	121.16
γ 25.0	179.24	75.06	53.90	107.59
γ 26.0	158.80	68.45	48.46	95.66
γ 27.0	141.76	62.59	43.85	85.13
γ 28.0	127.37	57.31	40.07	75.75
γ 29.0	114.83	52.57	37.04	67.67
γ 30.0	103.67	48.31	34.49	60.64
γ 31.0	93.78	44.65	32.34	54.57
γ 32.0	84.98	41.44	30.19	49.32
γ 33.0	77.16	38.52	28.15	44.88
γ 34.0	70.35	35.72	26.38	41.25
γ 35.0	64.21	33.11	24.82	38.06
γ 36.0	58.65	30.72	23.41	35.39
γ 37.0	53.87	28.52	22.12	32.84
γ 38.0	49.64	26.53	20.93	30.30
γ 39.0	45.90	24.75	19.77	28.16
γ 40.0	42.50	23.09	18.63	26.31
γ 41.0	39.14	21.56	17.52	24.76
γ 42.0	36.02	20.12	16.41	23.38
γ 43.0	33.17	18.79	15.36	22.17
γ 44.0	30.58	17.53	14.34	21.05
γ 45.0	28.29	16.32	13.35	19.95
γ 46.0	26.27	15.16	12.40	18.89

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 47.0	24.41	14.08	11.48	17.84
γ 48.0	22.71	13.04	10.61	16.82
γ 49.0	21.17	12.05	9.74	15.83
γ 50.0	19.77	11.10	8.90	14.83
γ 51.0	18.43	10.16	8.11	13.87
γ 52.0	17.18	9.28	7.49	12.95
γ 53.0	15.97	8.42	7.03	12.07
γ 54.0	14.82	7.70	6.59	11.25
γ 55.0	13.75	7.12	6.19	10.43
γ 56.0	12.74	6.65	5.79	9.64
γ 57.0	11.76	6.20	5.36	8.91
γ 58.0	10.85	5.75	4.96	8.34
γ 59.0	9.94	5.31	4.58	7.91
γ 60.0	9.10	4.88	4.21	7.49
γ 61.0	8.40	4.49	3.85	7.07
γ 62.0	7.89	4.11	3.47	6.68
γ 63.0	7.40	3.75	3.10	6.28
γ 64.0	6.95	3.41	2.79	5.88
γ 65.0	6.51	3.03	2.50	5.49
γ 66.0	6.07	2.71	2.19	5.12
γ 67.0	5.65	2.43	1.90	4.74
γ 68.0	5.26	2.18	1.65	4.33
γ 69.0	4.87	1.88	1.45	3.96
γ 70.0	4.50	1.62	1.27	3.62
γ 71.0	4.10	1.44	1.08	3.32
γ 72.0	3.72	1.26	0.92	2.99
γ 73.0	3.42	1.10	0.76	2.65
γ 74.0	3.14	0.94	0.61	2.40
γ 75.0	2.83	0.78	0.46	2.18
γ 76.0	2.50	0.63	0.34	1.97
γ 77.0	2.28	0.47	0.21	1.76
γ 78.0	2.08	0.34	0.09	1.57
γ 79.0	1.88	0.20	0.00	1.39
γ 80.0	1.70	0.07	0.00	1.23
γ 81.0	1.52	0.00	0.00	1.07
γ 82.0	1.35	0.00	0.00	0.92
γ 83.0	1.19	0.00	0.00	0.77
γ 84.0	1.04	0.00	0.00	0.62
γ 85.0	0.88	0.00	0.00	0.49
γ 86.0	0.74	0.00	0.00	0.34
γ 87.0	0.59	0.00	0.00	0.21
γ 88.0	0.46	0.00	0.00	0.09
γ 89.0	0.32	0.00	0.00	0.00
γ 90.0	0.20	0.00	0.00	0.00
γ 91.0	0.08	0.00	0.00	0.00
γ 92.0	0.00	0.00	0.00	0.00
γ 93.0	0.00	0.00	0.00	0.00

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 94.0	0.00	0.00	0.00	0.00
γ 95.0	0.00	0.00	0.00	0.00
γ 96.0	0.00	0.00	0.00	0.00
γ 97.0	0.00	0.00	0.00	0.00
γ 98.0	0.00	0.00	0.00	0.00
γ 99.0	0.00	0.00	0.00	0.00
γ 100.0	0.00	0.00	0.00	0.00
γ 101.0	0.00	0.00	0.00	0.00
γ 102.0	0.00	0.00	0.00	0.00
γ 103.0	0.00	0.00	0.00	0.00
γ 104.0	0.00	0.00	0.00	0.00
γ 105.0	0.00	0.00	0.00	0.00
γ 106.0	0.00	0.00	0.00	0.00
γ 107.0	0.00	0.00	0.00	0.00
γ 108.0	0.00	0.00	0.00	0.00
γ 109.0	0.00	0.00	0.00	0.00
γ 110.0	0.00	0.00	0.00	0.00
γ 111.0	0.00	0.00	0.00	0.00
γ 112.0	0.00	0.00	0.00	0.00
γ 113.0	0.00	0.00	0.00	0.00
γ 114.0	0.00	0.00	0.00	0.00
γ 115.0	0.00	0.00	0.00	0.00
γ 116.0	0.00	0.00	0.00	0.00
γ 117.0	0.00	0.00	0.00	0.00
γ 118.0	0.00	0.00	0.00	0.00
γ 119.0	0.00	0.00	0.00	0.00
γ 120.0	0.00	0.00	0.00	0.00
γ 121.0	0.00	0.00	0.00	0.00
γ 122.0	0.00	0.00	0.00	0.00
γ 123.0	0.00	0.00	0.00	0.00
γ 124.0	0.00	0.00	0.00	0.00
γ 125.0	0.00	0.00	0.00	0.00
γ 126.0	0.00	0.00	0.00	0.00
γ 127.0	0.00	0.00	0.00	0.00
γ 128.0	0.00	0.00	0.00	0.00
γ 129.0	0.00	0.00	0.00	0.00
γ 130.0	0.00	0.00	0.00	0.00
γ 131.0	0.00	0.00	0.00	0.00
γ 132.0	0.00	0.00	0.00	0.00
γ 133.0	0.00	0.00	0.00	0.00
γ 134.0	0.00	0.00	0.00	0.00
γ 135.0	0.00	0.00	0.15	0.00
γ 136.0	0.00	0.00	0.32	0.00
γ 137.0	0.00	0.00	0.50	0.00
γ 138.0	0.00	0.00	0.67	0.00
γ 139.0	0.00	0.00	0.85	0.01
γ 140.0	0.00	0.09	1.01	0.17

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 141.0	0.00	0.26	1.16	0.32
γ 142.0	0.00	0.42	1.31	0.48
γ 143.0	0.00	0.60	1.43	0.65
γ 144.0	0.00	0.75	1.55	0.82
γ 145.0	0.01	0.89	1.65	0.98
γ 146.0	0.18	1.04	1.73	1.14
γ 147.0	0.34	1.16	1.81	1.30
γ 148.0	0.51	1.28	1.88	1.45
γ 149.0	0.67	1.36	1.92	1.58
γ 150.0	0.84	1.45	1.98	1.70
γ 151.0	0.99	1.51	2.01	1.80
γ 152.0	1.14	1.57	2.04	1.86
γ 153.0	1.27	1.61	2.07	1.90
γ 154.0	1.40	1.63	2.08	1.94
γ 155.0	1.51	1.67	2.11	1.96
γ 156.0	1.60	1.68	2.12	1.97
γ 157.0	1.68	1.71	2.13	1.98
γ 158.0	1.75	1.74	2.15	1.99
γ 159.0	1.80	1.76	2.15	2.00
γ 160.0	1.85	1.78	2.16	2.01
γ 161.0	1.89	1.82	2.15	2.02
γ 162.0	1.92	1.84	2.15	2.03
γ 163.0	1.94	1.86	2.13	2.04
γ 164.0	1.97	1.88	2.12	2.06
γ 165.0	1.99	1.89	2.09	2.07
γ 166.0	2.01	1.90	2.04	2.09
γ 167.0	2.03	1.91	1.99	2.09
γ 168.0	2.05	1.89	1.92	2.11
γ 169.0	2.06	1.86	1.86	2.11
γ 170.0	2.07	1.82	1.77	2.11
γ 171.0	2.07	1.75	1.70	2.10
γ 172.0	2.05	1.68	1.61	2.08
γ 173.0	2.03	1.62	1.53	2.03
γ 174.0	2.00	1.58	1.49	1.97
γ 175.0	1.97	1.56	1.46	1.90
γ 176.0	1.92	1.56	1.46	1.81
γ 177.0	1.85	1.57	1.48	1.73
γ 178.0	1.77	1.58	1.51	1.67
γ 179.0	1.68	1.56	1.57	1.64
γ 180.0	1.62	1.62	1.62	1.62