



Indoor Luminaire Photometric Data

Description Information

Luminary Name: TR08-06-XX-04 3000K RA90 36D		Lum. Catalog:	Test ID: 01
Lamp Name:		Lamp Catalog: LED	Test Date: 2021/11/13
Manufacture: Shenzhen Norming Lighting Co., Ltd		Shld.Ang(°):	Test Machine:GON-2000
Test Lab: Quality Department		Frequency (Hz):	Lamp CCT (K): Ra:
Lum. Size (W*L*H):0.038m*0.038m*0.000m		Lum. Area (m2):0.001	Lum. W (kg): 0.000
Test System: C, γ	Test Step: C=90.0 γ=1.0	Temp. (°C): 25	Humidity(%): 50.0


Character Parameter

Lamp Speciality Parameter		Luminaire Speciality Parameter	
Rated Flux(lm): 531.770	Luminary Flux(lm): 531.767	Field Angle(10%Imax): 58.9(°)	
Rated Power(W):	Luminary Efficiency: 100.00%	Down Lumens&Percent: 530.469lm 99.76%	
Rated Voltage(V):	Luminary EER(lm/W): 85.301	Up Lumens&Percent: 1.298lm 0.24%	
Tested Power(W): 6.234	Max. Candela(cd): 1296.545	S/MH: C0_a180=0.627 C90_270=0.627	
Lamps' Inside: 1	Max Cand@Ang. (°): C=0.0 γ=7.0	CIE Type: Semi-Direct	
Tested Electrics (V, A, pf):241.0, 0.030, 0.845	Beam Angle(50%Imax): 35.9(°)	ErP Φ use(90°): 493.844lm	
Lamp Size (W*L*H):0.038m*0.038m*0.000m	Left=-16.0°, Right=19.9°	IRF(%): 458.431	

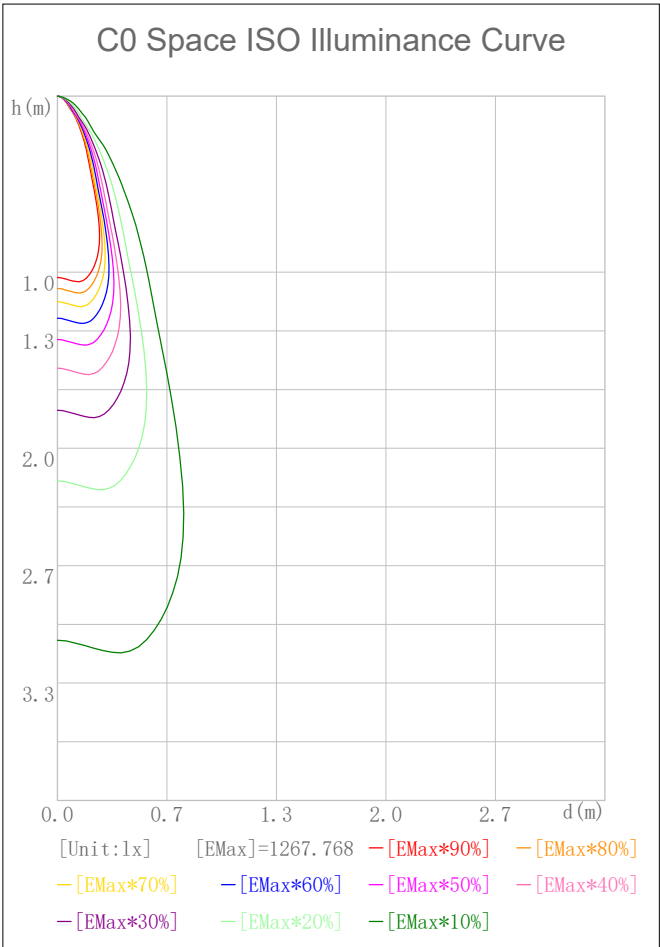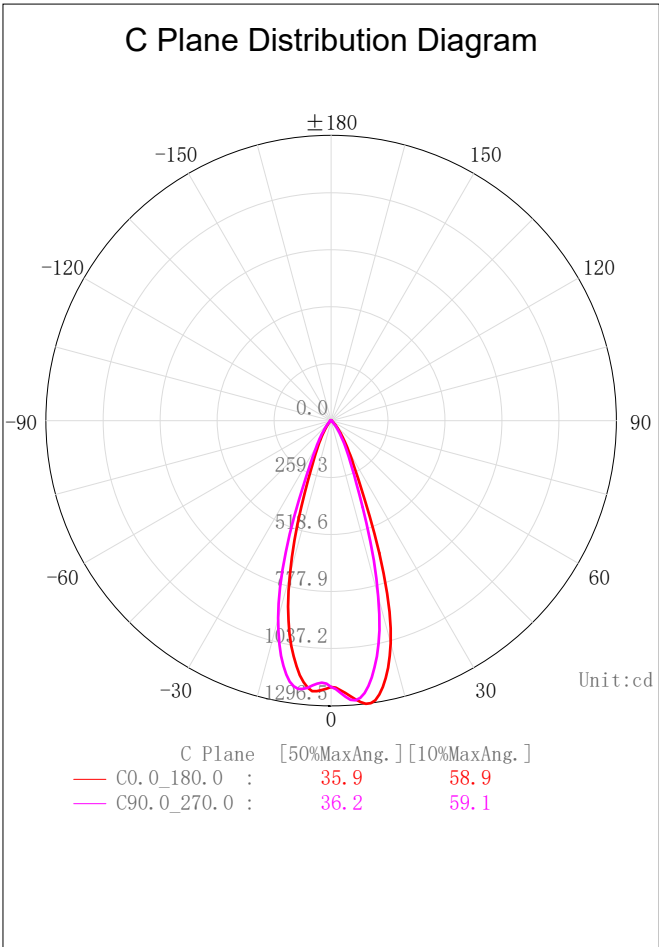

2D Plane Light Intensity Distribution Curve


Lum. Name:TR08-06-XX-04 3000K RA90 36D	Lum. Catalog:	Test ID:01
Lamp Name:	Lamp Catalog:LED	Test Lab:Quality Deparment
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/11/13

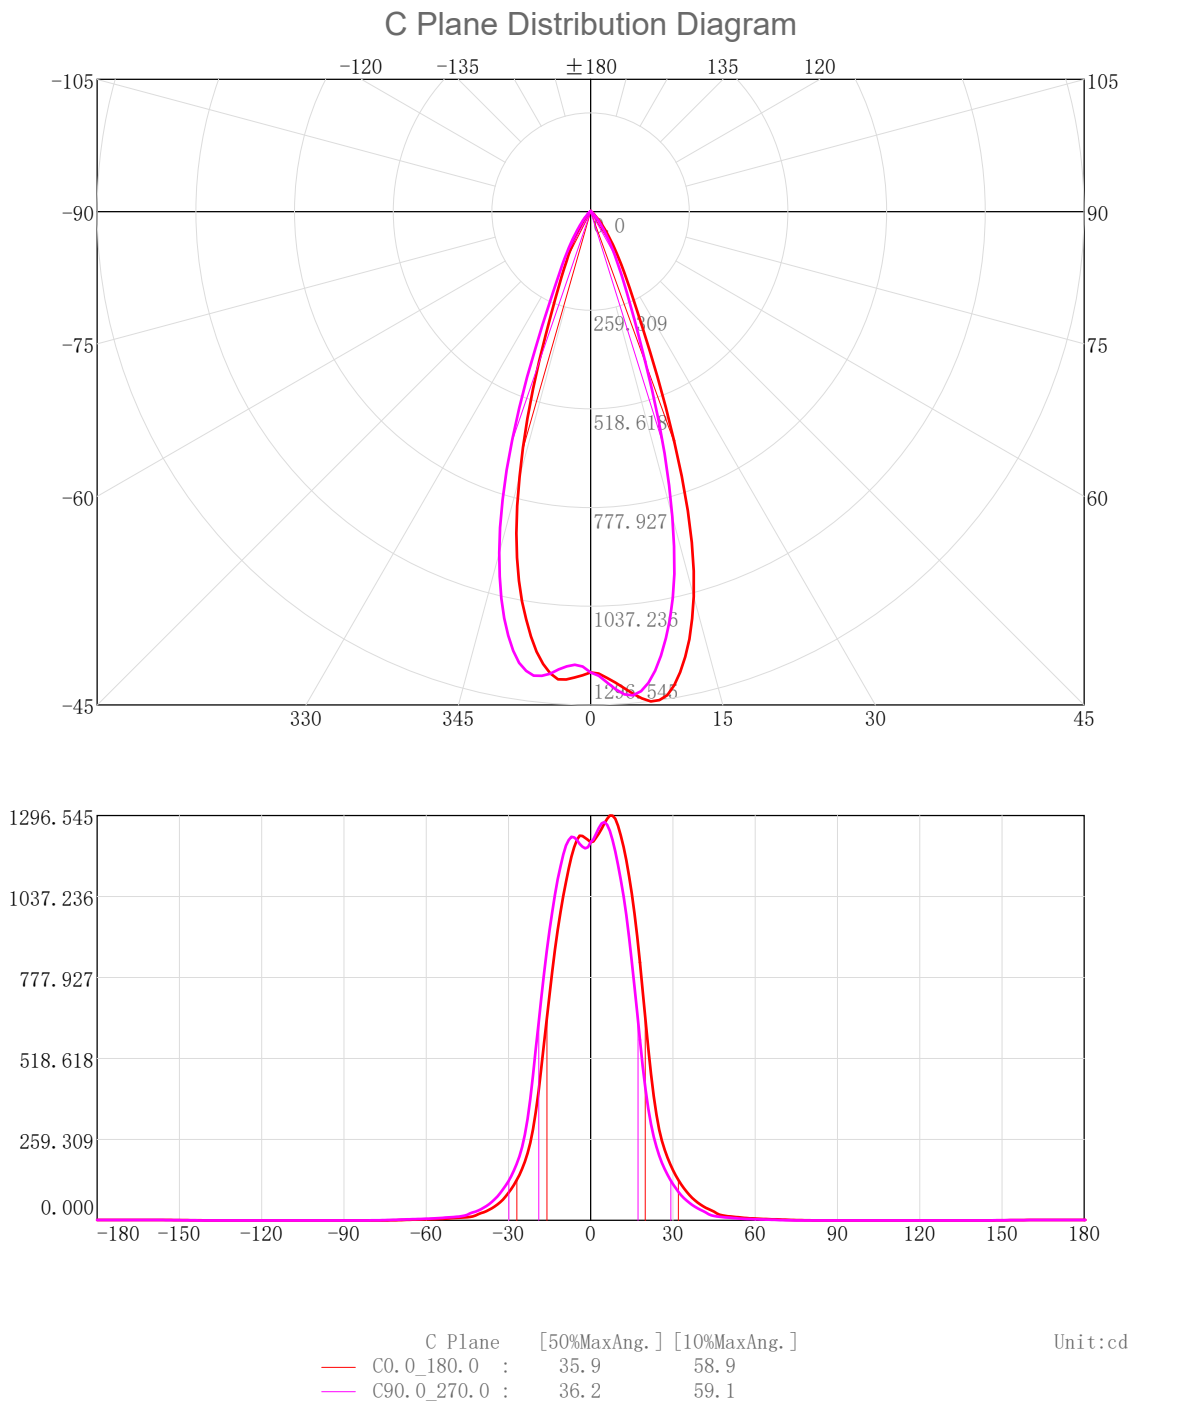

3D Light Intensity Distribution Modal

Lum. Name:TR08-06-XX-04 3000K RA90 36D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Deparment
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/11/13

3D Light Intensity Distribution Modal

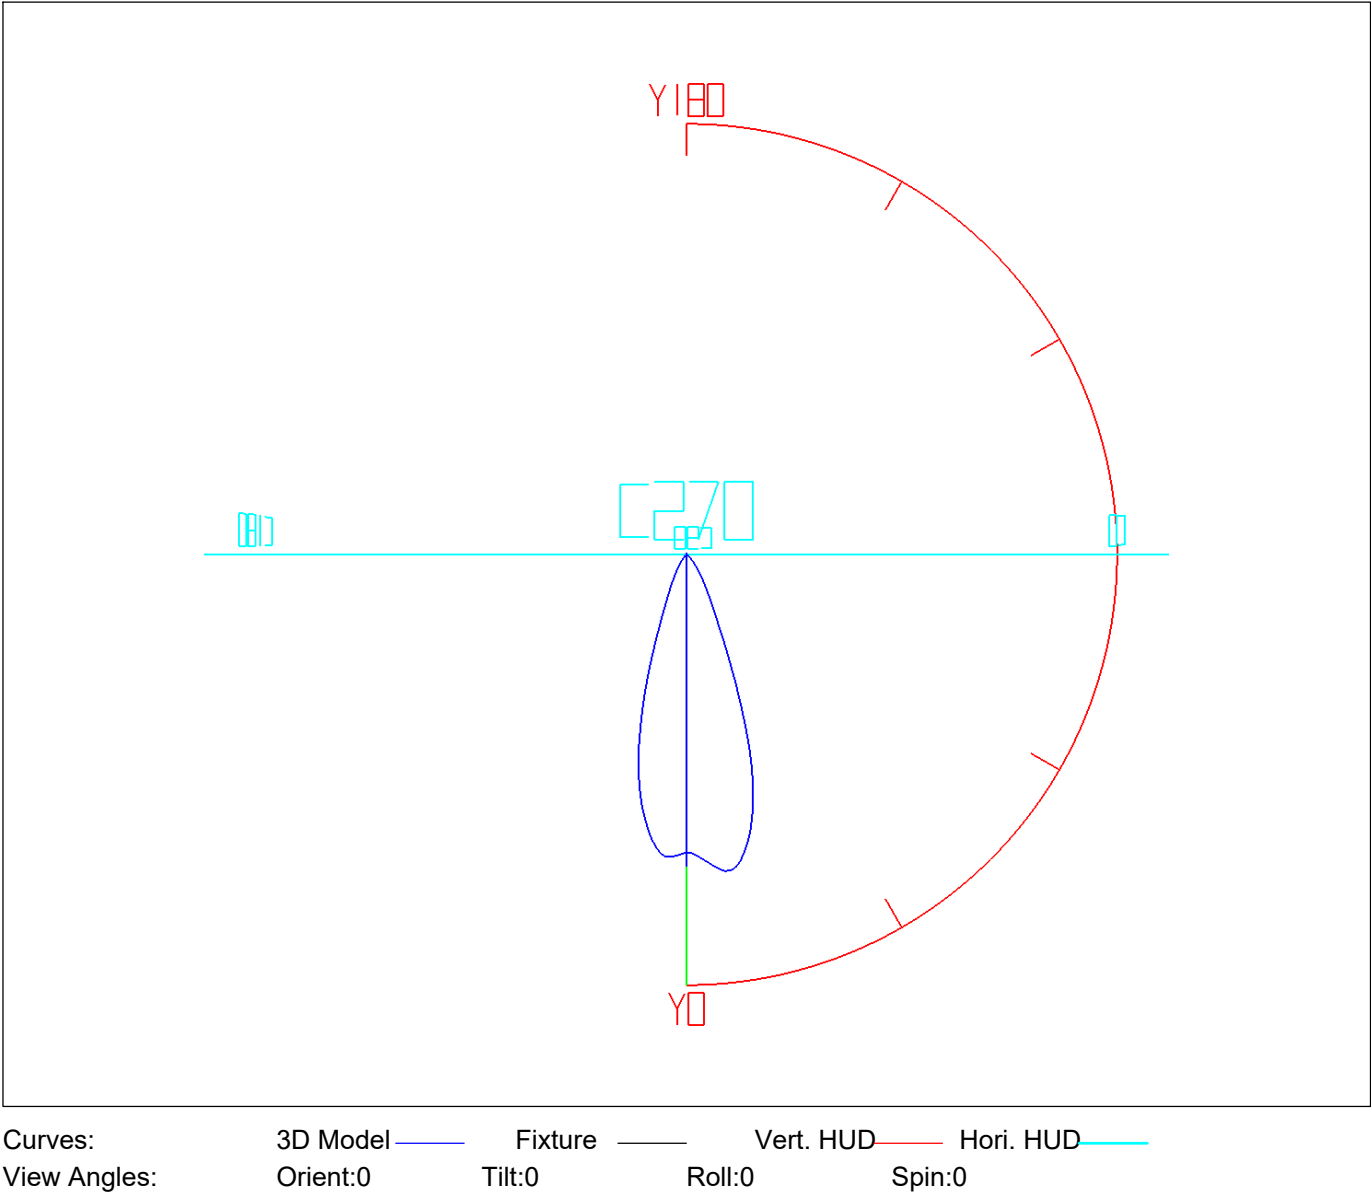

IES Indoor Report

Photometric Filename:TR08-06-XX-04 3000K RA90 36D.IES

Zonal Flux Tabulation


Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone(γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
0.0-1.0	1.16	1.16	0.22	0.22	47.0-48.0	1.02	518.35	0.19	97.48
1.0-2.0	3.49	4.65	0.66	0.87	48.0-49.0	0.95	519.30	0.18	97.66
2.0-3.0	5.86	10.51	1.10	1.98	49.0-50.0	0.89	520.19	0.17	97.82
3.0-4.0	8.27	18.78	1.56	3.53	50.0-51.0	0.84	521.03	0.16	97.98
4.0-5.0	10.70	29.48	2.01	5.54	51.0-52.0	0.79	521.82	0.15	98.13
5.0-6.0	13.08	42.57	2.46	8.00	52.0-53.0	0.74	522.56	0.14	98.27
6.0-7.0	15.38	57.94	2.89	10.90	53.0-54.0	0.69	523.24	0.13	98.40
7.0-8.0	17.53	75.47	3.30	14.19	54.0-55.0	0.64	523.89	0.12	98.52
8.0-9.0	19.47	94.95	3.66	17.85	55.0-56.0	0.59	524.48	0.11	98.63
9.0-10.0	21.19	116.13	3.98	21.84	56.0-57.0	0.55	525.03	0.10	98.73
10.0-11.0	22.63	138.76	4.26	26.09	57.0-58.0	0.52	525.55	0.10	98.83
11.0-12.0	23.78	162.54	4.47	30.57	58.0-59.0	0.48	526.03	0.09	98.92
12.0-13.0	24.61	187.15	4.63	35.19	59.0-60.0	0.46	526.49	0.09	99.01
13.0-14.0	25.07	212.22	4.71	39.91	60.0-61.0	0.43	526.91	0.08	99.09
14.0-15.0	25.12	237.34	4.72	44.63	61.0-62.0	0.40	527.31	0.08	99.16
15.0-16.0	24.78	262.12	4.66	49.29	62.0-63.0	0.38	527.69	0.07	99.23
16.0-17.0	24.03	286.15	4.52	53.81	63.0-64.0	0.35	528.04	0.07	99.30
17.0-18.0	22.84	308.99	4.30	58.11	64.0-65.0	0.33	528.37	0.06	99.36
18.0-19.0	21.24	330.23	3.99	62.10	65.0-66.0	0.31	528.68	0.06	99.42
19.0-20.0	19.36	349.58	3.64	65.74	66.0-67.0	0.29	528.97	0.05	99.47
20.0-21.0	17.39	366.97	3.27	69.01	67.0-68.0	0.26	529.23	0.05	99.52
21.0-22.0	15.49	382.46	2.91	71.92	68.0-69.0	0.23	529.46	0.04	99.57
22.0-23.0	13.75	396.21	2.59	74.51	69.0-70.0	0.20	529.66	0.04	99.60
23.0-24.0	12.26	408.48	2.31	76.81	70.0-71.0	0.17	529.83	0.03	99.64
24.0-25.0	11.01	419.49	2.07	78.89	71.0-72.0	0.14	529.98	0.03	99.66
25.0-26.0	9.97	429.46	1.88	80.76	72.0-73.0	0.12	530.09	0.02	99.68
26.0-27.0	9.10	438.56	1.71	82.47	73.0-74.0	0.09	530.18	0.02	99.70
27.0-28.0	8.35	446.91	1.57	84.04	74.0-75.0	0.07	530.25	0.01	99.71
28.0-29.0	7.67	454.58	1.44	85.49	75.0-76.0	0.06	530.31	0.01	99.73
29.0-30.0	7.04	461.63	1.32	86.81	76.0-77.0	0.05	530.36	0.01	99.73
30.0-31.0	6.45	468.08	1.21	88.02	77.0-78.0	0.04	530.39	0.01	99.74
31.0-32.0	5.90	473.98	1.11	89.13	78.0-79.0	0.03	530.42	0.01	99.75
32.0-33.0	5.38	479.37	1.01	90.15	79.0-80.0	0.02	530.44	0.00	99.75
33.0-34.0	4.89	484.26	0.92	91.07	80.0-81.0	0.01	530.46	0.00	99.75
34.0-35.0	4.43	488.69	0.83	91.90	81.0-82.0	0.01	530.47	0.00	99.75
35.0-36.0	4.01	492.70	0.75	92.65	82.0-83.0	0.00	530.47	0.00	99.76
36.0-37.0	3.63	496.33	0.68	93.34	83.0-84.0	0.00	530.47	0.00	99.76
37.0-38.0	3.29	499.62	0.62	93.95	84.0-85.0	0.00	530.47	0.00	99.76
38.0-39.0	2.97	502.59	0.56	94.51	85.0-86.0	0.00	530.47	0.00	99.76
39.0-40.0	2.69	505.29	0.51	95.02	86.0-87.0	0.00	530.47	0.00	99.76
40.0-41.0	2.43	507.72	0.46	95.48	87.0-88.0	0.00	530.47	0.00	99.76
41.0-42.0	2.17	509.89	0.41	95.88	88.0-89.0	0.00	530.47	0.00	99.76
42.0-43.0	1.90	511.78	0.36	96.24	89.0-90.0	0.00	530.47	0.00	99.76
43.0-44.0	1.67	513.46	0.31	96.56	90.0-91.0	0.00	530.47	0.00	99.76
44.0-45.0	1.48	514.93	0.28	96.83	91.0-92.0	0.00	530.47	0.00	99.76
45.0-46.0	1.28	516.21	0.24	97.07	92.0-93.0	0.00	530.47	0.00	99.76
46.0-47.0	1.12	517.34	0.21	97.29	93.0-94.0	0.00	530.47	0.00	99.76

Zonal Flux Tabulation - (Cont.)

Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp	Zone (γ)	Zone Flux (lm)	Sums Flux (lm)	Zone%Lamp	Sums%Lamp
94. 0-95. 0	0. 00	530. 47	0. 00	99. 76	141. 0-142. 0	0. 00	530. 48	0. 00	99. 76
95. 0-96. 0	0. 00	530. 47	0. 00	99. 76	142. 0-143. 0	0. 01	530. 48	0. 00	99. 76
96. 0-97. 0	0. 00	530. 47	0. 00	99. 76	143. 0-144. 0	0. 01	530. 50	0. 00	99. 76
97. 0-98. 0	0. 00	530. 47	0. 00	99. 76	144. 0-145. 0	0. 02	530. 51	0. 00	99. 76
98. 0-99. 0	0. 00	530. 47	0. 00	99. 76	145. 0-146. 0	0. 02	530. 53	0. 00	99. 77
99. 0-100. 0	0. 00	530. 47	0. 00	99. 76	146. 0-147. 0	0. 03	530. 56	0. 00	99. 77
100. 0-101. 0	0. 00	530. 47	0. 00	99. 76	147. 0-148. 0	0. 03	530. 59	0. 01	99. 78
101. 0-102. 0	0. 00	530. 47	0. 00	99. 76	148. 0-149. 0	0. 04	530. 62	0. 01	99. 78
102. 0-103. 0	0. 00	530. 47	0. 00	99. 76	149. 0-150. 0	0. 04	530. 66	0. 01	99. 79
103. 0-104. 0	0. 00	530. 47	0. 00	99. 76	150. 0-151. 0	0. 04	530. 71	0. 01	99. 80
104. 0-105. 0	0. 00	530. 47	0. 00	99. 76	151. 0-152. 0	0. 05	530. 76	0. 01	99. 81
105. 0-106. 0	0. 00	530. 47	0. 00	99. 76	152. 0-153. 0	0. 05	530. 81	0. 01	99. 82
106. 0-107. 0	0. 00	530. 47	0. 00	99. 76	153. 0-154. 0	0. 05	530. 86	0. 01	99. 83
107. 0-108. 0	0. 00	530. 47	0. 00	99. 76	154. 0-155. 0	0. 05	530. 91	0. 01	99. 84
108. 0-109. 0	0. 00	530. 47	0. 00	99. 76	155. 0-156. 0	0. 06	530. 97	0. 01	99. 85
109. 0-110. 0	0. 00	530. 47	0. 00	99. 76	156. 0-157. 0	0. 06	531. 02	0. 01	99. 86
110. 0-111. 0	0. 00	530. 47	0. 00	99. 76	157. 0-158. 0	0. 06	531. 08	0. 01	99. 87
111. 0-112. 0	0. 00	530. 47	0. 00	99. 76	158. 0-159. 0	0. 06	531. 13	0. 01	99. 88
112. 0-113. 0	0. 00	530. 47	0. 00	99. 76	159. 0-160. 0	0. 05	531. 19	0. 01	99. 89
113. 0-114. 0	0. 00	530. 47	0. 00	99. 76	160. 0-161. 0	0. 05	531. 24	0. 01	99. 90
114. 0-115. 0	0. 00	530. 47	0. 00	99. 76	161. 0-162. 0	0. 05	531. 29	0. 01	99. 91
115. 0-116. 0	0. 00	530. 47	0. 00	99. 76	162. 0-163. 0	0. 05	531. 34	0. 01	99. 92
116. 0-117. 0	0. 00	530. 47	0. 00	99. 76	163. 0-164. 0	0. 05	531. 39	0. 01	99. 93
117. 0-118. 0	0. 00	530. 47	0. 00	99. 76	164. 0-165. 0	0. 04	531. 44	0. 01	99. 94
118. 0-119. 0	0. 00	530. 47	0. 00	99. 76	165. 0-166. 0	0. 04	531. 48	0. 01	99. 95
119. 0-120. 0	0. 00	530. 47	0. 00	99. 76	166. 0-167. 0	0. 04	531. 52	0. 01	99. 95
120. 0-121. 0	0. 00	530. 47	0. 00	99. 76	167. 0-168. 0	0. 04	531. 55	0. 01	99. 96
121. 0-122. 0	0. 00	530. 47	0. 00	99. 76	168. 0-169. 0	0. 03	531. 59	0. 01	99. 97
122. 0-123. 0	0. 00	530. 47	0. 00	99. 76	169. 0-170. 0	0. 03	531. 62	0. 01	99. 97
123. 0-124. 0	0. 00	530. 47	0. 00	99. 76	170. 0-171. 0	0. 03	531. 65	0. 01	99. 98
124. 0-125. 0	0. 00	530. 47	0. 00	99. 76	171. 0-172. 0	0. 02	531. 67	0. 00	99. 98
125. 0-126. 0	0. 00	530. 47	0. 00	99. 76	172. 0-173. 0	0. 02	531. 69	0. 00	99. 99
126. 0-127. 0	0. 00	530. 47	0. 00	99. 76	173. 0-174. 0	0. 02	531. 71	0. 00	99. 99
127. 0-128. 0	0. 00	530. 47	0. 00	99. 76	174. 0-175. 0	0. 02	531. 73	0. 00	99. 99
128. 0-129. 0	0. 00	530. 47	0. 00	99. 76	175. 0-176. 0	0. 01	531. 74	0. 00	99. 99
129. 0-130. 0	0. 00	530. 47	0. 00	99. 76	176. 0-177. 0	0. 01	531. 75	0. 00	100. 00
130. 0-131. 0	0. 00	530. 47	0. 00	99. 76	177. 0-178. 0	0. 01	531. 76	0. 00	100. 00
131. 0-132. 0	0. 00	530. 47	0. 00	99. 76	178. 0-179. 0	0. 00	531. 77	0. 00	100. 00
132. 0-133. 0	0. 00	530. 47	0. 00	99. 76	179. 0-180. 0	0. 00	531. 77	0. 00	100. 00
133. 0-134. 0	0. 00	530. 47	0. 00	99. 76					
134. 0-135. 0	0. 00	530. 47	0. 00	99. 76					
135. 0-136. 0	0. 00	530. 47	0. 00	99. 76					
136. 0-137. 0	0. 00	530. 47	0. 00	99. 76					
137. 0-138. 0	0. 00	530. 47	0. 00	99. 76					
138. 0-139. 0	0. 00	530. 47	0. 00	99. 76					
139. 0-140. 0	0. 00	530. 47	0. 00	99. 76					
140. 0-141. 0	0. 00	530. 47	0. 00	99. 76					

Rectangle ISO Lighting Intensity Diagram


Lum. Name:TR08-06-XX-04 3000K RA90 36D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Deparment
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/11/13

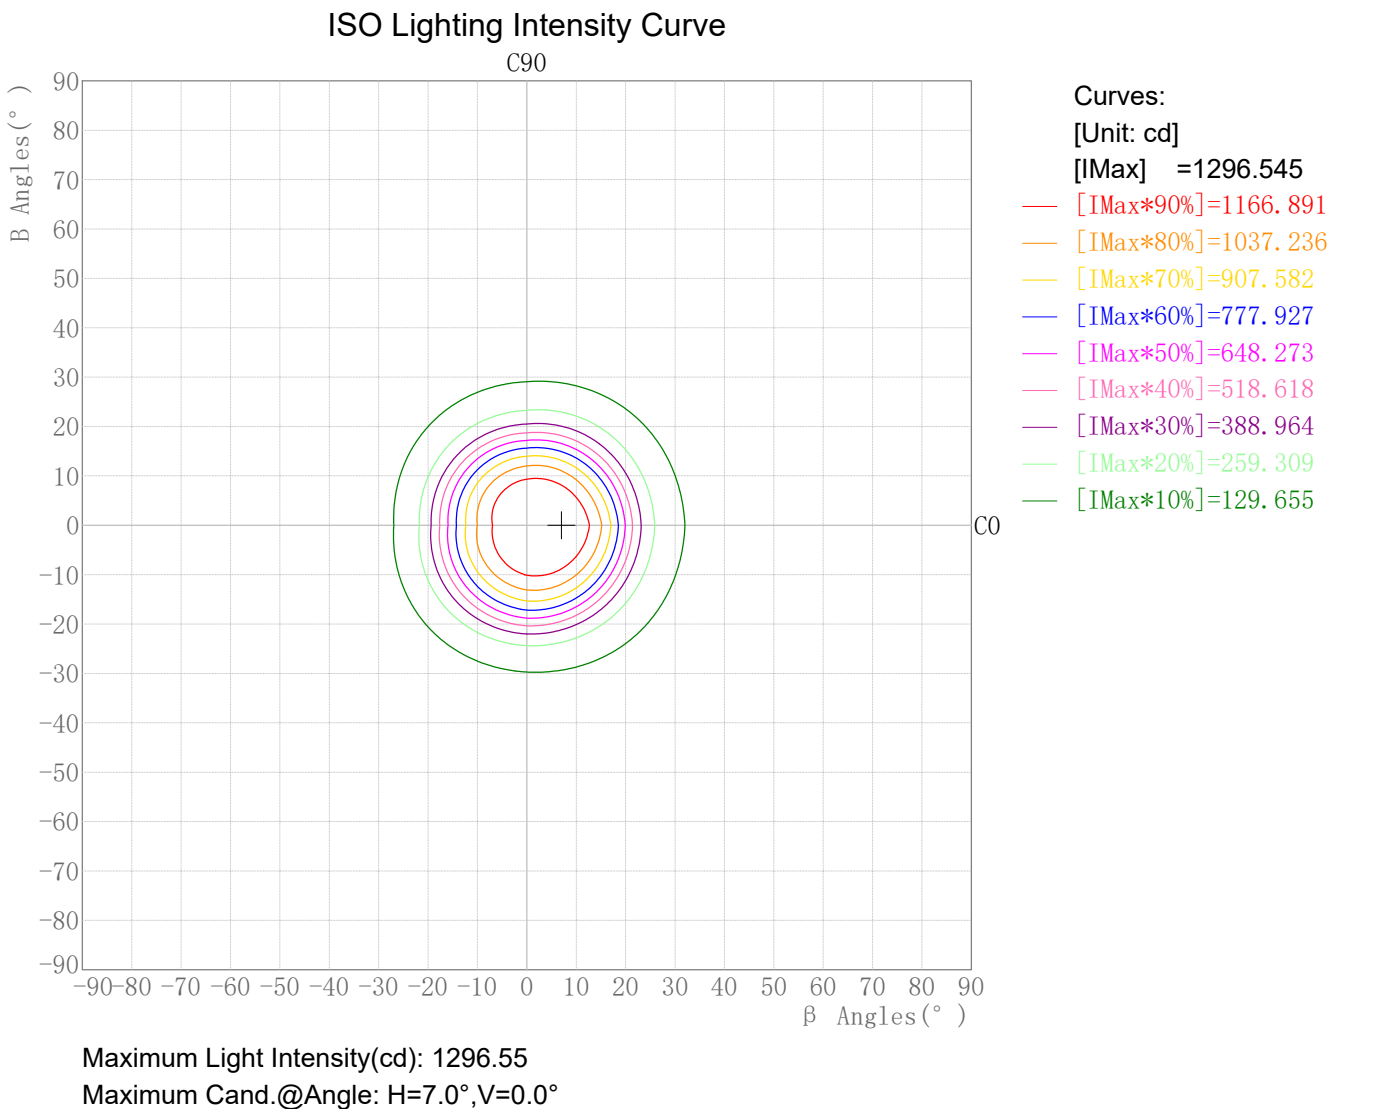

Plane ISO-Illuminance Diagram

Lum. Name:TR08-06-XX-04 3000K RA90 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Deparment
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/11/13

Plane ISO-Illuminance Curve

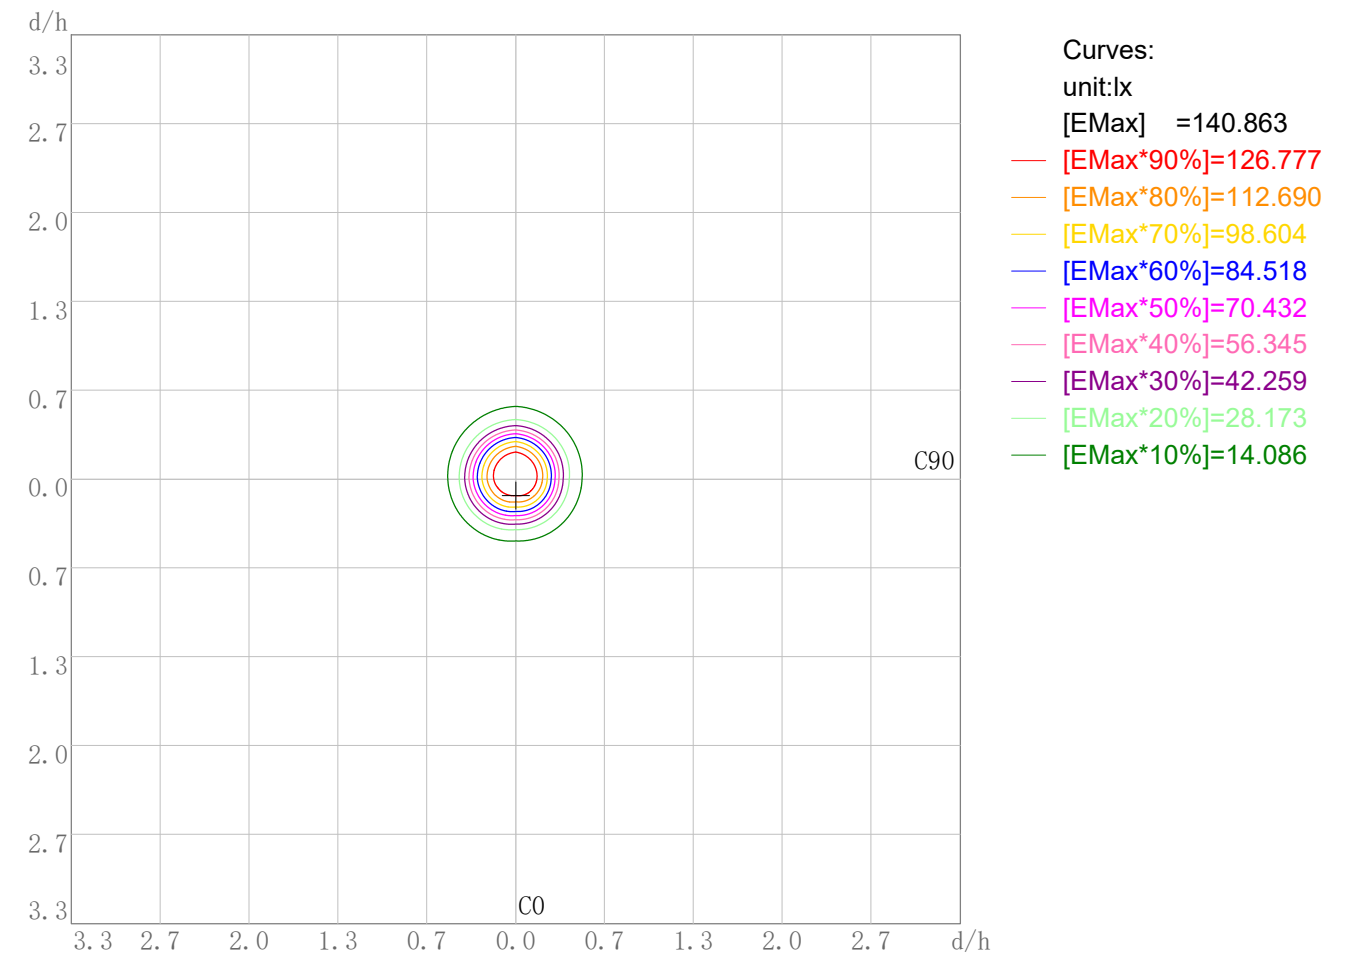

Working Plane Luminaire Mounting Height(m): 3.00
Working Plane Maximum Illuminance(lx): 140.86
Working Plane Maximum Illuminance Position(d/h):H0.0 V0.1


IES Indoor Report

Photometric Filename:TR08-06-XX-04 3000K RA90 36D.IES

3D Plane ISO Illuminance Diagram

Lum. Name: TR08-06-XX-04 3000K RA90 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/11/13

3D Plane Illuminance Modal

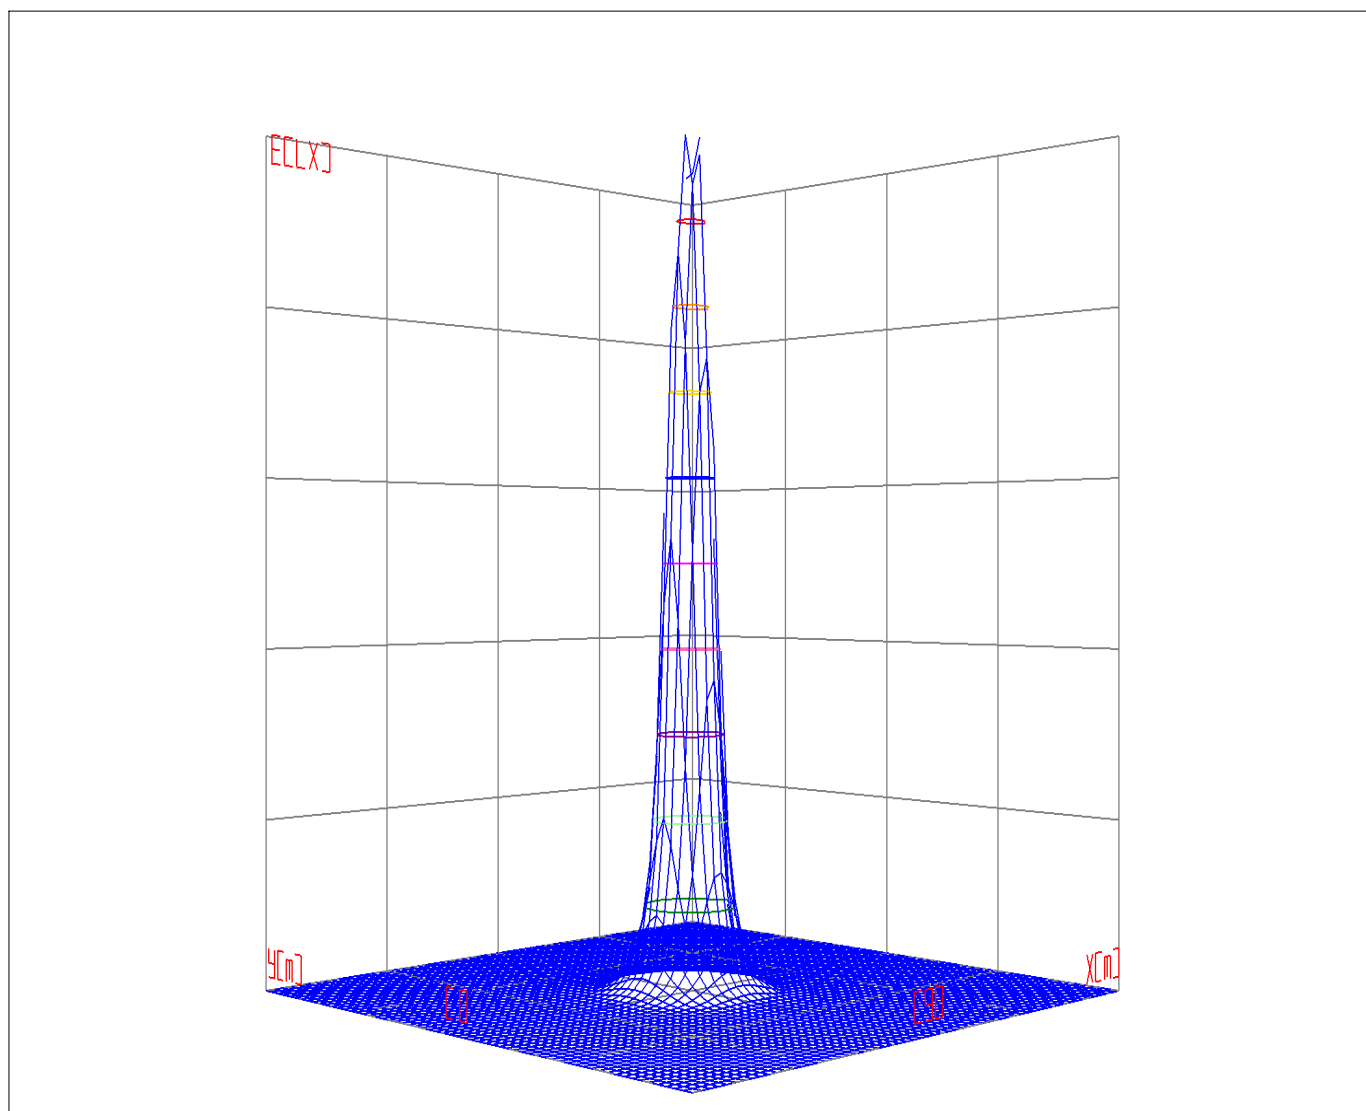


Curves: 3D Model — 90% — 80% — 70% — 60% — 50% — 40% — 30% — 20% — 10% —
View Angles(deg): 0 Height(m): 3.0 Distance(m): 10.0

Space ISO Illuminance Diagram

Lum. Name:TR08-06-XX-04 3000K RA90 36D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Deparment
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/11/13


Space ISO Illuminance Curve

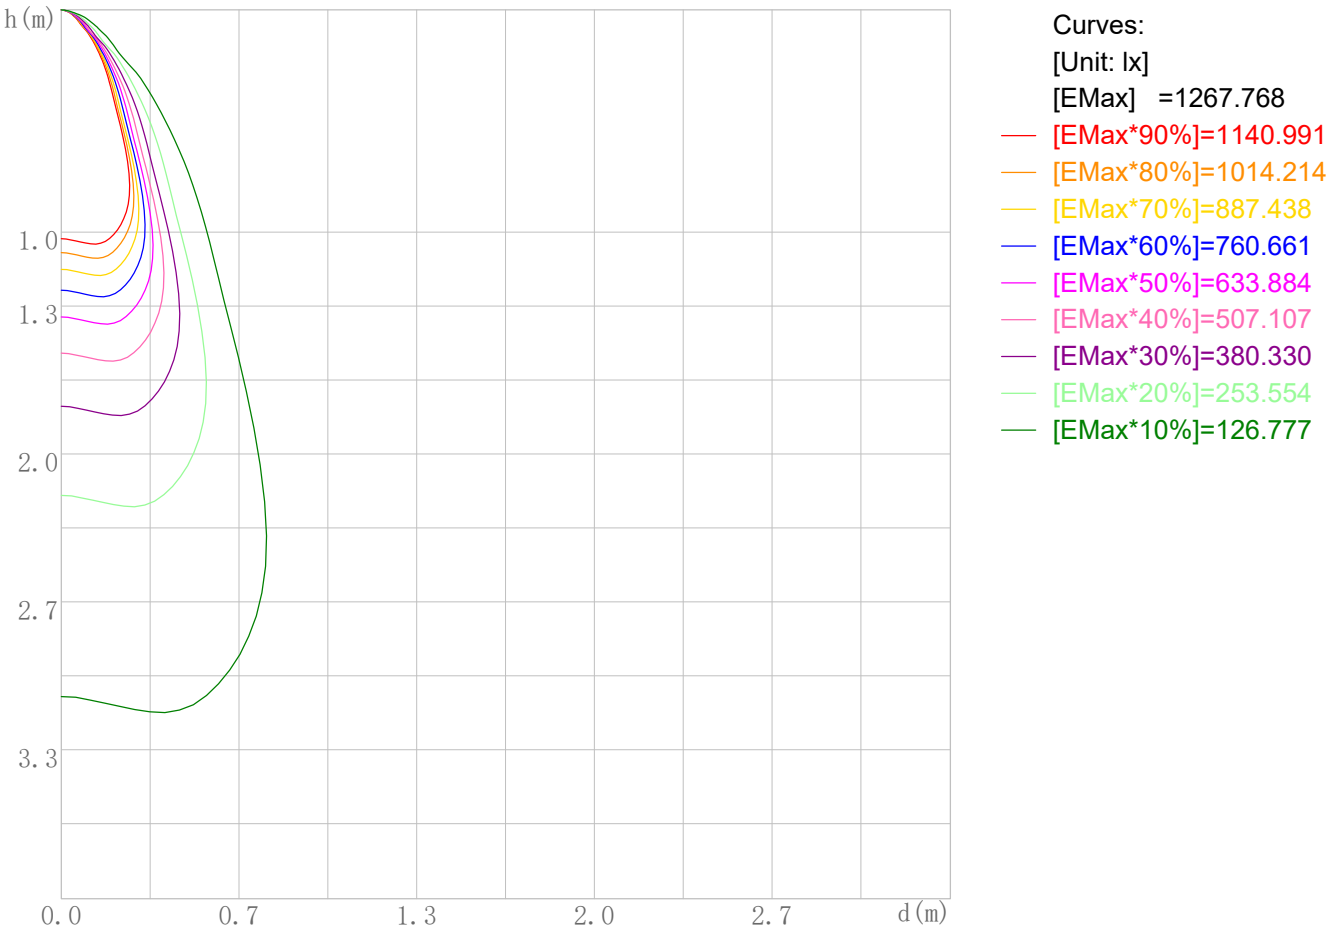

Space Plane Maximum Illuminance and @Angle:1267.77lx,7.0deg
Plane Maximum Lighting Intensity and @Angle:1296.545cd,0deg

Illuminance-Distance Diagram

Lum. Name:TR08-06-XX-04 3000K RA90 36D	Lum. Catelog:	Test ID:01
Lamp Name:	Lamp Catelog:LED	Test Lab:Quality Deparment
Manufacture:Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date:2021/11/13

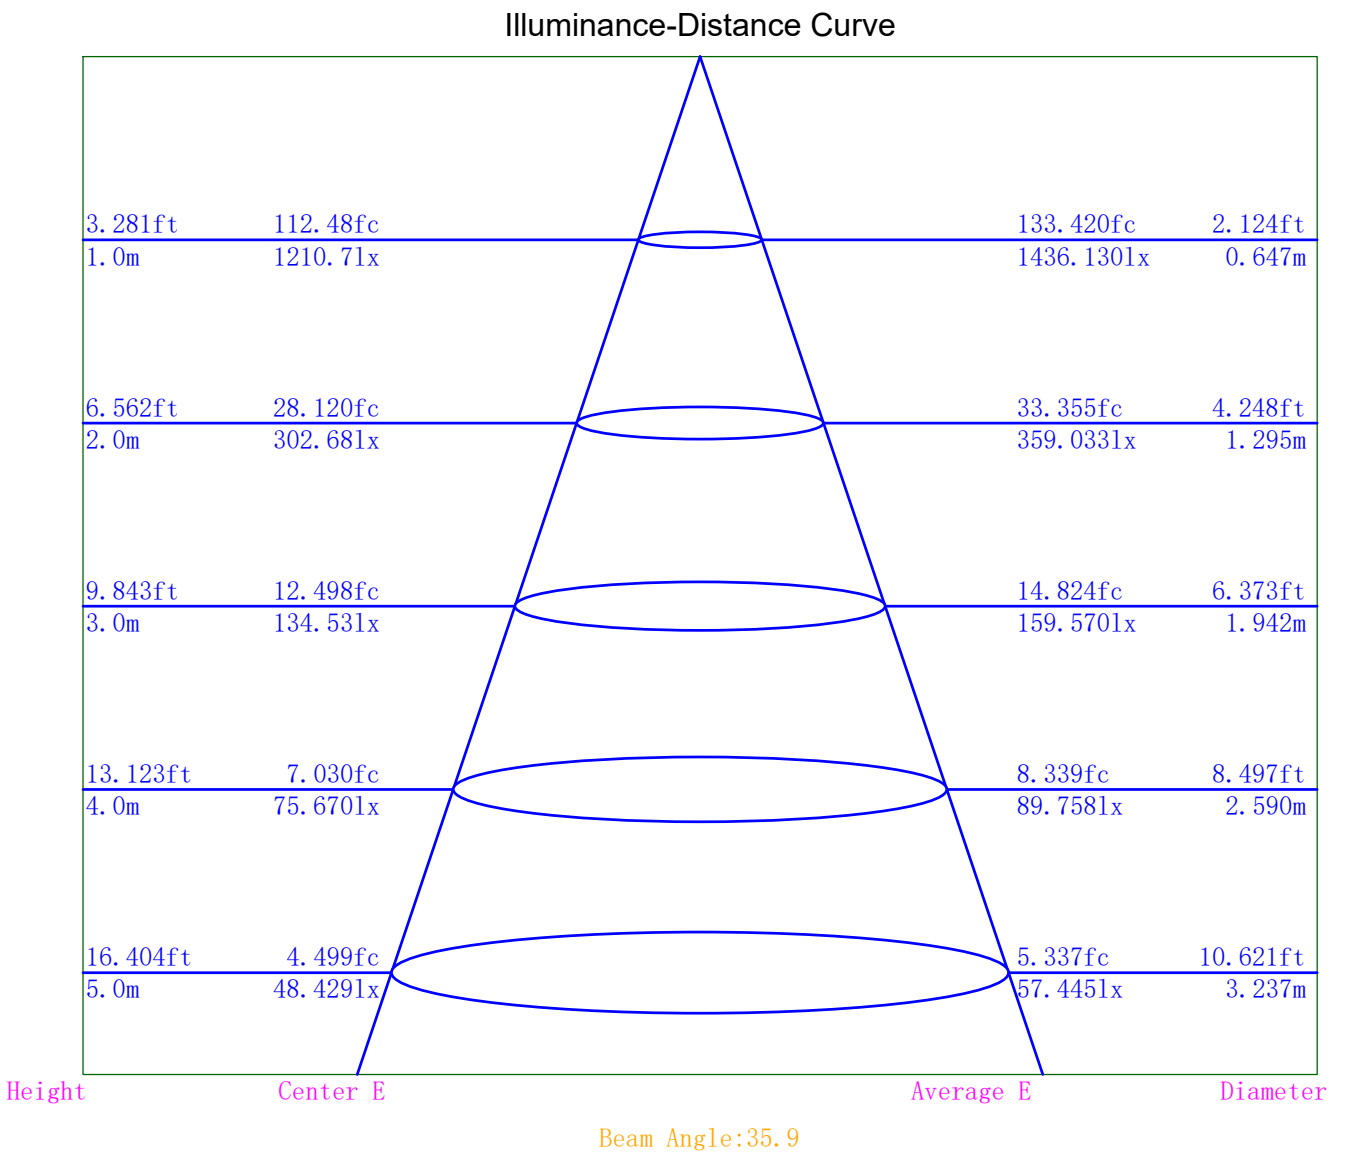

Indoor Luminance Limiting Curves

Lum. Name: TR08-06-XX-04 3000K RA90 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/11/13


Glare Grade Table

GI	Quality	Using Illuminance							
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E	a				2000	1000	500	<=300
			b	c	d	e	f	g	h

Luminance Table

Gama(deg)	45	50	55	60	65	70	75	80	85
C0	35049	18611	14355	10653	8567	7126	4112	1792	0
C90	17968	12602	8656	6483	5082	2457	0	0	0

Luminance Limiting Curve

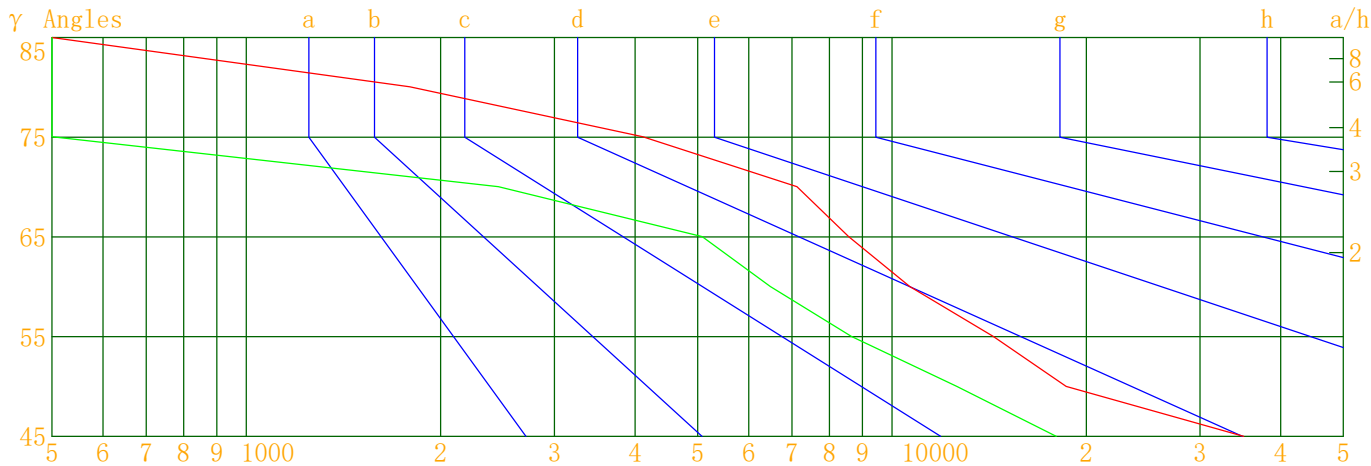


Luminous Size: Length(m)=-0.038 Width(m)=-0.038 Height(m)=0.000 Area(m^2)=0.001134

Luminous Type: Without Luminous Side

Luminous Curves: C0-C180 Color: C90-C270 Color:

Indoor Budgetary Estimate Table

Lum. Name:TR08-06-XX-04 3000K RA90 36D	Lum. Catalog:	Test ID:01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/11/13

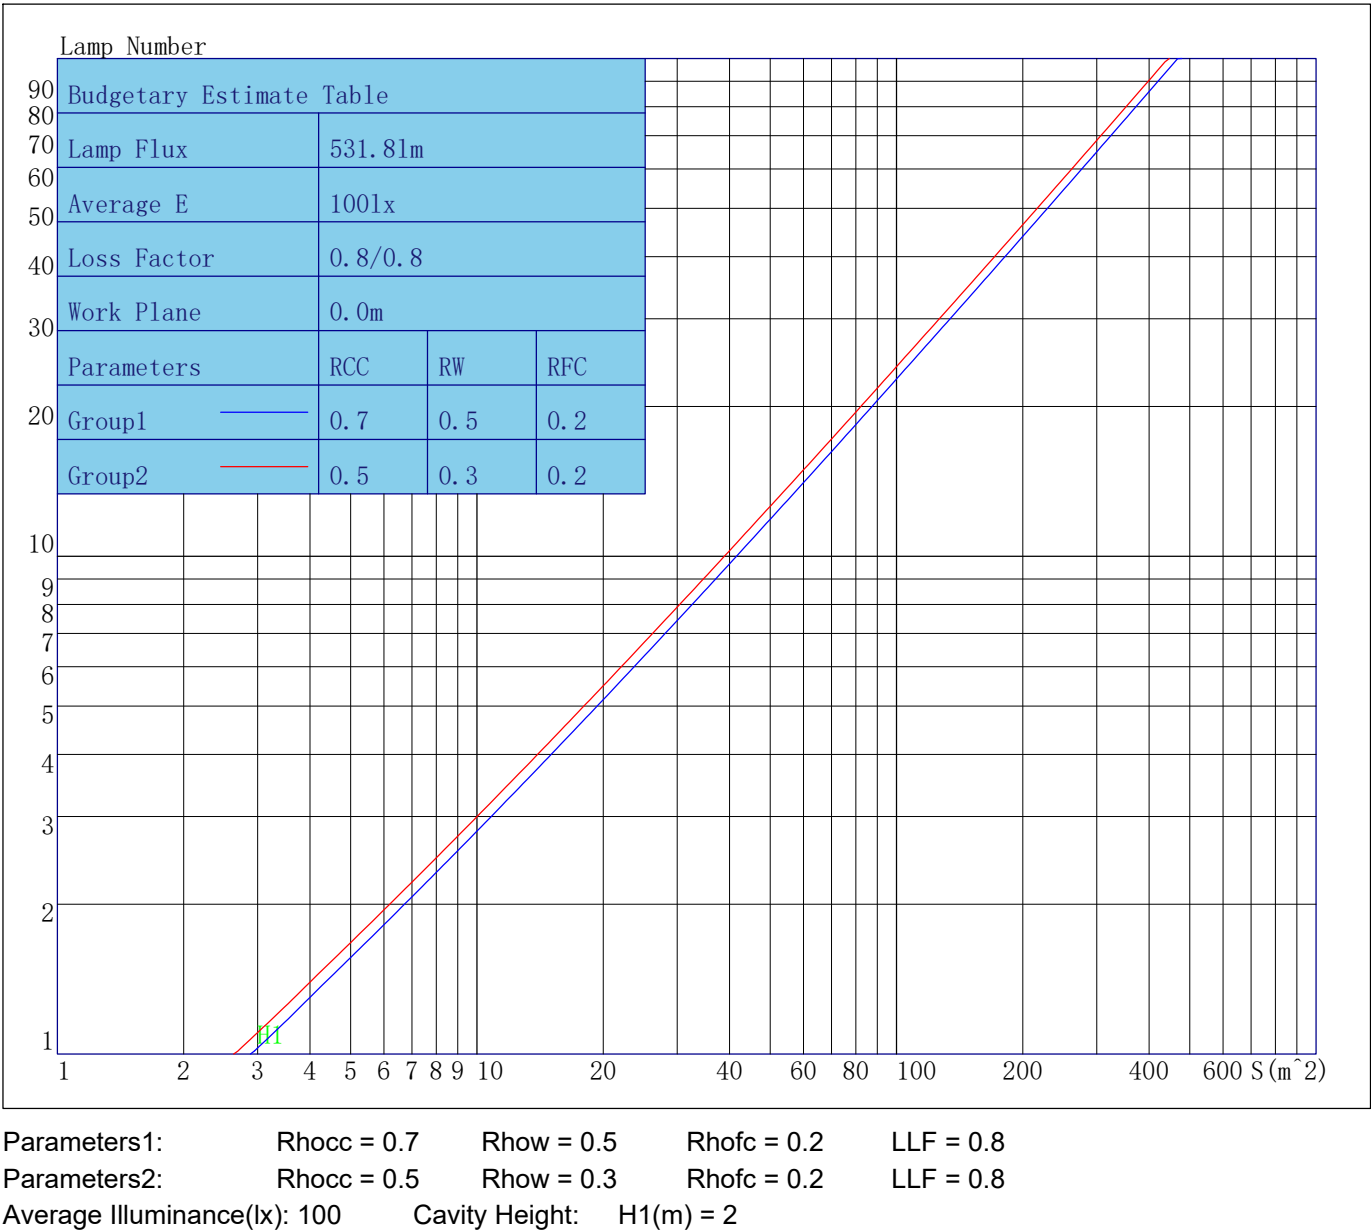

Indoor Coefficient of Utilization Table

Lum. Name: TR08-06-XX-04 3000K RA90 36D	Lum. Catelog:	Test ID: 01
Lamp Name:	Lamp Catelog: LED	Test Lab: Quality Deparment
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/11/13

Coefficients of Utilization - Zonal Cavity Method																		
Coef.	Effective Floor Cavity Reflectance RFC=0.20																	
RhoCC (%)	80				70				50			30			10			0
RhoW (%)	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	Coefficient of Utilization(%)																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95
2	110	106	102	99	108	104	101	98	101	98	96	98	96	94	95	93	92	90
3	105	100	96	92	103	99	95	92	96	93	90	94	91	89	91	89	87	86
4	101	95	90	87	100	94	90	86	92	88	85	90	87	84	88	85	83	82
5	97	90	86	82	96	90	85	82	88	84	81	86	83	80	85	82	80	78
6	94	86	81	78	92	86	81	78	84	80	77	83	79	77	82	79	76	75
7	90	83	78	74	89	82	77	74	81	77	74	80	76	73	79	75	73	72
8	87	79	74	71	86	79	74	71	78	74	71	77	73	70	76	73	70	69
9	84	76	71	68	83	76	71	68	75	71	68	74	70	68	73	70	67	66
10	81	73	69	65	80	73	68	65	72	68	65	71	68	65	71	67	65	64

Unified Glare Rating Table

Lum. Name: TR08-06-XX-04 3000K RA90 36D	Lum. Catalog:	Test ID: 01
Lamp Name:	Lamp Catalog: LED	Test Lab: Quality Department
Manufacture: Shenzhen Norming Lighting Co., Ltd	Test Machine:GON-2000	Test Date: 2021/11/13

Unified Glare Rating Table

Ceiling RCC	0.70	0.70	0.50	0.50	0.30	0.70	0.70	0.50	0.50	0.30
Wall RW	0.50	0.30	0.50	0.30	0.30	0.50	0.30	0.50	0.30	0.30
Floor RFC	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20	0.20
Room Size	Vewed crosswise					Vewed endwise				
X=2H Y=2H	18.4	19.4	18.7	19.7	20.0	16.2	17.2	16.6	17.5	17.8
	18.4	19.3	18.8	19.6	20.0	16.1	17.0	16.5	17.3	17.7
	18.3	19.2	18.7	19.5	19.9	16.0	16.8	16.4	17.2	17.6
	18.2	19.0	18.7	19.4	19.8	15.9	16.6	16.3	17.0	17.4
	18.2	18.9	18.6	19.3	19.7	15.8	16.5	16.3	16.9	17.4
	18.1	18.8	18.6	19.2	19.6	15.8	16.5	16.2	16.8	17.3
X=4H Y=2H	18.2	19.0	18.6	19.4	19.8	16.0	16.9	16.4	17.2	17.6
	18.2	18.9	18.7	19.4	19.8	15.9	16.6	16.4	17.1	17.5
	18.2	18.8	18.6	19.2	19.7	15.8	16.5	16.3	16.9	17.3
	18.1	18.7	18.6	19.1	19.6	15.7	16.3	16.2	16.7	17.2
	18.0	18.5	18.5	19.0	19.5	15.6	16.2	16.1	16.6	17.1
	18.0	18.4	18.4	18.9	19.4	15.6	16.0	16.1	16.5	17.0
X=8H Y=4H	18.0	18.5	18.5	19.0	19.5	15.6	16.2	16.1	16.6	17.1
	17.9	18.4	18.4	18.9	19.4	15.5	16.0	16.0	16.5	17.0
	17.8	18.2	18.4	18.8	19.3	15.4	15.8	16.0	16.4	16.9
	17.8	18.1	18.3	18.6	19.2	15.4	15.7	15.9	16.2	16.8
X=12H Y=4H	18.0	18.4	18.5	18.9	19.4	15.6	16.1	16.1	16.5	17.0
	17.9	18.2	18.4	18.7	19.3	15.5	15.8	16.0	16.3	16.9
	17.8	18.1	18.3	18.6	19.2	15.4	15.7	15.9	16.2	16.8
Variations with the objerver position at spacings										
S=1.0H	1.4/-1.7					1.7/-2.3				
S=1.5H	2.3/-3.1					4.2/-5.4				
S=2.0H	2.7/-4.7					4.6/-12.3				
Reduced UGR Table:										
Nordic Standard Table:	BK0					BK0				
Correction Value	0.3					0.2				

o the CIE Pub.117,data has been corrected,refers to the lamp's lumens 8.2flm.

IES Indoor Report

Photometric Filename:TR08-06-XX-04 3000K RA90 36D.IES

Candela Tabulation

V/H	C0.0	C90.0	C180.0	C270.0
γ 0.0	1210.73	1210.73	1210.73	1210.73
γ 1.0	1213.71	1219.98	1218.41	1195.25
γ 2.0	1225.64	1237.98	1225.01	1191.33
γ 3.0	1238.88	1256.60	1231.06	1196.50
γ 4.0	1254.69	1271.33	1232.01	1205.68
γ 5.0	1271.18	1275.74	1217.99	1218.72
γ 6.0	1285.93	1266.92	1194.89	1226.12
γ 7.0	1296.55	1247.35	1164.93	1228.13
γ 8.0	1296.24	1217.82	1126.99	1218.28
γ 9.0	1286.49	1181.47	1083.88	1200.49
γ 10.0	1263.74	1138.15	1039.41	1171.29
γ 11.0	1232.81	1091.52	987.85	1134.27
γ 12.0	1195.66	1037.80	929.54	1092.19
γ 13.0	1152.92	977.30	867.24	1042.68
γ 14.0	1102.14	906.45	797.13	987.60
γ 15.0	1047.21	828.76	721.42	928.39
γ 16.0	982.24	747.66	645.31	863.55
γ 17.0	908.96	664.49	568.33	791.48
γ 18.0	825.86	577.84	489.99	714.02
γ 19.0	734.67	494.12	414.03	632.02
γ 20.0	640.32	419.36	347.01	548.83
γ 21.0	551.18	358.20	292.26	465.43
γ 22.0	469.17	308.40	248.74	388.97
γ 23.0	398.18	268.19	215.33	324.92
γ 24.0	339.11	235.69	188.03	274.46
γ 25.0	291.24	208.06	165.29	235.23
γ 26.0	255.24	184.69	145.32	204.77
γ 27.0	225.70	164.20	128.47	180.07
γ 28.0	201.49	146.45	113.45	159.24
γ 29.0	180.36	130.73	100.14	140.99
γ 30.0	161.39	116.56	88.01	125.15
γ 31.0	144.50	103.88	76.77	111.49
γ 32.0	129.67	91.86	66.83	99.20
γ 33.0	116.04	81.09	58.33	87.86
γ 34.0	103.63	71.61	51.02	76.82
γ 35.0	91.88	63.50	44.70	67.56
γ 36.0	81.59	56.24	39.13	59.35
γ 37.0	72.51	49.81	34.21	52.45
γ 38.0	64.68	44.01	29.96	46.24
γ 39.0	57.56	38.90	26.35	40.89
γ 40.0	51.30	34.39	23.35	36.05
γ 41.0	45.63	30.46	20.13	31.95
γ 42.0	40.57	25.63	15.87	28.40
γ 43.0	36.16	20.04	13.01	25.40
γ 44.0	32.31	16.42	11.48	22.33
γ 45.0	28.11	14.41	10.44	18.09
γ 46.0	22.35	12.96	9.66	15.15

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 47.0	18.33	11.79	9.01	13.60
γ 48.0	16.24	10.80	8.46	12.49
γ 49.0	14.75	9.94	7.95	11.57
γ 50.0	13.57	9.19	7.47	10.81
γ 51.0	12.58	8.50	7.00	10.12
γ 52.0	11.68	7.86	6.38	9.52
γ 53.0	10.87	6.97	5.68	8.98
γ 54.0	10.11	6.21	5.23	8.42
γ 55.0	9.34	5.63	4.89	7.66
γ 56.0	8.29	5.22	4.61	6.93
γ 57.0	7.49	4.85	4.34	6.43
γ 58.0	6.91	4.48	4.03	6.06
γ 59.0	6.44	4.06	3.72	5.72
γ 60.0	6.04	3.68	3.45	5.42
γ 61.0	5.61	3.38	3.22	5.07
γ 62.0	5.17	3.13	3.01	4.73
γ 63.0	4.73	2.88	2.82	4.43
γ 64.0	4.39	2.67	2.61	4.18
γ 65.0	4.11	2.44	2.40	3.94
γ 66.0	3.84	2.20	2.16	3.72
γ 67.0	3.60	1.92	1.84	3.51
γ 68.0	3.35	1.57	1.49	3.27
γ 69.0	3.09	1.24	1.20	2.98
γ 70.0	2.76	0.95	0.93	2.60
γ 71.0	2.37	0.70	0.68	2.25
γ 72.0	2.04	0.47	0.45	1.93
γ 73.0	1.72	0.28	0.27	1.64
γ 74.0	1.45	0.10	0.11	1.37
γ 75.0	1.21	0.00	0.00	1.14
γ 76.0	0.99	0.00	0.00	0.94
γ 77.0	0.80	0.00	0.00	0.75
γ 78.0	0.64	0.00	0.00	0.59
γ 79.0	0.49	0.00	0.00	0.44
γ 80.0	0.35	0.00	0.00	0.31
γ 81.0	0.24	0.00	0.00	0.18
γ 82.0	0.12	0.00	0.00	0.06
γ 83.0	0.02	0.00	0.00	0.00
γ 84.0	0.00	0.00	0.00	0.00
γ 85.0	0.00	0.00	0.00	0.00
γ 86.0	0.00	0.00	0.00	0.00
γ 87.0	0.00	0.00	0.00	0.00
γ 88.0	0.00	0.00	0.00	0.00
γ 89.0	0.00	0.00	0.00	0.00
γ 90.0	0.00	0.00	0.00	0.00
γ 91.0	0.00	0.00	0.00	0.00
γ 92.0	0.00	0.00	0.00	0.00
γ 93.0	0.00	0.00	0.00	0.00

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 94.0	0.00	0.00	0.00	0.00
γ 95.0	0.00	0.00	0.00	0.00
γ 96.0	0.00	0.00	0.00	0.00
γ 97.0	0.00	0.00	0.00	0.00
γ 98.0	0.00	0.00	0.00	0.00
γ 99.0	0.00	0.00	0.00	0.00
γ 100.0	0.00	0.00	0.00	0.00
γ 101.0	0.00	0.00	0.00	0.00
γ 102.0	0.00	0.00	0.00	0.00
γ 103.0	0.00	0.00	0.00	0.00
γ 104.0	0.00	0.00	0.00	0.00
γ 105.0	0.00	0.00	0.00	0.00
γ 106.0	0.00	0.00	0.00	0.00
γ 107.0	0.00	0.00	0.00	0.00
γ 108.0	0.00	0.00	0.00	0.00
γ 109.0	0.00	0.00	0.00	0.00
γ 110.0	0.00	0.00	0.00	0.00
γ 111.0	0.00	0.00	0.00	0.00
γ 112.0	0.00	0.00	0.00	0.00
γ 113.0	0.00	0.00	0.00	0.00
γ 114.0	0.00	0.00	0.00	0.00
γ 115.0	0.00	0.00	0.00	0.00
γ 116.0	0.00	0.00	0.00	0.00
γ 117.0	0.00	0.00	0.00	0.00
γ 118.0	0.00	0.00	0.00	0.00
γ 119.0	0.00	0.00	0.00	0.00
γ 120.0	0.00	0.00	0.00	0.00
γ 121.0	0.00	0.00	0.00	0.00
γ 122.0	0.00	0.00	0.00	0.00
γ 123.0	0.00	0.00	0.00	0.00
γ 124.0	0.00	0.00	0.00	0.00
γ 125.0	0.00	0.00	0.00	0.00
γ 126.0	0.00	0.00	0.00	0.00
γ 127.0	0.00	0.00	0.00	0.00
γ 128.0	0.00	0.00	0.00	0.00
γ 129.0	0.00	0.00	0.00	0.00
γ 130.0	0.00	0.00	0.00	0.00
γ 131.0	0.00	0.00	0.00	0.00
γ 132.0	0.00	0.00	0.00	0.00
γ 133.0	0.00	0.00	0.00	0.00
γ 134.0	0.00	0.00	0.00	0.00
γ 135.0	0.00	0.00	0.00	0.00
γ 136.0	0.00	0.00	0.00	0.00
γ 137.0	0.00	0.00	0.00	0.00
γ 138.0	0.00	0.00	0.00	0.00
γ 139.0	0.00	0.00	0.00	0.00
γ 140.0	0.00	0.00	0.08	0.00

Candela Tabulation - (Cont.)

V/H	C0.0	C90.0	C180.0	C270.0
γ 141.0	0.00	0.00	0.18	0.00
γ 142.0	0.00	0.00	0.29	0.08
γ 143.0	0.00	0.00	0.39	0.18
γ 144.0	0.00	0.03	0.50	0.29
γ 145.0	0.00	0.12	0.60	0.38
γ 146.0	0.10	0.23	0.71	0.48
γ 147.0	0.22	0.33	0.80	0.58
γ 148.0	0.31	0.42	0.90	0.67
γ 149.0	0.41	0.51	0.99	0.77
γ 150.0	0.52	0.61	1.08	0.87
γ 151.0	0.62	0.70	1.16	0.95
γ 152.0	0.71	0.79	1.23	1.03
γ 153.0	0.81	0.87	1.31	1.12
γ 154.0	0.90	0.95	1.37	1.20
γ 155.0	1.00	1.02	1.43	1.27
γ 156.0	1.07	1.09	1.49	1.34
γ 157.0	1.14	1.15	1.53	1.39
γ 158.0	1.21	1.21	1.58	1.45
γ 159.0	1.30	1.26	1.59	1.51
γ 160.0	1.34	1.28	1.62	1.54
γ 161.0	1.39	1.31	1.63	1.57
γ 162.0	1.44	1.33	1.64	1.60
γ 163.0	1.48	1.34	1.65	1.61
γ 164.0	1.50	1.35	1.64	1.63
γ 165.0	1.52	1.35	1.63	1.63
γ 166.0	1.54	1.36	1.63	1.63
γ 167.0	1.56	1.35	1.60	1.61
γ 168.0	1.54	1.37	1.60	1.60
γ 169.0	1.57	1.37	1.58	1.60
γ 170.0	1.57	1.39	1.57	1.59
γ 171.0	1.57	1.40	1.58	1.59
γ 172.0	1.59	1.42	1.59	1.59
γ 173.0	1.58	1.44	1.59	1.59
γ 174.0	1.60	1.47	1.60	1.60
γ 175.0	1.61	1.50	1.60	1.62
γ 176.0	1.62	1.53	1.61	1.63
γ 177.0	1.63	1.55	1.62	1.65
γ 178.0	1.65	1.58	1.64	1.66
γ 179.0	1.65	1.58	1.64	1.68
γ 180.0	1.65	1.65	1.65	1.65